



Anguilla Renewable Energy Integration Project

Final Report

Presented to the

Government of Anguilla

**Ministry of Infrastructure, Communications,
Utilities, and Housing (MICUH)**

26 October 2012

Glossary of Terms

ANGLEC	Anguilla Electricity Company Limited
ANEC	Anguilla National Energy Committee
AREO	Anguilla Renewable Energy Office
BL&P	Barbados Light & Power
CARICOM	Caribbean Community
CARILEC	Caribbean Electric Utility Service Corporation
CDKN	Climate and Development Knowledge Network
CERs	Certified Emissions Reductions
CO ₂	Carbon Dioxide
COSS	Cost of Service Study
CSP	Concentrated Solar Power
DBOM	Design, Build, Operate, and Maintain
DFID	United Kingdom Department for International Development
DGIS	Netherlands Directorate-General for International Cooperation
ECERA	Eastern Caribbean Electricity Regulatory Authority
ECACC	Enhancing Capacity for Adaptation to Climate Change in the Caribbean UK Overseas Territories
EIAs	Environmental Impact Assessments
EXCO	Executive Council
FIT	Feed-in Tariff
GHG	Greenhouse Gas
GRENLEC	Grenada Electricity Services Ltd
IG	Imperial Gallon
IPCC	Intergovernmental Panel on Climate Change
IPPs	Independent Power Producers
IRR	Internal Rate of Return
kWh	Kilowatt Hour

LDCC	Land Development Control Committee
LRMCs	Long Run Marginal Costs
MICUH	Ministry of Infrastructure, Communications, Utilities and Housing
MSW	Municipal Solid Waste
MW	Megawatt
NEP	National Energy Policy
NPV	Net Present Value
NGO	Non-Governmental Organization
NCV	Net Calorific Value
NREL	National Renewable Energy Laboratory
O&M	Operations & Maintenance
OECS	Organization of Eastern Caribbean States
OTEC	Ocean Thermal Energy Conversion
OTEP	Overseas Territories Environmental Programme
PPA	Power Purchase Agreement
PUC	Public Utilities Commission
PV	Photovoltaic
RFP	Request For Proposals
SOC	Standard Offer Contract
SWAC	Seawater Air Conditioning
tCO ₂ e	Tons of Carbon Dioxide equivalent, as a common way to measure greenhouse gases ('equivalent' because all greenhouse gases other than CO ₂ are also measured in terms of CO ₂)
T&D	Transmission and Distribution
TPD	Tons Per Day
WACC	Weighted Average Cost of Capital

Table of Contents

1	Introduction	1
1.1	Scope of Work of this Assignment	1
1.2	Institutional Responsibilities for Renewable Energy Integration	2
1.3	Content of this Report	3
2	Objectives of Integrating Renewable Energy in Anguilla	5
3	Overview of Anguilla’s Power Sector	8
3.1	Key Entities in Anguilla’s Power Sector	8
3.2	Electricity Demand and Supply	9
3.3	Electricity Tariffs	10
4	Anguilla’s Policy, Legal, and Regulatory Framework for Electricity	12
4.1	Relevant Policy	12
4.2	Relevant Legal and Regulatory Framework	12
5	Anguilla’s Renewable Energy Potential	14
5.1	Current Uptake of Renewable Energy	15
5.1.1	No uptake of utility scale technologies	15
5.1.2	Limited uptake of distributed generation technologies	15
5.2	Economic and Commercial Viability of Renewable Energy	16
5.2.1	Screening of renewable energy technologies	16
5.2.2	Analysis of renewable energy technologies	18
5.2.3	Conclusions about the viability of technologies for renewable energy	23
5.3	Assessing the Cost of Additional CO ₂ Abatement	26
6	Barriers to Renewable Energy	28
6.1	Commercial Barrier—Lack of Commercial Viability	29
6.2	Legal and Regulatory Barriers	30
6.2.1	The right to use an energy resource—no barriers	30
6.2.2	The right to access and develop a site—no barriers for utility scale renewables, but solar water heaters face a problem	31

6.2.3	The ability to sell electricity generated—minor barrier for utility scale renewables, significant barrier for distributed scale renewables	33
6.2.4	Existence of adequate regulatory framework for electricity—significant barriers at both utility and distributed scale	33
6.3	Other barriers	35
6.3.1	Financing—a barrier for viable distributed scale renewables	36
6.3.2	Limited availability of equipment—a low barrier for viable distributed scale renewables	36
6.3.3	Institutional capabilities—minor barriers, but limited electrical inspection capacity	36
6.3.4	Technical skills—minor barriers	39
6.3.5	Information and awareness—barriers for solar, wind, and waste energy	40
7	Recommendations to Integrate Renewable Energy	41
7.1	Measures for Realizing Anguilla’s Immediate Renewable Energy Potential	43
7.1.1	Utility and distributed scale renewables: amend ANGLEC’s Licence and Electricity Supply Regulations by adding Rules for Renewable Energy	43
7.1.2	Utility scale: amend ANGLEC’s licence and Electricity Supply Regulations by adding tariff setting principles on recovery of sustainable energy costs	57
7.1.3	Utility scale: ANGLEC immediately to publish request for expressions of interest for solar PV	58
7.1.4	Utility scale: ANGLEC to add O&M in the solar PV Request for Proposals	59
7.1.5	Distributed scale: amend Electricity Act to extend exemption from licence also to the sale of excess electricity once the person has a contract with the public supplier	59
7.1.6	Distributed scale: ANGLEC to develop pilot Standard Offer Contract (SOC) with pilot disaggregated tariff	59
7.1.7	Distributed scale: mandate solar water heating for new facilities	60
7.2	Additional Legal and Regulatory Measures for Later	61

7.2.1	Utility and distributed scale: commission a Cost of Service Study	61
7.2.2	Utility and distributed scale: amend the Electricity (Rates and Charges) Regulations with a disaggregated tariff structure	62
7.2.3	Distributed scale: issue a revised Standard Offer Contract	63
7.2.4	Utility and distributed scale: determine the best option for a regulator to administer rules	63
7.3	Other Measures	63
8	Roadmap for Renewable Energy Integration in Anguilla	67
8.1	Complete Legal and Regulatory Framework for Renewable Energy	67
8.2	Implement Utility Scale Renewable Energy	69
8.3	Implement Distributed Scale Renewable Energy	70
8.4	Carry Out Ancillary Actions	71

Appendices

Appendix A : Institutional Outline of the Power Sector	73
Appendix B : Electricity Demand and Supply in Anguilla	77
Appendix C : Electricity Tariffs in Anguilla	86
Appendix D : Analysis of Anguilla’s National Energy Policy and Draft Climate Change Policy	88
Appendix E : Analysis of Anguilla’s Relevant Laws and Regulations	91
Appendix F : Estimated Conventional Generation Costs and Electricity Tariffs for Assessing Renewables	101
Appendix G : Renewable Energy Technologies	104
Appendix H : Calculation of Long Run Marginal Cost of Renewable Energy Generation	118
Appendix I : Calculation of Marginal Cost of Carbon Abatement for Renewable Energy Technologies	119
Appendix J : Recommended Changes to ANGLEC’s Licence and Electricity Supply Regulations	120
Appendix K : Optional Changes for ANGLEC’s By-laws or New Policy	124
Appendix L : Recommended Changes to the Electricity Act	125

Appendix M : Government’s Terms of Reference for Renewable Energy Integration in Anguilla	126
--	------------

Tables

Table 5.1: Screening Renewable Energy Technologies to be Assessed in Anguilla	16
Table 5.2: Summary of Potential Renewable Energy Technologies in Anguilla	23
Table 5.3: Conclusions about the Viability of Renewable Energy Technologies in Anguilla	24
Table 6.1: Critical Factors for the Successful Development of Renewable Energy	28
Table 6.2: Barriers to Economically Viable Renewable Energy Technologies	29
Table 6.3: Assessment of Institutional Capabilities	36
Table 7.1: Recommendations for Integrating Renewable Energy Technologies	42
Table 7.2: Options for Implementing New Utility Scale Renewable Energy Projects	47
Table 7.3: Key Questions and Answers on the Net Metering vs. Net Billing Debate	53
Table B.1: ANGLEC Generating Units in Service	80
Table E.1: Summary of Land Rights	100
Table F.1: Estimated Total Tariffs with Fuel at US\$4 per IG (US\$ per kWh)	103

Figures

Figure 3.1: Ownership of Anguilla Electricity Company Limited (ANGLEC)	8
Figure 3.2: ANGLEC Peak Demand (2006-2010) and Projected Peak Demand to 2015	9
Figure 5-1: Viability of Renewable Energy Technologies in Anguilla	19
Figure 5.2: CO₂ Abatement Cost Curve for Renewable Energy Technologies (US\$/tCO₂e)	26
Figure 7.1: Difference between Net Metering and Net Billing	50

Figure 7.2: Relative Fuel Consumption of a Wartsila Engine at Different Loads	52
Figure 8.1: Roadmap for Renewable Energy Integration in Anguilla	68
Figure A.1: Power Sector Governance in Anguilla	73
Figure B.1: ANGLEC Peak Demand (2006-2010)	77
Figure B.2: ANGLEC Total Electricity Sales (2001-2010)	79
Figure B.3: ANGLEC's Reserve Margin Compared to Other Caribbean Utilities (2010)	81
Figure B.4: ANGLEC's Generation Operating Cost compared to other Caribbean Utilities (2010)	83
Figure B.5: ANGLEC's Average Price of Fuel (US\$/IG) and WTI Crude (US\$/bbl)	83
Figure B.6: ANGLEC's Fuel Efficiency compared to other Caribbean Utilities (2010)	84
Figure B.7: ANGLEC's System Losses compared to other Caribbean Utilities (2010)	85
Figure C.1: Volatility of Fuel surcharge and Gulf Coast Prices of diesel No.2, 2007-2012	87
Figure F.1: Estimated All-in Costs of Generation of ANGLEC's Plants with diesel US\$4.00/IG	101

Boxes

Box 7.1:	Experience with Distributed Generation in the Caribbean
Box 7.2:	Solar PV with Net Billing at Avoided Fuel Cost from a Customer's Perspective in Anguilla

Executive Summary

The Anguilla Renewable Energy Integration Project aims at providing the appropriate legal and regulatory framework for implementing renewable energy in Anguilla. This Executive Summary provides an overview of the context for the assignment; the approach followed; and key findings and recommendations.

Context

Anguilla is a British Overseas Dependent Territory located in the Eastern Caribbean. It is a very small island (only 91 square kilometers) with a small population (about 15,000 people). The terrain is relatively flat and low lying, making the country vulnerable to the frequent hurricanes and tropical storms that affect the Caribbean region.

Anguilla, like many Caribbean countries, faces challenges for moving towards a more sustainable energy matrix. The three key challenges are:

- **High cost of electricity.** Like many of its Caribbean neighbors, Anguilla's small population means that the electric utility (Anguilla Electricity Company Limited, ANGLEC) has a small customer base. This does not allow for larger and more cost-effective power generation plants. The relative inefficiency of smaller diesel generators, as well as the high cost of imported diesel, results in high electricity costs in Anguilla. High costs of electricity are common in the Caribbean; but are very high by international standards
- **High dependence on imported fossil fuels.** Fossil fuels account for almost all of Anguilla's primary energy sources, and virtually all of its power generation. (There is some non-grid connected generation with solar photovoltaic, PV). Anguilla has no primary fossil fuel resources; therefore, it must import all fuel that it requires. This makes the island particularly vulnerable to high and frequently changing international oil prices
- **Vulnerability to environmental impacts.** Consuming fossil fuel creates local pollution that negatively impacts Anguilla's fragile environment. This also hurts the tourism industry, the main driver of Anguilla's economy. Anguilla's vulnerability to the effects of global climate change is disproportionately high when compared to the country's very small contribution to generating greenhouse gases (GHGs) through consumption of fossil fuels.

To some extent, Anguilla has the opportunity to address these challenges by implementing its renewable energy potential. However, doing so requires an appropriate legal and regulatory framework; as well as overcoming other barriers.

As a first step in this direction, the Government of Anguilla, with the support of the Climate and Development Knowledge Network (CDKN), asked Castalia to recommend how to improve Anguilla's legal and regulatory framework so that renewable energy may be integrated within the country's electricity system.

The scope of Castalia's assignment focuses essentially on the legal and regulatory changes needed to make renewable energy integration possible. To some extent, this report also

touches upon some other related matters (such as financial, capacity, and information barriers faced by renewable energy projects). Other related matters provide a more complete picture of opportunities for, and challenges to renewable energy in Anguilla; and should be considered for planning and implementing the subsequent steps of renewable integration.

Approach

Castalia followed a multi-step approach for this project, consulting with the Government and stakeholders in Anguilla along each step of the process.

To start the assignment, Castalia gathered information on Anguilla's electricity sector—in particular, relevant laws and regulations. Castalia met with the Government, as well as public and private stakeholders, to collect this information, and to understand the country's objectives for renewable energy integration.

Castalia used the information collected to assess Anguilla's viable renewable energy potential. We did this by screening renewable energy options based on two criteria: (i) availability of primary renewable energy sources (such as sunlight or wind) in sufficient quantity, and of a quality appropriate for renewable generation; and (ii) availability of commercially proven technologies to exploit the available renewable sources. For renewable energy technologies screened in, we assessed the economic and commercial viability. A renewable technology is defined as 'economically viable' if it generates electricity at a lower cost than conventional, diesel-fueled generation, and can save money to the country as a whole in the long term. A renewable technology is defined as 'commercially viable' if it generates savings for an individual customer implementing it (because it generates electricity at a cost that is lower than the tariff); or if it is a profitable business for an individual company that invests in it (because it generates electricity at a cost that is competitive in the market).

Having identified the viable renewable energy potential that should be happening, Castalia then identified the barriers that prevent it from doing so. Given the scope of this assignment, we focused primarily on legal and regulatory barriers. We analyzed the Electricity Act, and all legislation and regulation related to electricity and renewable energy. We identified some parts of the legal and regulatory framework that are appropriate for renewable energy integration, and that do not need to change; some other parts that contain provisions that prevent renewable energy integration, and that need to be amended; and some other provisions that contain gaps that need to be filled. To make the analysis of barriers more complete, we also identified other financial, institutional capacity, and awareness problems that block Anguilla's renewable energy potential.

Finally, we recommended changes to Anguilla's legal and regulatory framework to allow overcoming the barriers identified. We also recommended various ways to address the other barriers identified. We discussed our recommendations with the Government, ANGLEC, the Attorney General (AG), and other public and private stakeholders at the Anguilla Renewable Energy Integration Stakeholder Workshop on 24 April 2012. We also held further individual meetings with key public and private stakeholders. Finally, we met with the Government, ANGLEC, and the AG in August 2012 to further present and discuss our recommendations following feedback from the Workshop and comments received on our draft reports.

This Final Report considers comments received throughout the entire assignment from the Government, ANGLEC, the AG, and stakeholders.

Key findings and recommendations

Renewable energy can, to some extent, help Anguilla reduce energy costs, increase energy security, and enhance environmental sustainability.

The country's overall renewable energy potential is limited in that the key sources available (solar and wind) do not provide firm power. 'Firm power' means power that can be provided at any time from generating plant that can be turned on and off at will. Fossil fuel based generation is firm; some types of renewable energy generation (such as hydro or geothermal energy, which are not present in Anguilla) are also firm. However, solar generation and wind generation are not firm (although solar generation is more predictable than wind, and not as subject to as strong sudden changes). Firm generation can be used to meet base load ('base load' is the demand that is present at every time of the day, any day, and that constantly needs generation).

In spite of the limitations in Anguilla's natural endowment with renewable energy sources, there are several renewable energy options that would be viable in the country. Solar, wind, and perhaps waste-based energy options should be explored and exploited. These options are blocked by several barriers—legal and regulatory ones, in particular. The recommendations for improving Anguilla's legal and regulatory framework are the first important step towards helping the country realize its renewable energy potential.

Objectives of renewable energy integration

According to the Government and the overwhelming majority of stakeholders we met, Anguilla's priority objective for integrating renewable energy is to reduce electricity costs in the long term (Anguilla's electricity costs are among the highest in the region). This objective is consistent with one of the primary goals of Anguilla's National Energy Policy: "ensure universal access to an affordable electricity supply for all Anguillans".

Increasing energy security, and enhancing local and global environmental sustainability are two other important objectives. Given that reducing costs is the priority, these two other objectives should be pursued only to the extent that costs may be reduced at the same time.


Achieving all of these objectives at the same time is possible, because the renewable energy options that are available in Anguilla are all economically viable (that is, they may reduce costs to the country as a whole over the long term). Therefore, they avoid imports of fuel, and do not emit polluting substances, particulate matter, or greenhouse gases—while also saving money.

Anguilla's renewable energy potential: several viable options, largely unrealized

Uptake of renewable energy is very limited in Anguilla. There is no utility scale renewable electricity plant. ('Utility scale' indicates large-scale plants that are installed at a designated site, for supplying power to all customers at high voltage over the grid.) There is almost no distributed renewable generation; and the little that exists is not connected to the grid. ('Distributed scale' technologies are smaller-scale technologies that are, as their name says, distributed across the grid—at customers' premises, or close to them.)

In spite of almost no uptake, our assessment of the viability of renewable energy technologies in Anguilla (summarized in Figure ES1 below) suggests that there are several renewable energy options that could reduce the country's electricity generation costs over the long term. The figure compares generation costs of conventional options (vertical lines) with the generation costs of renewable options (horizontal bars).

Figure ES1: Viability of Renewable Energy Technologies in Anguilla (US\$ per kWh)

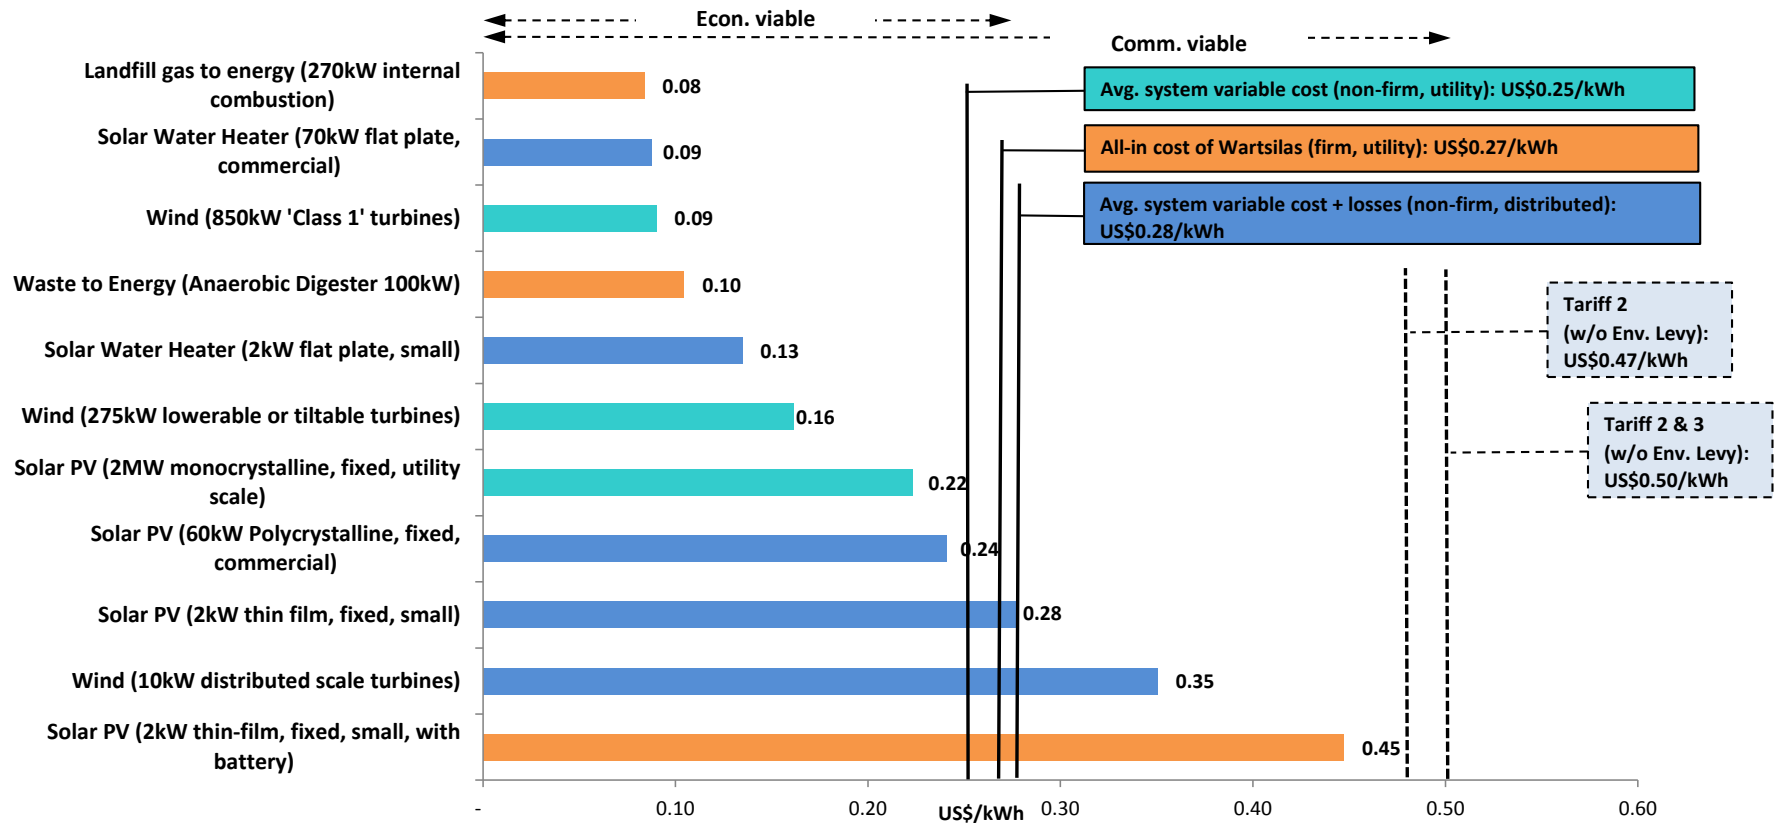

Explanation: This figure analyzes the cost to generate 1 kilowatt hour of electricity (US\$/kWh), comparing renewable options (horizontal bars) and conventional options (vertical lines) based on a diesel price assumption of US\$4 per Imperial Gallon (IG). Estimated tariffs (dotted vertical lines) allow comparing the cost of generating electricity with small renewables with that of buying it from the grid, based on the same diesel price assumption of US\$4 per IG.

Note: Conventional generation costs and tariffs shown are not historical values (for example, ANGLEC's highest tariff as of May 2012 is US\$0.43 per kWh), but estimates for analytical purposes, based on an assumption of diesel prices at US\$4.00 per IG. In particular, tariffs shown are estimated based on the fuel surcharge that could be applied if diesel cost were US\$4 per IG; ANGLEC reports that it does not always charge the full fuel surcharge that could be applied, and charges a lower fuel surcharge instead. Indicative Long Run Marginal Costs (LRMCs) of renewable energy technologies are based on assumptions about their cost and performance explained in Appendix G; and using a 11% discount rate for utility scale technologies, and 9% for distributed scale technologies, as explained in Appendix H. Landfill gas to energy and waste to energy estimates are subject to there being enough waste. The average system variable cost benchmark for distributed generation is grossed up for system losses (12%), because distributed technologies also avoid those losses.

Economically viable technologies would be:

- **Solar water heating**—flat-plate systems (both small and commercial scale for homes and businesses)
- **Solar PV**—at utility scale, and at distributed (commercial and small) scale
- **Wind**—‘Class 1’ turbines (which withstand very strong winds) and lowerable/tiltable turbines (which can be lowered or tilted when the wind is too strong), both at utility scale
- **Waste-based technologies**—provided that there be sufficient quantity of waste of sufficiently good quality in the medium-long term, waste-based technologies on a small scale but operated commercially could be viable. Viable technologies could include landfill gas to energy, and waste to energy (anaerobic digestion).

All of the above technologies would also be commercially viable. As noted, this means that they could save money to customers, or be a profitable business for companies (including the utility) that implement them.

Distributed scale solar PV with a battery and distributed scale wind would not be economically viable since they would cost more than diesel-fired generation. However, they would be commercially viable because they would save money to customers who implement them, because they generate electricity at a cost that is lower than the tariff (as the tariff is currently designed, and assuming continued high oil prices).

Economically viable technologies would also abate GHGs (measured in US Dollars per ton of carbon dioxide equivalent, tCO₂e) at no additional cost: they generate electricity that does not emit GHGs while also saving money.

As noted above, although Anguilla can count on several economically viable options for renewable energy, the country’s overall renewable energy potential is limited because of no ‘firm’ options that can be used for base load. In addition, Anguilla’s clearest renewable option (solar PV) is only marginally viable: currently, its cost of generation is not too much lower than that of diesel, assuming diesel prices of US\$4 per gallon. (However, further cost reductions in the cost of solar PV are expected.) Therefore, unfortunately diesel-fired generation will still be needed in Anguilla for the foreseeable future, even if the country realizes its full renewable energy potential.

In summary, Anguilla’s renewable energy potential is good, and likely to help the country save on fuel costs and stabilize energy prices in the long term. However, it is unlikely to create profound savings and changes, at least in the short to medium term.

Barriers that prevent viable renewable options from happening

In spite of a good potential, viable renewable energy options are not happening in Anguilla due to a number of barriers related to laws, regulations, financing, institutional capacity, and information.

Table ES1 below provides a summary assessment of potential barriers to economically viable technologies. (No barriers are considered for technologies that are not economically viable: if they are not being implemented, the reason is precisely that they are not viable.) For each potential barrier in the table, a number zero indicates that there is no barrier; a number one

indicates a low barrier; a number two indicates a medium barrier; and a number three indicates a high barrier.

Table ES1: Barriers to Economically Viable Renewable Energy Technologies

	Utility Scale Renewables	Distributed Scale Renewables
Commercial barrier		
Lack of commercial viability	0 (all commercially viable)	0 (all commercially viable)
Legal and regulatory barriers		
Lack of clear rights to use a resource	0 (no unclear property rights for solar, wind, and waste energy)	0 (no unclear property rights for solar, wind, and waste energy)
Lack of right to access and develop a site	0 (clear rights in place in the rules—although flaws and social norms affect the efficiency and effectiveness of these rules)	1 (clear rights—but often buildings are such that solar water heaters are impossible or too costly to install)
Inability to sell electricity generated	1 (IPPs can operate under ANGLEC’s licence; DBOM contracts are possible; but no own licence is possible for IPPs)	3 (customers cannot connect their systems or sell their excess electricity to the grid)
Regulatory distortions	3 (no obligation to operate on least cost basis; limited rate review process; uncertain cost recovery, unlike for fossil fuels)	3 (tariff structure is disincentive to allow sale of excess electricity generated from customer-owned distributed systems)
Other barriers		
Limited financing	0 (no significant financing barrier for larger actors)	2 (high upfront cost and general limited access to credit)
Limited availability of equipment	0 (no particular barrier)	1 (equipment mostly available, not always competitively priced)
Limited institutional capabilities	1 (limited capabilities, but can be overcome or contracted out)	2 (limited capabilities, but can be overcome or contracted out; limited capacity for electrical inspection)
Limited technical skills	1 (limited expertise, but can be contracted or acquired quickly)	2 (limited expertise, with some exceptions)
Limited information and awareness	2 (limited information on wind and waste for power generation)	2 (limited awareness about solar PV and water heating)

Notes: 0 = not a barrier; 1 = low barrier; 2 = medium barrier; 3 = high barrier; NA = Not Applicable. DBOM = Design, Build, Operate, and Maintain; IPP = Independent Power Producer

A good way to understand barriers is to think about them as the lack of critical factors that are needed to ensure the success of any renewable energy project. For the purposes of our assignment, which focuses on changes needed to laws and regulations, critical factors are:

- Commercial viability (utility scale renewables must generate at a competitive cost compared to other options; distributed ones must generate at a cost that allows saving on one’s bill)

- The right to use the primary renewable energy resource (sunlight, wind, or waste)
- The right to access and develop the site where the renewable energy project is to be set up and operated
- The ability to sell electricity generated at a reasonable price
- An adequate regulatory framework for electricity (meaning, a complete body of rules that ensure good quality of service at a reasonable cost)
- A regulatory body with the power and ability to effectively administer and enforce those rules.

Other critical factors are access to financing at reasonable terms; sufficient availability of equipment that is competitively priced; appropriate institutional capabilities; good technical skills; and adequate information and awareness.

Recommendations for overcoming barriers identified

Table ES2 summarizes our recommendations for overcoming barriers to renewable energy related to laws, regulations, financing, institutional capacity, and information. The table shows priority measures to be implemented in the short term (we indicate the short term with ‘now’, as discussed with the Government, to convey the urgency of adopting these measures); and measures that could be implemented after the priority measures are taken (‘later’), but as soon as possible—and no later than 2015 (the Roadmap in section 8 shows a timeline for implementing all measures from 2012 to 2015). Measures recommended are interrelated, and should be considered as part of one coherent design—they should all be implemented to ensure success in integration of renewable energy.

In cases where there is no barrier, we do not recommend any measure. In particular:

- There are **no barriers of commercial viability**—electricity generation with solar, wind, and waste can be profitable for those who develop them. A company could use solar, wind, or waste energy as competitive options to generate power for the market; customers could use solar PV to generate power for own use that costs less than that bought from the grid
- There are also **no legal or regulatory barriers to the right to use solar, wind, and waste resources**. Anyone who can capture sunlight and wind can use it to generate electricity; and anyone who owns waste can also use it. For the case of waste, only a public supplier is legally allowed to generate electricity. However, this is not a barrier: the reason is that for waste-based electricity generation to be feasible in Anguilla, all of the available waste should be aggregated for one utility scale project (however small) that would be operated commercially. Either the public supplier or a third party operating under the public supplier’s licence could pursue this option
- There are also **no legal or regulatory barriers to accessing and developing sites for utility scale renewables**. All the rights are in place in the law. (Although enforcement of these rights has been difficult, new procedures in draft legislation are likely to improve the current situation).

Table ES2: Recommendations for Integrating Renewable Energy Technologies

	Utility Scale Renewables	Distributed Scale Renewables
Commercial barrier		
Lack of comm. viability	No barrier —no measure	No barrier —no measure
Legal and regulatory barriers		
Lack of clear rights to use a resource	No barrier —no measure	No barrier —no measure
Lack of right to access and develop a site	No barrier —no measure	Now —Mandate solar water heaters for new buildings
Inability to sell electricity generated	<p>Now—Amend ANGLEC’s licence and the Electricity Supply Regulations by adding ‘Rules for Renewable Energy’ to develop, procure, or contract utility scale renewables under ANGLEC’s licence</p> <p>Now—Publish a request for EOIs for the planned solar PV tender</p> <p>Now—Include O&M in RFP for solar PV tender</p>	<p>Now—Amend ANGLEC’s licence and the Electricity Supply Regulations by adding ‘Rules for Renewable Energy’ to create a SOC</p> <p>Now—Amend Electricity Act by extending licence exemption to the sale of excess renewable electricity to the public supplier under a SOC</p> <p>Now—Issue a pilot SOC with a limited cap and a pilot disaggregated tariff</p> <p>Later—Issue a revised SOC with a revised cap</p>
Regulatory distortions	<p>Now—Amend ANGLEC’s licence and the Electricity Supply Regulations by adding (i) a definition of ‘Approved Renewable Energy Costs’; and (ii) a cost recovery principle for ‘Approved Renewable Energy Costs’</p> <p>Later—Commission COSS; Amend Electricity (Rates and Charges) Regulations with disaggregated tariff structure; Determine best option for regulator to administer rules</p>	
Other barriers		
Limited financing	No barrier —no measure	Later —Use this report to secure low-cost financing, guarantees, and grants for solar projects (water heating, PV); Set up consumer financing initiative
Limited availability of equipment	No barrier —no measure	
Limited institutional capabilities	Now —Secure funding for further activities, such as a cost of service study or broader power sector reform	Later —Secure funding for further activities; Strengthen capacity of Electrical Inspector’s Office to deal with SOC
Limited technical skills	Now —Include O&M when procuring a specialized contractor	Later —Check any rules related to electrical wiring or installation
Limited information and awareness	Later —Assess quantity and quality of wind and waste resources	Later —Adopt external certification for installers of renewable technologies
<p>Notes: DBOM = Design, Build, Operate, and Maintain; O&M = Operations and Maintenance; IPP = Independent Power Producer; COSS = Cost of Service Study; RFP = Request for Proposals; EOI = Expression of Interest; SOC = Standard Offer Contract. ‘Now’ = short term; ‘Later’ = as soon as possible after the short term measures are implemented, and no later than 2015.</p>		

The paragraphs below focus on the recommendations for overcoming legal and regulatory barriers that are blocking economically viable renewable energy in Anguilla.

The first barrier we encounter is related to the **right to access and develop a site for distributed scale renewables**—particularly solar water heaters. All rights are in place, and distributed scale renewables do not qualify as ‘developments’ (which makes their development subject to fewer requirements, and easier). However, there is a specific problem for solar water heaters: new buildings can be developed in a way that makes it impossible or very costly to install one. Our first recommendation is therefore as follows.

Now—Mandate solar water heaters for new buildings. When a building wants water heating, it should be solar, and of a type that is appropriate for the Caribbean. This could be implemented as an amendment to the Building Regulations; incorporated into the draft Building Code; or simply included as a step in the permitting process (like it is done for underground water tanks in Anguilla: if a new construction does not have one, it obtains no permit). Exemptions may be provided for customers to opt out under certain circumstances (such as for low income households). However, even in these cases the buildings should be developed with the necessary plumbing and wiring, in the event that a future owner or tenant wants to install a solar water heater.

With respect to the **ability to sell electricity generated**, barriers are less severe for utility scale renewables than for distributed scale ones:

- For utility scale renewables, the only option that is not possible in the existing framework is for independent power producers (IPPs) to operate under their own licence, which is not contemplated under the law. On the other hand, there are three other options that are available under the law, the latter two of which ensure a role for third parties: (i) ANGLEC can sell electricity generated by renewable projects that it implements itself; (ii) IPPs can operate under ANGLEC’s licence, and sell power to ANGLEC through a power purchase agreement (PPA) without the need for a new licence—because ANGLEC is allowed to assign all or some of its licence rights to others; and (iii) ANGLEC can hire a specialized contractor to design, build, operate, and maintain (DBOM) a renewable energy plant
- For distributed scale renewables, on the other hand, there is no option available: currently, customers cannot connect their systems or sell their excess electricity to the grid.

Given this situation, our recommendations to overcome barriers to the ability to sell electricity generated from renewables are as follows.

Now—Amend ANGLEC’s Public Supplier’s Licence and the Electricity Supply Regulations by adding ‘Rules for Renewable Energy’. Doing this would provide the complete framework for ANGLEC to develop renewable generation itself; procure under DBOM arrangements the development of renewable energy projects; or contract (buy) renewable electricity from large and small IPPs. The recommended amendment could be done by adding a Schedule to ANGLEC’s licence and to the Electricity Supply Regulations. The Schedule would contain Rules for Renewable Energy (‘the Rules’) drafted as part of this assignment and contained in Appendix J:

- For utility scale renewables, the rules would **establish a best practice process to develop, procure, or contract new renewable energy generation capacity**. The process would include the following phases: (i)

preparing a demand forecast; (ii) preparing a least cost generation plan with full consideration of renewables, while preserving system reliability and power quality, and creating no unreasonable financial risk; (iii) participating in a consultation with the public; (iv) obtaining approval of the least cost generation plan; (v) identifying the best option to design, build, operate, maintain, and finance projects (fully developed by ANGLEC; procuring a DBOM contractor; or contracting an IPP under ANGLEC's licence); (vi) when using the DBOM or the IPP option, running a competitive, transparent procurement process (with clear eligibility criteria; a clear evaluation process and rules; and a prequalification stage before the stage of requests for proposals); and (vii) implementing projects (including awarding their implementation to third parties)

- For distributed scale renewables, the Rules would lead to a **well designed Standard Offer Contract (SOC)** that: (i) identifies a technically and economically viable cap for eligible distributed generation to contribute to the energy mix; (ii) creates a grid and distributed generation code setting out rules for interconnecting distributed renewable energy generation to the grid; (iii) establishes a net billing arrangement under which ANGLEC would buy excess power from eligible customers at a fair rate set at actual avoided fuel cost (that is, considering ANGLEC's cost of generation that is offset by distributed generation under realistic dispatching conditions), and for a term no less than a system's useful lifetime—usually 20 years); and (iv) introduces, in accordance with ANGLEC's licence, any changes to tariffs and supply conditions that are necessary to ensure that customers who both buy from, and sell electricity to ANGLEC pay for no more and no less than the services they actually receive. Currently, customers pay for three separate services through one same rate. Energy, backup and standby capacity, and connection to the distribution grid are all bundled in the base rate. Under a SOC, customers would have to pay less for energy since they generate some energy themselves; but would still have to pay for backup and standby, and connection to the distribution grid, because they would still be receiving those services.

Now—ANGLEC to publish a request for Expressions of Interest (EOIs) for solar PV. ANGLEC's initiative to procure a 1MW solar PV plant is an excellent idea, and should not be delayed. We only recommend adding a prequalification stage (request for EOIs) to the procurement process for the utility scale solar PV plant, according to best practice procurement procedures. ANGLEC has implemented this recommendation.

Now—ANGLEC to add Operations & Maintenance (O&M) in the Request for Proposals (RFP) for solar PV. ANGLEC's draft RFP to procure the design and building of a 1MW solar PV plant is well structured and appropriate. However, we recommend that ANGLEC consider adding an O&M component (even a short one), turning it into a DBOM contract. Once the Rules are adopted, we recommend that ANGLEC check that the RFP complies with them, so that it may be certain to recover that cost through tariffs, and make a reasonable return on it.

Now—Amend the Electricity Act to extend the exemption from a licence also to the sale of excess electricity under a SOC. Customers that enter into a SOC with ANGLEC

should not need a licence to generate and sell electricity using their distributed scale renewable systems. Licenses may be difficult and time-consuming to obtain; and negotiating a licence on a case-by-case basis only makes sense for larger projects. The SOC ‘package’ itself should work like a standardized licence to sell electricity generated by distributed scale systems. Enabling customers to generate and sell renewable electricity to the public supplier without a licence requires a simple, but extremely important, amendment to the Electricity Act: adding to the exemption from a licence to generate electricity with wind and solar the words “or selling excess electricity to a public supplier if the person has a contract with the public supplier to do so” (see the full amendment in Appendix L).

Now—ANGLEC to develop pilot SOC with pilot disaggregated tariff. A pilot SOC would allow starting the development of distributed renewables in the short term, and would be the first step of a gradual approach. The pilot SOC should be accompanied by a pilot disaggregated tariff for customers who participate in the initiative. Fortunately, the law already allows for special tariffs to be agreed upon between the utility and its customers under special circumstances (as a SOC would be), with no need for a general rate case involving all customers.

With respect to the **existence of an adequate regulatory framework**, there are important barriers that should be addressed later. Anguilla’s regulatory framework only contains the very basic elements of power sector regulation, and is out of date. There are very few rules available on how to plan, implement, operate, and recover investments; and there has been limited regulatory activity. The current framework was designed for an era when renewables were not even an option to be considered—existing rules were designed for diesel-based electricity supply. Much of these problems relate to broader power sector reform, beyond just renewables—but they create barriers to renewables too. Investments in diesel generation can be safely recovered, because there is a fuel surcharge. However, there is no corresponding tariff mechanism that allows recovering investments in capital intensive renewable energy projects. Rate reviews are also rare, and there are few rules on how the reviews should be carried out. As a result, outcomes of rate reviews are uncertain. Tariffs bundle all services together (energy, backup and standby capacity, and connection to the grid). The effect of this is that customers who self-generate with distributed renewables and remain connected to the grid would use services that are costly for the utility; however, these customers would end up not paying for those services, jeopardizing the utility’s financial viability. Over the long run, Anguilla’s regulatory framework and regulatory capacity to administer this framework should be strengthened. Given this situation, our recommendations to overcome regulatory distortions are as follows.

Now—Amend ANGLEC’s Public Supplier’s Licence and the Electricity Supply Regulations by adding (i) a definition of ‘Approved Renewable Energy Costs’; and (ii) a cost recovery principle. By inserting the Rules in ANGLEC’s licence and in the Electricity Supply Regulations, Anguilla’s regulatory framework would be complete with regard to *what* is needed to implement renewable energy in the country. What would still be missing would be *how* to ensure that what is prescribed in the Rules may actually happen. The best regulatory mechanism to ensure actual implementation of the Rules would be a strong incentive for renewable energy to actually become a profitable business for the public supplier.

This strong incentive should be provided by a ‘cost recovery principle’. This would be a statement that says that, as long as ANGLEC complies with the Rules, it may recover

through tariffs the costs of investing in renewable energy projects, and make a reasonable return on its investment. Appendix J contains this proposed cost recovery principle as an amendment to ANGLEC's Licence and the Electricity Supply Regulations.

The cost recovery principle would work as follows: investments done in accordance with the Rules (both for utility scale and for distributed scale renewables) would be defined as 'Approved Renewable Energy Costs'. In turn, 'Approved Renewable Energy Costs' would be automatically considered reasonable in a rate case, and therefore recoverable through tariffs. The effect of this apparently minor change would be major: it would provide a clear and strong incentive for investments in economically viable renewables to be made.

In addition to the incentive described above, various options may be considered to ensure ANGLEC's compliance with the Rules. ANGLEC could make compliance mandatory for its managers by amending its by-laws. Or, it could adopt a new 'Policy for Renewable Energy', where it commits to use its best endeavors to comply with the Rules. These two options are presented in Appendix K. However, even if ANGLEC were to adopt neither of these options, the incentive represented by the cost recovery principle would be sufficient to make Anguilla's regulatory framework for renewable energy complete, and compliant with best regulatory practices.

Later—Commission a Cost of Service Study (COSS). Anguilla should commission a COSS to improve the tariff structure, and identify other ways to reduce costs beyond renewable energy. Improving operating efficiency can reduce cost of service, particularly by procuring fuel at lower cost, or optimizing the dispatching of generating units in merit order (that is, order of efficiency in cost, starting from the most economical unit).

Later—Amend the Electricity (Rates and Charges) Regulations with a disaggregated tariff structure. An advantage of the Electricity (Rates and Charges) regulations is that they do not mandate which tariff components there should be in Anguilla. This means that other and different tariff components that encourage the development of renewable energy could be included, instead. A simple rate adjustment (which requires no legal or regulatory changes) could be done to implement a 'sustainable tariff structure'. A sustainable tariff structure would be disaggregated and cost-reflective, charging consumers separately for: (i) supply of energy, measured in kilowatt hours sold (energy charge); (ii) connection to the distribution system (connection charge); and (iii) provision of backup and standby generating capacity (capacity charge). Cost of fuel should be included fully in just one component (fuel surcharge), and not split between a base charge and the fuel surcharge. In addition, the fuel surcharge (in EC\$ per kilowatt hour) should be published monthly, for transparency. There could also be a separate 'Renewable Energy Recovery Clause' in the tariff structure, which allows for the recovery of all Approved Renewable Energy Costs together, in a more transparent way.

Later—Issue a revised Standard Offer Contract. Based on the experience of the pilot SOC, and once a COSS allows a general revision of the tariff structure of all customers, ANGLEC should issue a revised SOC. The revised SOC would follow the same principles as the pilot one, but fine-tuning it so that it is appropriate for a more widespread adoption.

Later—Determine the best option for a regulator to administer rules. Anguilla should choose among three options for a regulator to administer the rules of a reformed regulatory framework: (i) assign regulatory functions for the power sector to the Public Utilities Commission (PUC); (ii) maintain the current situation, and appoint an Electricity

Commissioner; or (iii) assign regulatory functions to the Eastern Caribbean Electricity Regulatory Authority (ECERA), once it is set up. The Government has expressed its preference for the first option: assigning regulatory functions for the power sector to the PUC. The PUC Act was drafted with this intent.

Finally, additional measures (other than those related to the legal and regulatory framework) would also help promote cost-effective renewables:

- For problems of limited financing and limited availability of equipment, we recommend ***using this report to secure low-cost financing and other financial resources for distributed solar systems***—both solar water heaters and solar PV. Loan guarantees, concessional loans, and grants for project preparation would be the main financial tools available
- To help solve limited institutional capabilities, we recommend ***strengthening the capabilities of the Electrical Inspector’s Office***, and ***securing funding for further studies and reforms***—such as a COSS, or broader power sector reform matters
- To help increase skills for renewables in the country, we recommend ***including an O&M component (even a short one) when procuring a specialized contractor***, and ***checking whether any rules related to electrical wiring and installation are appropriate*** for distributed renewable energy (for example, rules in any licence arrangements and in the Electrical Code that Anguilla follows)
- To help enhance information and awareness, we recommend:
 - ***further assessing the quantity and quality of wind and waste resources***
 - ***adopting external certifications for installers*** of solar water heaters, solar PV, and other renewable energy systems.

1 Introduction

The Government of Anguilla, with the support of the Climate and Development Knowledge Network (CDKN), asked Castalia to recommend how to improve Anguilla's legal and regulatory framework to enable integration of renewable energy.

Anguilla is a British Overseas Dependent Territory located in the Eastern Caribbean, with a population of about 15,000. The island is very small: 91 square kilometers. The terrain is relatively flat (it is a low lying coral and limestone island). The island is vulnerable to frequent hurricanes and tropical storms. Anguilla has very little portable water, and limited arable land. Its economy is primarily based on tourism, offshore banking, and the fishing industry, as well as some agriculture. In 2002, 23 percent of the population lived below the poverty line.¹ Anguilla is an associate member of the Organization of Eastern Caribbean States (OECS), and an associate member of the Caribbean Community (CARICOM).

This document represents our assignment's Final Report. It takes into account comments and suggestions made by the Government, CDKN, and all stakeholders throughout our entire assignment.

In this introduction, we summarize the scope of work of this assignment, which focuses on the legal and regulatory aspects of promoting renewables (section 1.1). Then, we present the institutional responsibilities in implementing renewable energy integration, as requested by the Government (section 1.2). Finally, we present the content of this report (section 1.3).

1.1 Scope of Work of this Assignment

Our assignment consists of recommending how to amend current electricity legislation and regulation of Anguilla for providing a clear framework to integrate both distributed scale and utility scale renewable energy into the national electricity grid. Our task is to do this while involving key stakeholders throughout our entire assignment; and enabling the sharing of Anguilla's experience with other Caribbean countries that are in a similar situation. Ultimately, our work should contribute to a legislative environment that promotes affordable and reliable electricity supply from renewable sources for all Anguillans, particularly the poor.

Our scope of work includes the following activities:

- **Assess Anguilla's renewable energy potential.** Gather information on the legal and regulatory framework for renewable energy, and on Anguilla's renewable energy potential. Assess Anguilla's renewable energy potential to understand what renewable energy options are viable in the country (from a technical, economic, and financial standpoint), and which ones that could be viable are not being implemented
- **Identify barriers to viable renewable energy potential.** Identify key legal and regulatory barriers that prevent the deployment of viable renewable energy technologies, differentiating utility and distributed scale projects

¹ Central Intelligence Agency. The World Factbook: Anguilla". <https://www.cia.gov/library/publications/the-world-factbook/geos/av.html> (accessed May 31, 2012).

- **Recommend improvements to the legal and regulatory framework.** Develop detailed recommendations that can be easily translated into legislative and regulatory reform for renewable energy integration in Anguilla.

Several related matters are outside our scope of work, in particular:

- Renewable energy matters that are not legal or regulatory—for example, financial barriers, and specific social policies for poverty reduction
- Broader power sector reform matters (beyond what is needed for renewable energy). For example, Anguilla would need to improve the overall way its electricity tariffs are set; and to identify ways other than renewables to improve the efficiency of its power sector. These matters would require, at least, a cost of service study (COSS) and a tariff study, which are not included among our tasks
- Technical matters regarding renewables, such as carrying out technical feasibility studies of specific projects; determining how much renewable capacity can and should be implemented, and when; defining what price should be paid to renewables; or stating which technical rules grid-integrated renewables should comply with. These matters would require detailed feasibility studies, an optimized least cost generation expansion plan, and development of grid code rules, which are not included among our tasks.

To the extent possible, we consider these related matters in this report for providing a more complete picture of opportunities for, and barriers to renewable energy integration. We also consider these related matters to some extent for providing guidance to the Government on the subsequent steps for renewable energy integration.

1.2 Institutional Responsibilities for Renewable Energy Integration

The Government of Anguilla is committed to renewable energy integration to reduce costs as top priority, while also increasing energy security and environmental sustainability. The Government, ANGLEC, and other stakeholders can take a number of steps to achieve these objectives over the short to medium term.

As a first step, the Government intends to complete the legal and regulatory framework for renewable energy. Secondly, the Government intends to work with ANGLEC to ensure the successful implementation of viable utility scale and distributed scale renewable energy projects. Finally, the Government intends to work with ANGLEC and other stakeholders to address the remaining barriers related to financing, institutional capacity, and limited information.

This report includes a Roadmap for Renewable Energy Integration (see section 8). The Roadmap lays out the additional work that is required to advance renewable energy integration in Anguilla; the entity responsible for each task; and a proposed timeline for implementation from 2012 to 2015.

The Ministry of Infrastructure, Communications, Utilities and Housing (MICUH) has the ultimate responsibility for ensuring that all tasks in the Roadmap are completed. MICUH is

also responsible for ensuring that if anything has been omitted from this report that is material and of importance to the success of the project, it is carried out.

1.3 Content of this Report

The remainder of this report is structured as follows:

- First, we explain that the country's priority objective for integrating renewable energy is to reduce electricity costs over the long term. Increasing energy security, and enhancing local and global environmental sustainability are two other objectives. We discuss these objectives (which are based on indications by the Government and stakeholders we met in Anguilla) in section 2
- The following step in our work is to provide a brief overview of Anguilla's power sector. Anguilla is a small isolated electricity system. Power is provided by a vertically integrated utility using imported diesel. Electricity costs and tariffs are among the highest in the region. We briefly discuss electricity sector entities, electricity supply and demand, and electricity tariffs in section 3
- Anguilla's policy, legal, and regulatory framework for electricity completes the analysis of the local setting. In section 4 we provide a concise analysis of the Government's energy and climate change policies. We also analyze Anguilla's electricity sector legislation and regulations that are relevant to renewable energy integration
- Having analyzed the context within which renewables may be developed in Anguilla, the following task is to assess the country's renewable energy potential. In section 5, we screen renewable energy technologies to determine resource availability, the existence of commercially proven technologies, and economic and commercial viability. Solar and wind energy are Anguilla's clearest options. Waste-based energy might be an option in the longer term, provided that there be a sufficient quantity of waste, and with a composition that is appropriate for energy generation
- Once the viable options are identified, the question to ask is, why are they not happening? In section 6 we analyze barriers related to the legal and regulatory framework, and briefly describe other barriers related to institutional capabilities, technical skills, availability of financing, information and awareness, and availability of competitively priced equipment
- To overcome legal and regulatory barriers, Anguilla should pursue a phased approach. In the immediate term, Anguilla can pursue large and small renewables with relatively limited changes in the legal and regulatory framework. In the medium term, Anguilla can engage in a broader strategy that may involve reforms that go beyond just renewables. We explain this in section 7
- Section 8, as mentioned above, contains the Roadmap.

Thirteen appendices complete this report. Appendices A to I respond to requests by clients and stakeholders to make this report more concise and user-friendly, separating most background information from the main body of the report:

- Appendix A provides an institutional outline of Anguilla's power sector
- Appendix B analyzes in detail electricity demand and supply in Anguilla
- Appendix C describes Anguilla's electricity tariffs
- Appendix D analyzes Anguilla's National Energy Policy and draft Climate Change Policy
- Appendix E contains a detailed analysis of Anguilla's laws and regulations relevant to renewable energy integration
- Appendix F shows how we estimate conventional electricity generation costs and tariffs for assessing the viability of renewable energy in Anguilla
- Appendix G describes in greater detail Anguilla's viable renewable energy options
- Appendix H explains how the long run marginal cost (LRMC) of generation of renewable energy technologies is calculated (US\$ per kilowatt hour generated)
- Appendix I explains how the marginal cost of carbon abatement (US\$ per ton of carbon dioxide equivalent abated, tCO₂e) is calculated for renewable energy technologies.

Appendices J, K, and L contain our recommended legal and regulatory changes:

- Appendix J provides language to amend ANGLEC's Licence and the Electricity Supply Regulations by adding Rules for Renewable Energy, and a cost recovery principle for approved renewable energy costs
- Appendix K provides language for optional changes to ANGLEC's by-laws to ensure that ANGLEC follows the Rules for Renewable Energy; or for a new policy that ANGLEC may issue on how it intends to pursue renewable energy development
- Appendix L contains our recommended amendments to the Electricity Act.

Appendix M includes the Government's terms of reference for renewable energy integration in Anguilla.

2 Objectives of Integrating Renewable Energy in Anguilla

Our assignment is to recommend legal and regulatory ways to integrate renewables in Anguilla—but why should Anguilla integrate renewables in the first place?

There are three reasons that make renewables important for a small island developing state like Anguilla, and which represent the three objectives that justify our assignment:

1. **To reduce electricity costs over the long term.** Anguilla's electricity costs (and as a consequence its electricity tariffs) are among the highest in the region. They are so high that they have led to an unsustainable situation, commonly described as a crisis. Some residential customers have been disconnected because they are unable to pay bills (although many have been reconnected under a new arrangement²). According to discussions with stakeholders, some businesses have closed due to (among other factors) high electricity costs. Anguilla fully relies on expensive imported diesel for power generation. It is a small, remote country with limited demand, which means relatively small and inefficient generating units, inability to switch to cheaper fossil fuels, and even higher costs of fuel procurement. As we show in section 5, there are some renewable energy options in Anguilla that can generate electricity at less than the fuel-only cost of diesel plants. This may mean some immediate savings on customers' bills, and good potential to save (or at least to stabilize) costs and prices of electricity over the long term³
2. **To increase energy security.** As a small, remote country with no fossil fuel resources, Anguilla is particularly sensitive to energy security problems. Energy security “has two key dimensions—reliability and resilience. Reliability means users are able to access the energy services they require, when they require them. Resilience is the ability of the system to cope with shocks and change.”⁴ Energy security does not mean energy independence. A country can achieve total energy security even with no local primary energy resources. Renewables contribute to

² ANGLEC estimates that 400 to 500 people have been disconnected (Castalia meeting with ANGLEC management, 17 February 2012). Some of these customers are vacant rental properties (villas and apartments) that were built during the construction boom, but are empty now because of the global recession. However, this number also includes many customers who cannot afford to pay their electricity bills (customers are disconnected 45 days after the billing date if they do not pay their electricity bill). ANGLEC has a flexible payment plan, based on the individual circumstances of the consumer, and a deferral process if the consumer needs an extra week to pay (it is required to sign an agreement to pay ANGLEC). During Christmas 2011, ANGLEC also instituted a \$1 reconnection plan, reconnecting customers who paid at least \$1 towards their bill. However, only 30 consumers took advantage of this reconnection plan.

³ Of course, actual savings depend on future oil costs, and the costs of renewable energy systems. For example, solar PV generation at the utility scale at current prices could cost US\$0.22/kWh, which is less than the utility's variable cost of electricity generation. Not assuming any changes in the prices of solar PV, this technology would need oil prices of at least US\$3.5 per gallon to cost less than diesel generation.

⁴ New Zealand Ministry of Economic Development, *Glossary*, Definition for Energy Security. http://www.med.govt.nz/templates/MultipageDocumentPage_____32084.aspx.

greater energy security because they represent primary energy resources that are locally available, and reduce the need to import diesel. There are also other ways to achieve energy security (outside the scope of this assignment), such as forward contracts for fuel procurement

3. **To enhance environmental sustainability.** Anguilla is a small island country with a delicate natural environment (which is the key resource for its tourism-based economy). As such, it is particularly vulnerable to local pollution from fossil fuel-based generation and risks of oil spills. Anguilla is also exposed to possible effects of global climate change, such as sea level rise and increased frequency or severity of climate events. The two dimensions of Anguilla’s environmental vulnerability—local pollution, and global climate change—are different with respect to costs and benefits of mitigation. Anguilla can capture all the value of any additional cost it incurs to mitigate local pollution. On the other hand, it could capture virtually no value of any additional cost incurred to abate greenhouse gases (GHG). This is due to the fact that climate change is a global phenomenon, created by far larger emitters than Anguilla.

Reducing electricity costs over the long term: priority objective

Reducing electricity costs is the Government’s priority objective for integrating renewable energy in Anguilla. This is consistent with one of the primary goals of the National Energy Policy: “Ensure universal access to an affordable electricity supply for all Anguillans”.

Reducing electricity costs is also the priority objective for the overwhelming majority of other public and private actors met during our visits to Anguilla.

Anguilla should aim towards lower electricity costs over the long term. This means that Anguilla should promote renewable technologies that are likely to achieve a reduction in costs that is sustainable over time. That said, some renewable energy options that are likely to achieve a sustainable reduction in energy costs can also provide immediate savings.

Increasing energy security and enhancing environmental sustainability: objectives to pursue as long as costs decrease

Increasing energy security and enhancing environmental sustainability are also objectives that the Government intends to pursue through renewable energy integration, recognizing their importance for Anguilla—as long as they may be pursued while also decreasing electricity costs. Pursuing energy security and environmental sustainability with renewable energy technologies that are not economically viable (a renewable energy technology is ‘economically viable’ if it reduces the overall cost of generating electricity in the country by costing less than diesel-powered generation) means a tradeoff with the objective of reducing electricity costs.

In Anguilla’s case, however, there is no tradeoff in practice, because renewables can be a win-win option for the country in any case. As we discuss in section 5, the renewable energy resources that are available in Anguilla—solar energy, wind energy, and perhaps (assuming enough waste with an adequate composition) waste—can all be exploited with technologies that are economically viable in the country. This is an ideal situation, because it means that Anguilla can achieve all three objectives at one time when pursuing its renewable energy

potential. Anguilla can reduce emissions in the local environment, contribute to mitigating the emission of global greenhouse gases (a symbolic but nonetheless significant contribution), and reduce dependence on imported oil—while also saving on electricity costs and prices.


3 Overview of Anguilla’s Power Sector

This section provides an overview of key entities in Anguilla’s power sector, electricity demand and supply, and electricity tariffs. Appendices A, B, and C complement this section with detailed analyses of these topics.

3.1 Key Entities in Anguilla’s Power Sector

Anguilla is a small isolated electricity system, with power provided by one operator, the Anguilla Electricity Company Limited (ANGLEC). ANGLEC is a vertically integrated utility, owned in its majority by the Government. The Government and Government Social Security have a majority shareholding (a combined 56 percent of ANGLEC’s shares). The remaining 44 percent is held by the National Bank of Anguilla, the Caribbean Commercial Banks, other local companies, and the general public.

Figure 3.1: Ownership of Anguilla Electricity Company Limited (ANGLEC)

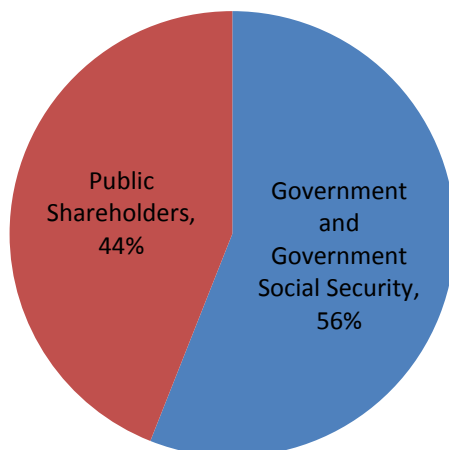

The Governor, Executive Council (EXCO), and the Ministry of Infrastructure, Communications, Utilities, and Housing (MICUH) are the key Government actors that set energy policy, issue licences, and regulate the power sector. The Government is both the policy maker and the regulator of the energy sector. Therefore, the terms ‘Government’ and ‘Regulator’ may be used interchangeably in this report when referring to the current situation.

The Ministry of Home Affairs is responsible for reviewing and approving applications for new energy projects, and for issuing permits.


The Anguilla National Energy Committee (ANEC), and the Anguilla Renewable Energy Office (AREO) are the two non-profit organizations that complete the country’s institutional picture for the power sector.

Appendix A provides a complete outline of institutions involved in Anguilla’s power sector.

3.2 Electricity Demand and Supply

Electricity demand has grown consistently since 2003, as shown in Figure 3.2. However, it may slow down in the future due to increased fuel prices and the economic recession. Peak demand reached 15.3MW in December 2010, having increased by about 7 percent per year since 2001. ANGLEC’s most recent load forecast expects peak demand to reach almost 20MW by the end of 2015 (average growth rate of 5 percent). However, the company is considering revising this estimate downwards due to the current economic downturn. ANGLEC does not currently have a demand forecast for the period after 2015.

Figure 3.2: ANGLEC Peak Demand (2006-2010) and Projected Peak Demand to 2015

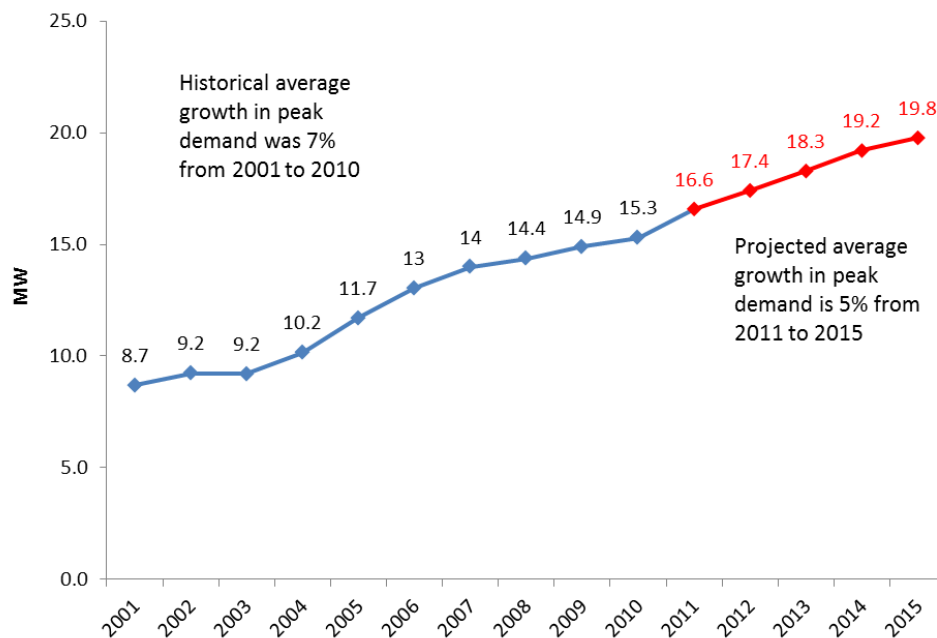

Source: Based on ANGLEC’s Annual Reports for 2010, 2006, and 2005

ANGLEC’s current generation mix consists of high and medium speed diesel generators which, combined with high prices of imported diesel, mean high generation costs. At US\$0.25 per kilowatt hour in 2010, ANGLEC’s generation operating costs (the sum of all fuel and generation-related operating expenditures, divided by gross generation) are higher than those in Barbados, Grenada, Dominica, the Cayman Islands, or Saint Lucia. ANGLEC’s fuel efficiency is relatively good compared to its peers in the region. System losses, however, are relatively high.

Appendix B provides a more detailed analysis of Anguilla’s electricity demand and supply.

ANGLEC’s Renewable Energy Outlook

ANGLEC management is open to including renewable generation in its plant mix. In addition, the Government (ANGLEC’s majority stakeholder) is eager to use renewable

energy generation to reduce electricity costs in the country over the long term.⁵ ANGLEC has drafted a request for proposals (RFP) for the construction and delivery (design and build) of solar PV plant.⁶ The RFP, which has not been issued and is confidential, establishes that bidders should propose:

- An installed capacity of 1.5-2MW
- A commercially proven and available technology resilient to hurricanes
- Firm and binding prices
- A site for the development in the Corito area under ANGLEC control (or an explanation of how a bidder would deliver electricity from a site outside this area). This site would make the development of the plant easier given its proximity to ANGLEC's other plant and the grid.

ANGLEC management has also expressed interest in having the option to purchase renewable power from independent power producers (IPPs). This option would allow third parties, instead of ANGLEC, to finance new plants. However, it would also require creating a new type of licence, because no IPP licence is currently contemplated in Anguilla's regulatory framework. As we discuss in section 4.2, however, IPPs may operate in Anguilla and sell power to ANGLEC with no need to create a new type of licence. They could simply operate under ANGLEC's own licence to design, build, operate, and maintain renewable energy plants.

As explained in section 5.2.2, viable renewable technologies with the most potential in Anguilla (solar PV and wind) can provide lower-cost power than diesel generation. However, they do not provide firm power for base load (that is, power that can be ensured at any time to meet demand that is present all the time). Therefore, conventional generation capacity will still be required in Anguilla for the foreseeable future.⁷

3.3 Electricity Tariffs

Tariff categories in Anguilla are based on monthly consumption levels, not on customer type. The first category is for customers consuming up to 40 kilowatt hours per month; the second for those consuming up to 2,500 kilowatt hours per month; the third for those consuming up to 100,000 kilowatt hours per month; and the fourth for those consuming over 100,000 kilowatt hours per month.

Tariffs charged by ANGLEC to its customers comprise a base rate per kilowatt hour, which includes a fixed portion of fuel costs; a fuel surcharge per kilowatt hour, which depends on the cost per gallon of fuel oil; and an environmental levy, which is used to fund waste collection on the island.

Tariffs bundle all services together: (i) energy, (ii) backup and standby capacity, and (iii) connection to the grid. The implication of this tariff design is that customers who generate energy for themselves with distributed renewable systems and remain connected to the grid

⁵ Information provided by stakeholders in the Government and ANGLEC, January, 14-21, 2012.

⁶ ANGLEC. "Request for Proposal: Photovoltaic Generating Plan." January, 2012.

⁷ Anguilla Renewable Energy. "The Anguilla Model: An 8 Year Plan for Achieving a Carbon Neutral Economy as a Replicable Model for Small Island Nations Worldwide." 2009.

use less or none of the energy service (i), depending on how much energy their system generates compared to how much energy they consume. On the other hand, they continue using backup and standby services (ii), as well as the grid interconnection service (iii). However, the only way to pay for all of those services is through the rate for the service that they use less or not at all (energy).

Therefore, the effect of the current tariff design when combined with distributed generation is the following: grid-connected customers that generate for themselves with a renewable system end up not paying (in full, or in part) for services that are costly for ANGLEC—building and maintaining power plants and a grid. This effect, especially when more and more customers self-generate with distributed renewables, may jeopardize the utility's financial viability.

Appendix C describes ANGLEC's tariff components and categories in detail.

4 Anguilla’s Policy, Legal, and Regulatory Framework for Electricity

In this section we summarize our analysis of Anguilla’s policy, legal, and regulatory framework for electricity, focusing on the aspects that are relevant for enabling renewable energy integration. Appendices D and E provide our full analysis of these topics.

4.1 Relevant Policy

Anguilla’s policy documents relevant to electricity regulation are:

- The **National Energy Policy**. This document aims at providing a reliable and good-quality supply of electricity to all sectors of society at an equitable price. The National Energy Policy includes as an objective that of using renewable resources to the greatest extent possible to meet existing and future demand for power generation
- The **Draft Climate Change Policy**. This document aims to manage the impacts of, and risks from climate change while transforming Anguilla into a climate resilient, energy efficient, and low carbon economy.

The only aspect in these two documents that is not consistent with the Government’s objectives and priorities for renewable energy as stated in section 1 (to reduce electricity costs as a priority, while increasing energy security and enhancing environmental sustainability) is the Draft Climate Change Policy’s goal to ‘achieve energy independence’ (goal number 8). We would recommend that goal number 8 be rephrased as ‘achieve *greater* energy independence’ or ‘pursue energy security’.

Appendix D analyzes in greater detail these two documents.

4.2 Relevant Legal and Regulatory Framework

The key aspects of Anguilla’s legal and regulatory framework from the perspective of renewable energy integration are as follows:

- **Licensing**—there is no need for a licence to generate electricity with wind and solar photovoltaic technologies, if it is for one’s own consumption. A licence to supply electricity on a commercial basis to a licenced public supplier is not contemplated under the law. The law contemplates only two types of licences: a private supplier’s licence, and a public supplier’s licence. Only one licence has been issued in Anguilla: ANGLEC’s public supplier’s licence. Importantly, ANGLEC’s licence includes assignment rights thanks to which the utility may (with the Governor’s approval) transfer or assign all or part of its licence to another party. Another party could be, for example, an IPP that could sell all of its generation to ANGLEC under a power purchase agreement (PPA), operating under ANGLEC’s licence. However, an IPP would not be allowed to sell the electricity it generates directly to a private off-taker, since ANGLEC has an exclusive right to supply electricity in Anguilla
- **Corporate instruments**—ANGLEC’s by-laws empower the directors to manage the business and affairs of the company. The by-laws also

empower directors to impose on the officers any terms and conditions, or any restrictions that they think fit in respect of the powers delegated to management. Directors may also make, amend, or repeal by-laws for the regulation of the business and affairs of the company. Importantly, this means that (in addition to the terms and conditions in the Act, Regulations, and licence) ANGLEC is subject to any internal rules. For example, these could include rules on how to assess and implement renewable energy (as we discuss in section 7.1.1)

- **Service standards**—ANGLEC’s duty is to provide a regular, sufficient, and continuous supply of electricity. However, laws, regulations, and ANGLEC’s licence do not control how this overall duty must be met. There are no indications or restrictions as to which plant may be used, and no obligation for ANGLEC’s generation expansion plans to be approved. All ANGLEC must show to recover its costs through tariffs is that its costs are reasonable
- **Rate adjustment procedure**—it is for ANGLEC to initiate the procedure to request a rate adjustment. The relevant Minister and an Arbitrator decide whether (and to what extent) to approve a rate adjustment. In deciding, they must ensure that rates allow ANGLEC to meet all costs and expenses that are reasonably incurred, and provide an annual return on shareholder equity of at least 12 percent per year. The Electricity Act and ANGLEC’s licence only list two types of information that may be requested from ANGLEC as part of the rate adjustment procedure: most recent audited accounts; and an estimate for the 5 following financial years. However, Anguilla’s laws allow for any other information also to be requested
- **Land rights**—Anguilla’s legal and regulatory framework is complete with respect to the rights for acquiring land, including the right to access it over the land of others; obtaining the right to develop land; and obtaining rights over the land of others to place poles and other apparatus.

Appendix E contains our full analysis of Anguilla’s laws and regulations relevant to renewable energy integration.

5 Anguilla's Renewable Energy Potential

Several renewable energy technologies may be economically and commercially viable in Anguilla. The country has abundant solar resources available, as well as good wind resources; and there are commercially proven technologies that can be used to tap into this potential. Solar photovoltaic (PV) technologies at the utility and distributed scale, solar water heating, and utility scale wind are all economically viable technologies that can be exploited—immediately in the case of solar; with further study and time in the case of wind. Anguilla could also look at waste-based energy technologies in the future, but it would certainly need more waste volume to pursue this option.

In spite of several options being potentially viable, very few renewable energy options are currently implemented in the country. Furthermore, diesel generation will be needed even if Anguilla realizes its entire renewable energy potential (at least under current technology conditions). As noted above, this is because most of Anguilla's renewable energy potential is represented by sources (wind and solar) that cannot provide firm power for base load—that is, power that may be made available at any time ('firm') for meeting demand that is present all the time ('base load'). Finally, Anguilla should not expect an unrealistically high impact from renewable energy integration in the near term. This is because its most immediate and clear opportunity for viable renewables (solar PV) does not cost much less than conventional generation under current and expected oil prices.

In the remainder of this section, we review the current uptake of renewable energy in Anguilla (section 5.1). Then, we screen which technologies should be assessed (based on maturity of a technology, and availability of the primary energy resource); and analyze the potential for and economic viability of renewable energy technologies for Anguilla (section 5.2). Finally, we look at the cost of greenhouse gas abatement of renewables (section 5.3).

As a reminder, the purpose of this section is to guide our recommendations for legal and regulatory reform, which is the focus of our assignment. Our assessment of how renewable energy options compare to conventional generation is necessarily a simplified one—or just a first broad step of an assessment, done for policy purposes. A detailed feasibility analysis would be required for any specific project. Also, the viability of renewables critically depends on the assumption made for the cost of diesel. Finally, developing a least-cost plan for electricity generation in Anguilla, or assessing and recommending how much renewable energy should be implemented in the country, are technical matters outside the scope of this assignment.

In spite of simplifications, the results of our assessment are broadly valid. Assumptions are based on information collected in Anguilla and vetted with local stakeholders wherever possible. Assumptions appear reasonable and conservative when compared to information collected in other small island countries of the Caribbean and other regions.

All assumptions and sources of information used for this analysis are shown in:

- Appendix F (conventional generation costs and tariff levels assuming that diesel fuel costs US\$4 per gallon)
- Appendix G (costs and performance of renewable energy technologies).

5.1 Current Uptake of Renewable Energy

There is very little uptake of renewable energy in Anguilla. The rare exceptions are small distributed scale solar and wind systems at customer premises, which are not connected to the grid. Below we discuss the uptake of utility scale technologies in more detail, then that of distributed scale technologies.

5.1.1 No uptake of utility scale technologies

There is no utility scale renewable electricity generated in Anguilla. ‘Utility scale’ technologies are those that need to be installed at a dedicated site, and supply power over the transmission and distribution grid.

As noted above (see section 3.2), ANGLEC has prepared a draft Request for Proposals for a utility scale solar PV installation.⁸ Additionally, the government has published a redevelopment plan for Corito Bay that includes a utility scale wind installation, and a potential waste-based plant.⁹

5.1.2 Limited uptake of distributed generation technologies

Distributed renewable generation is almost non-existent in Anguilla. ‘Distributed’ generation technologies¹⁰ are small-scale technologies that are located in close proximity to the load being served. These technologies are called distributed because they are spread across the distribution network, at or close to customer premises.

There are a few distributed generation systems in Anguilla:

- **Solar water heaters**—equipment retailers and installers¹¹ report installing several solar water heaters. However, no precise data are available on residential and non-residential penetration. Uptake is limited compared to other Caribbean countries. This is mostly due to limited awareness, limited availability of competitively priced equipment, and also for reported problems in the past. (Some systems installed before Hurricane Luis came off during the hurricane. Other systems were not properly installed, and malfunctioned)
- **Solar PV**—a few residential and commercial customers have installed small solar PV systems for self-generation (on an apartment building, private health clinic, Princess Alexandra Hospital, and at the airport)¹²
- **Small wind**—one residential customer at an apartment building installed a small wind turbine (500W) for self-generation.

⁸ ANGLEC. “Request for Proposal: Photovoltaic Generating Plan.” January, 2012.

⁹ Anguilla National Energy Committee. “Corito ‘Zero Energy’ Development Zone.” 2009.

¹⁰ There is no single, commonly accepted definition of ‘distributed generation’. Two useful definitions are: (1) “Any electricity generation facility that produces electricity for use at the point of location, or supplies electricity to other consumers through a local lines distribution network” (New Zealand’s Ministry of Economic Development); and (2) “Small, modular, decentralized, grid-connected or off-grid energy systems located in or near the place where energy is used” (United States Environmental Protection Agency).

¹¹ Meeting with Renewable Energy Equipment Retailers and Installers, Anguilla, 21 February 2012.

¹² Conversations with the Government, AREO, ANGLEC, and stakeholders, Anguilla, 13 February 2012 to 22 February 2012.

5.2 Economic and Commercial Viability of Renewable Energy

Below we assess Anguilla’s renewable energy potential. First, we screen which technologies should be considered based on maturity and availability of the primary energy resource (section 5.2.1). Then, we analyze the economic and commercial viability of technologies (section 5.2.2). Finally, we summarize our conclusions about the country’s renewable energy potential (section 5.2.3).

5.2.1 Screening of renewable energy technologies

To determine if a technology is appropriate for Anguilla, we screen individual technologies based on two criteria:

1. **Maturity of technology**—this means that a renewable energy technology is in commercial operation somewhere in the world
2. **Availability of primary energy resource**—this means that there is sufficient quantity and appropriate quality of the primary energy resource used by a renewable energy technology to develop the technology commercially. Given Anguilla’s limited land mass, we bundle availability of land in this criterion.

The table below illustrates the results of the screening. As shown in the table, we screen out: Concentrated Solar Power (CSP), Seawater Air Conditioning, Hydropower, Geothermal Energy, Biomass Cogeneration, Biodiesel-based Power Generation, Ocean Thermal Energy Conversion (OTEC), and Ocean Wave Energy Conversion.

Table 5.1: Screening Renewable Energy Technologies to be Assessed in Anguilla

RE Technology	Maturity (0-2)	Availability of primary resource (0-2)	Comments	Screening result (in/out)
Solar PV	1	2	Mature technology, although further improvements expected. Excellent solar potential. Limited land availability	In
Solar Water Heaters	2	2	Mature technology. Excellent solar potential	In
Wind	2	1	Mature technology. Good wind potential, limited land availability	In
Waste-Based Energy	2	1 (medium-long term)	Several mature technologies available (landfill gas to energy, waste to energy). Very limited waste stream, not properly treated, and with unclear composition, may be sufficient only for a small project (if any)	In
Concentrated Solar Power (CSP)	1	1	In commercial operation, but significant improvements and cost reductions expected. Optimal plant size may exceed needs and land availability of Anguilla. Excellent solar potential	Out
Seawater Air Conditioning (SWAC)	1	0	Technology based on other commercially proven ones, but further improvement expected. Likely no availability of deep cool water (shallow water around Anguilla)	Out
Hydropower	2	0	Mature technology. No hydro resources.	Out

RE Technology	Maturity (0-2)	Availability of primary resource (0-2)	Comments	Screening result (in/out)
Geothermal	2	0	Mature technology. No geothermal resources in Anguilla (conventional geothermal fluids or hot dry rock)	Out
Biomass Cogeneration	2	0	Mature technology. No sufficient biomass available (or sufficient land to grow it)	Out
Biodiesel for Power Generation	2	0	Mature technology. No sufficient biodiesel feedstock available (or sufficient land to grow it)	Out
Ocean Thermal Energy Conversion (OTEC)	0	0	Technology at an experimental/pilot stage. Likely no availability of sufficient thermal gradient (shallow water around Anguilla)	Out
Ocean Wave Energy Conversion	0	1	Technology at an experimental/pilot stage. Possible availability of good ocean kinetic energy, but not ascertained	Out

Maturity: 0 = experimental/pilot stage; 1 = commercial stage, but further development expected; 2 = mature stage, no significant further development expected.

Availability of primary resource: 0 = low, 1 = medium, 2 = high.

We estimate the availability of resources based on different sources for each technology:

- Solar energy (including PV, CSP and, SWH)—there is no existing solar irradiation map for Anguilla, but one for the Bahamas may be used given the similar geographic location and weather patterns of the two areas¹³
- Wind energy—a preliminary study by Mistaya Engineering shows very good availability of the resource, with estimated capacity factors up to 44 percent¹⁴
- Waste—data provided by the Anguilla Statistics Unit about waste tonnage received at the Corito landfill shows a very limited waste stream¹⁵
- Ocean technologies—a nautical map shows relatively shallow water around Anguilla¹⁶
- Biomass and biodiesel—Anguilla’s limited agricultural activity and irrigation potential.¹⁷

¹³ Fichtner, Direct normal solar irradiation on The Bahamas, based on National Renewable Energy Laboratory (NREL), 2010.

¹⁴ Lambert, Tony. “Anguilla Wind Data Analysis.” Mistaya Engineering Inc., 2008.

¹⁵ Anguilla Statistics Unit. “Environmental & Climate.” Accessed 4/10/2012 at: http://www.gov.ai/statistics/ENVIR_CLIMATE_TAB_10.htm.

¹⁶ Mappery, accessed April 19, 2012 at <http://mappery.com/map-of/Anguilla-St-Martin-St-Barthelemy-Nautical-Map>.

¹⁷ Anguilla has virtually no arable land. Its GDP composition by sector is as follows: agriculture (2%), industry (26%), and services (72%). See Central Intelligence Agency. The World Factbook: Anguilla”.

Anguilla should not exclude the possibility that technologies screened out for not being mature (such as wave energy, or OTEC) may become viable in the future. However, Anguilla should not focus on these technologies until they become commercially viable—especially because there are commercially viable options that are currently unrealized. Also, it is possible that other technologies not considered in our screening may be viable. Furthermore, the plant size (installed capacity, expressed in megawatts) that allows certain costs that make a technology viable may exceed the size suitable for Anguilla—this is likely to be the case for CSP.

On the other hand, even if a technology is screened in, this does not necessarily mean it can be immediately viable in Anguilla. For example, two waste-based technologies may be viable in theory; however, in practice just one may be developed because they both compete for the same primary energy resource, which is limited. This is typically the case for waste-based technologies in small island countries.

Finally, firm renewable energy plants are sometimes not developed in spite of being technically and economically viable, because there is no need for additional firm capacity to meet demand. However, the key options viable in Anguilla (solar and wind) are non-firm. Therefore, they can always be developed to save some fuel, with no risks of turning existing plants into stranded assets. ('Stranded assets' are those that become obsolete before they are fully depreciated).

5.2.2 Analysis of renewable energy technologies


Figure 5-1 shows our assessment of the economic and commercial viability of potential technologies for renewable generation in Anguilla. The figure shows the Long Run Marginal Cost (LRMC, or all-in cost) of generation (US\$ per kilowatt hour) for a range of renewable energy technologies. LRMCs of renewable energy technologies (illustrated as bars in the figure) are compared with the estimated average system variable cost and all-in cost of conventional diesel-fired generation, as well as with ANGLEC's estimated retail tariffs for different tariff categories (illustrated as vertical lines in the figure).

A renewable technology is **economically viable** if it reduces the overall cost of generating electricity in Anguilla. This happens when a technology's generation cost is less than that of diesel-fired generation, allowing cost savings to be passed on to customers through lower tariffs. A renewable technology is **commercially viable** if a developer can make or save money by using it. This happens when a company develops a plant that generates at a competitive price compared to other available options; or when a customer develops a system that generates electricity at a lower cost than the tariff (which is the retail price a customer can buy electricity at). So, by comparing the cost of renewable generation with the correct benchmark, one can assess whether a technology is economically viable, commercially viable, or both.

Small wind and solar PV with batteries are economically unviable (they cost more than diesel generation) but commercially viable (they cost less than the tariff). This is due to differences between cost and retail price of an unbundled tariff—a technology can fall in between.

<https://www.cia.gov/library/publications/the-world-factbook/geos/av.html> (accessed May 28, 2012). Agriculture employment was 344 in 2002 (out of 5,496 total employed)—see Anguilla Statistics Unit. Press Release “Unemployment Rises”, July 2002. http://www.gov.ai/statistics/images/Unemployment_Rises.pdf (accessed May 28, 2012)

Figure 5-1: Viability of Renewable Energy Technologies in Anguilla

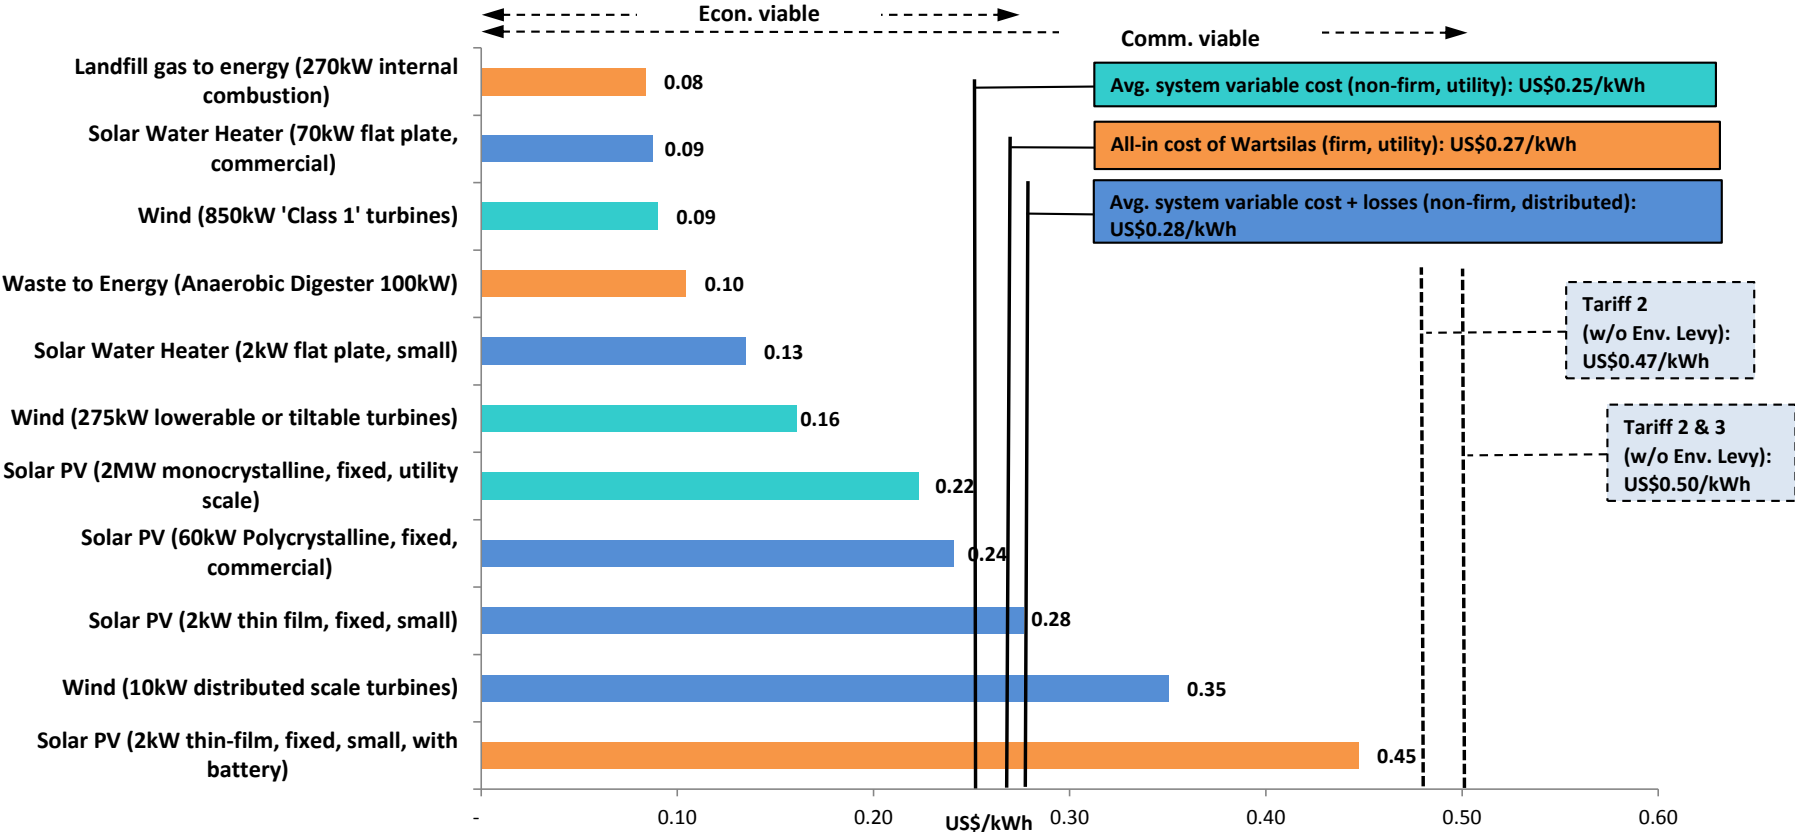

Explanation: This figure analyzes the cost to generate 1 kilowatt hour of electricity (US\$/kWh), comparing renewable options (horizontal bars) and conventional options (vertical lines) based on a diesel price assumption of US\$4 per Imperial Gallon (IG). Estimated tariffs (dotted vertical lines) allow comparing the cost of generating electricity with small renewables with that of buying it from the grid, based on the same diesel price assumption of US\$4 per IG.

Note: Conventional generation costs and tariffs shown are not historical values (for example, ANGLEC’s highest tariff as of May 2012 is US\$0.43 per kWh), but estimates for analytical purposes, based on an assumption of diesel prices at US\$4.00 per IG. In particular, tariffs shown are estimated based on the fuel surcharge that could be applied if diesel cost US\$4 per IG, using tariff categories most common (2 and 3, see E.3.1); ANGLEC reports that it does not always charge the full fuel surcharge that could be applied, and charges a lower fuel surcharge instead. Indicative Long Run Marginal Costs (LRMCs) of renewable energy technologies are based on assumptions about their cost and performance explained in Appendix G, and using a 11% discount rate for utility scale technologies, and 9% for distributed scale technologies, as explained in Appendix H. Landfill gas to energy and waste to energy estimates are subject to there being enough waste. The average system variable cost benchmark for distributed generation is grossed up for system losses (12%).

As explained in Appendix F, we estimate generation costs (and retail tariffs) calculated on the basis of a cost of diesel No. 2 fuel of US\$4.00 per gallon (including taxes). We need to use some estimate of future oil prices, and the market is the best source for finding one. US\$4.00 is a reasonable estimate because it corresponds to oil prices of about US\$100 per barrel, which is the price that medium term oil futures contracts (3-4 years) are trading at.¹⁸

Oil prices, of course, vary—and with them the viability of renewable energy technologies. Table 5.2 shows breakeven prices of oil at which the various technologies are viable. Breakeven prices shown in the table suggest that most technologies viable at US\$4 per gallon oil would still be viable also at lower oil prices (US\$1-2.4 per gallon). The exception is solar PV, which would need oil prices between US\$3.5 and US\$3.9 per gallon. In this sense, solar PV is a ‘marginally viable’ technology.

Figure 5-1 shows an indicative assessment of the LRMCS for all of the renewable energy technologies that pass the screening. The LRMCS are based on estimated values of capital costs; operating and maintenance (O&M) costs; capacity factor (the amount of energy actually generated over a period of time, usually a year, expressed as a percentage of the amount of energy that could be generated over that same period if a plant were always operating at full capacity); and lifetime of the various technologies.

The assumptions we use for each technology are contained in Appendix G. We use data gathered in Anguilla where available. In other cases, we use data from similar small island countries we have recently worked in (Turks and Caicos Islands, Barbados, Trinidad and Tobago, the Bahamas, and Mauritius), or gathered from businesses active in the North American and Caribbean market for renewable energy. Of course, the actual LRMC of any project—especially renewable energy projects—is highly site-specific, and requires a detailed feasibility study that is outside the scope of our assignment. Further analysis, such as a more detailed wind resource assessment, or a waste resource assessment to determine the quantity and quality of waste resources in Anguilla, would be needed before actually embarking in the development of these projects.

Viable technologies

The analysis shows that there are several renewable energy technologies that are economically viable in Anguilla. These are:

- Solar water heating: flat-plate systems on small and commercial scale for homes and businesses (US\$0.09 and US\$0.13 per kilowatt hour, respectively)
- Solar PV: at utility scale (monocrystalline, US\$0.22 per kilowatt hour), and distributed commercial and small scale (polycrystalline and thin film, US\$0.24 and US\$0.28 per kilowatt hour, respectively). Monocrystalline panels can also be used for residential applications. Even lower prices may be secured, for instance when discounted equipment is available—but even with our more conservative estimate, this technology is economically viable

¹⁸ CME Group. “Light Sweet Crude Oil (WTI) Futures.” Accessed 4/10/2012 at: <http://www.cmegroup.com/trading/energy/crude-oil/light-sweet-crude.htm>

- Wind ('Class 1', and lowerable/tiltable turbines), on a utility scale (US\$0.09 and US\$0.16 per kilowatt hour, respectively)
- Waste-based technologies, assuming there may be sufficient quantity of waste of sufficiently good quality in the medium to long term: landfill gas to energy (270kW internal combustion, US\$0.08 per kilowatt hour), and waste to energy (100kW anaerobic digester, US\$0.10 per kilowatt hour), on a small scale operated commercially. We screen waste-based technologies in, in spite of an extremely limited amount of waste with uncertain composition (see G.4). We do this given the Government's interest in this technology and preliminary work done for it, and the importance of waste management in Anguilla for reasons other than power generation. It is not certain that any waste-based technology may be exploited commercially in Anguilla. However, very small scale units might be implemented, and their cost assessed from the broader perspective of waste management.

Therefore, from a country perspective, a utility scale developer could generate in an economically viable way by using solar PV, wind, and (assuming this proves technically viable) waste-based technologies. Electricity customers could generate in an economically viable way using solar water heating, and solar PV—although only barely so when using a small system. From an individual perspective, all economically viable technologies are also all commercially viable. A utility scale developer could generate electricity competitively with solar PV, wind, and waste. A residential or commercial customer would save money on the tariff by using solar PV and solar water heating.

Analyzing the economic viability for each technology

As noted, Figure 5-1 above shows the viability of each renewable energy technology by comparing the LRMC of the technology (shown by the horizontal bar) with the relevant benchmark for that technology (shown by the vertical lines). We use different benchmarks for economic viability depending on the type of conventional generation that the renewable technology displaces:

- **Landfill gas to energy and waste to energy technologies** are benchmarked against the all-in cost of the most economical base load generation option (medium-speed Wartsila units) because (assuming an adequate quantity of waste allows a high enough capacity factor) they are 'firm' technologies—they could be depended on to generate electricity at any time, just like a conventional generation unit. The most economical option is the appropriate benchmark for firm renewable energy technologies, because it is the one that firm renewable energy technologies would displace if they were to be developed
- **Utility scale solar and wind technologies** are benchmarked against the average variable cost of the system operated by ANGLEC, because they are 'non-firm'—they cannot be switched on at will. This means that there needs to be a conventional generator on standby that is used as 'firming' supply when the sun is not shining, or the wind is not blowing. Every unit of energy (kilowatt hour) generated by wind and solar technologies will save fuel and variable O&M costs, but it will not save the fixed costs of

capacity (because the firming technology capacity would also have to be built)

- **Distributed scale solar and wind technologies** are also non-firm. For purposes of this analysis, we consider solar water heaters non-firm because they store some, but not all energy in the form of heat, and not all of the energy stored may actually be used. As for distributed scale wind and solar, the appropriate benchmark is the average variable cost of the system, but grossed up for system losses (12 percent). An additional credit against conventional generation to account for losses is justified for distributed technologies, because these technologies generate energy that is consumed at (or very close to) customer premises. Therefore, distributed energy generation avoids losses that there would be buying from the grid
- **Solar PV with a battery** shows an estimated cost for full backup, and should be assessed against the all-in cost of medium-speed units (for simplicity, the figure does not show this value grossed up for losses—the result would be a benchmark similar to that of other distributed scale solar technologies).

A comprehensive analysis could factor in the exact cost of generation displaced for different types of renewable technologies, in different locations and of varying capacity, and at different times of the day. But it would be of limited value given that the focus of our assignment is not that of a technical study. Instead, our focus is guidance for legal and regulatory reform. Also, cost and tariff benchmarks for assessing viability are heavily dependent on an uncertain fuel price, and therefore can quickly change significantly. For policy purposes, it is enough to conclude that some technologies (such as solar water heaters, and wind at utility scale) are clearly viable; while others (such as solar PV) may be border-line viable, and will become clearly so if fuel costs rise or the costs of the technologies drop.

Summary assessment of all renewable energy technologies

Table 5.2 briefly describes all renewable energy technologies assessed, and shows their costs, key parameters, and breakeven oil prices at which the various technologies are viable.

As noted, breakeven prices of oil suggest that most technologies viable at US\$4 per gallon oil would be viable also at lower oil prices (US\$1-2.4 per gallon):

- Landfill gas to energy is viable with oil at US\$0.70 per gallon; waste to energy with anaerobic digestion at US\$1.05 per gallon
- Commercial solar water heaters are viable with oil at US\$1.01 per gallon, and small solar water heaters at US\$1.73 per gallon
- Utility scale wind would be viable even if oil dropped at US\$1.17 per gallon (for ‘Class 1’ turbines that are more resilient to hurricanes), or US\$2.39 per gallon (for more expensive turbines that can be lowered or tilted to the ground in case of a hurricane).

However, solar PV (at current installed cost for this technology) would need oil prices between US\$3.5 and US\$3.9 per gallon to be viable, depending on whether it is installed at utility scale or distributed scale, respectively.

Table 5.2: Summary of Potential Renewable Energy Technologies in Anguilla

Name	Description	Size of plant	Unit capital cost (US\$/kW)	O&M costs (US\$/kW/yr)	Lifetime (years)	Capacity factor (%)	LRMC (US\$/kWh)	Viable with Diesel at US\$4.00/gal?	Breakeven oil price (US\$/gallon)
Landfill gas to energy (internal combustion)	Generation of electricity by combusting methane captured from a landfill	270kW	4,000	150	20	90%	0.08	Yes	0.70
Solar water heater (flat plate, commercial)	Commercial and industrial systems for heating water using solar thermal energy	70 kW	1,100	24	20	19%	0.09	Yes	1.01
Wind (850kW 'Class 1' turbines)	Wind turbines for electricity generation, designed to resist extreme gusts of 250km/hr and average wind of 36km/hr	3.4MW	1,800	50	20	35%	0.09	Yes	1.17
Waste to energy (Anaerobic Digester)	Generation of electricity by combusting municipal solid waste	100kW	5,000	150	20	85%	0.10	Yes	1.05
Solar water heater (flat plate, small)	Domestic systems for heating water using solar thermal energy	2kW	1,600	20	20	17%	0.13	Yes	1.73
Wind (275 kW lowerable or tiltable turbines)	Wind turbines for electricity generation that may be lowered or tilted in case of hurricanes	3MW	3,150	98.5	20	35%	0.16	Yes	2.39
Solar PV (monocrystalline, fixed, utility)	Polycrystalline solar photovoltaic panels with fixed mounting	2MW	3,100	60	20	23%	0.22	Yes	3.46
Solar PV (Polycrystalline, fixed, commercial)	Polycrystalline solar photovoltaic panels with fixed mounting	60kW	3,500	50	20	21%	0.24	Yes	3.36
Solar PV (thin film, fixed, small)	Thin film solar photovoltaic panels with fixed mounting	2kW	4,000	60	20	21%	0.28	Yes	3.91
Solar PV (thin film, small, with battery)	Thin film solar photovoltaic panels with fixed mounting	2kW	6,800	60	20	21%	0.45	No	6.53
Wind (10kW distributed scale turbines)	Domestic wind turbines for electricity generation	10kW	6,000	110	20	25%	0.35	No	5.04

5.2.3 Conclusions about the viability of technologies for renewable energy

Table 5.3 below summarizes our conclusions about the economic and commercial viability of renewable energy technologies in Anguilla.

Table 5.3: Conclusions about the Viability of Renewable Energy Technologies in Anguilla

Technology	Scale	Economic Viability with Diesel US\$4.00/gal	Likely economic viability in near future	Commercial viability	Explanation
LFGTE (internal combustion)	Utility	✓	Unclear (resource availability to be determined)	Unclear (resource availability to be determined)	If there were sufficient waste stream available, of a sufficiently good quality, LFGTE could generate electricity for as low as US\$0.08 per kWh compared to all-in costs of US\$0.27 per kWh of Wartsilas. Actual costs will depend on waste composition and volumes. However, currently the waste stream is unlikely to be sufficient even for the smallest generator. Gradual development in smaller modules (smaller than 0.270MW) is possible, but would increase costs. Generation costs would be lower than for waste to energy, but a lower volume of waste would be eliminated.
Solar Water Heaters	Distributed	✓	✓	✓	Solar water heaters would clearly be economically and commercially viable for homes and businesses. They could be used instead of electricity at a much lower cost than the average system variable cost (US\$0.13 and US\$0.09, respectively as opposed to US\$0.28 per kWh), saving money to consumers as well as the utility.
Wind	Utility	✓	✓	✓	Utility scale wind may represent an economically viable option to generate electricity in Anguilla—however, they would be more difficult to design, install, operate, and maintain compared to solar PV. Under an estimate of 35 percent capacity factor (which, given available data, may be conservative), turbines designed to withstand strong winds (‘Class 1’) could generate for as low as US\$0.09 per kWh. This is far less than the average system variable cost in Anguilla of US\$0.25 per kWh. Lowerable or tiltable turbines are more expensive—with an LRMV of at least US\$0.16 per kWh, always assuming high capacity factors of 35 percent—but still viable. Land availability is limited, but off-shore installations may be an option provided that higher capacity factors are ascertained to compensate for higher installation costs. Precise resource assessments conducted over a sufficiently long period, however, would be needed for offshore wind capacity.


Technology	Scale	Economic Viability with Diesel US\$4.00/gal	Likely economic viability in near future	Commercial viability	Explanation
Waste to Energy (Anaerobic Digester)	Utility	✓	Unclear (resource availability to be determined)	Unclear (resource availability to be determined)	As above, provided that there be enough primary resource, an anaerobic digester could generate electricity for as low as US\$0.10 per kWh compared to all-in costs of US\$0.27 per kWh of Wartsilas—however, capital costs may be even higher, up to US\$8,000 per kW instead of the more optimistic assumption we use (in that case, the LRMC would be US\$0.16 per kWh). Actual costs will depend on waste composition and volumes. Smaller volumes are likely to be required compared to those required for landfill gas to energy.
Solar PV	Utility and Distributed	✓	✓	✓	At oil prices of US\$4.00 per gallon small, commercial, and utility scale PV technologies are economically and commercially viable in Anguilla, and represent the most immediate option for renewable electricity generation. Design, installation, and O&M are relatively easy, especially when compared to wind and waste options. Residential and commercial scale with LRMCs of US\$0.28 and US\$0.24 per kWh is below or equal to the system cost grossed up for losses of US\$0.28 per kWh, and lower than the tariff. Utility scale installations are also viable, provided there is enough land. The LRMC of US\$0.22 is lower than the average system cost of US\$0.25.
Solar PV with battery	Distributed	x	x	✓	With high electricity tariffs, even solar PV with batteries (which for full backup increase cost by up to US\$2,800 per kW) may save on bills. However, utility services for backup and standby and connection to the grid are likely to be more cost-effective solutions compared to systems with batteries large enough to provide full backup to a consumer, at least until batteries significantly improve in performance and/or reduce in cost.
Wind	Distributed	x	x	✓	The capital costs of wind turbine technology, although decreasing in recent years, is still too expensive to make it economically viable in the Anguilla on a commercial or small scale.

5.3 Assessing the Cost of Additional CO₂ Abatement

If the Government wishes to reduce carbon dioxide (CO₂), it should do so by prioritizing economically viable technologies. This would allow it to reduce CO₂ while also saving money for the country. Reducing CO₂ by supporting non-economically viable technologies would carry an additional cost, as illustrated in Figure 5.2.

The figure shows that after the renewable energy technologies that are economically viable (those with a negative cost of abatement) are exhausted, the cost of reducing one additional ton of CO₂ begins at around US\$99 for small scale distributed wind. Small scale solar PV with full battery backup has a marginal abatement cost of US\$241 per tCO₂e.

Figure 5.2: CO₂ Abatement Cost Curve for Renewable Energy Technologies (US\$/tCO₂e)

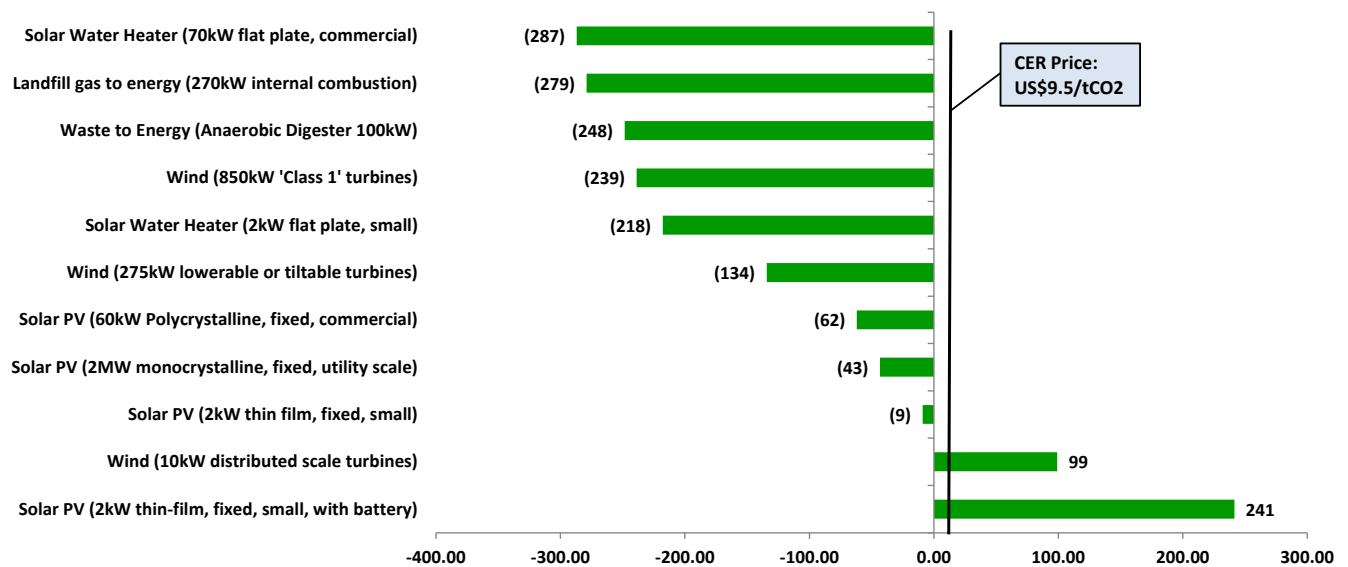

Explanation: This Marginal Carbon Abatement Cost Curve shows what cost the various renewable energy technologies require to avoid 1 ton of CO₂. Technologies that are economically viable (most of them, as shown in Figure 5-1) do that with a negative cost—that is, they avoid emitting CO₂ while also saving money. Just two technologies require spending extra money to avoid emitting CO₂—but instead of doing those two technologies, if one wanted to avoid emitting CO₂ he or she could buy an emission reduction on the market (at a price of about US\$9.5 per ton of CO₂)

Source: CER price for Carbon from Carbonex on April 15, 2012

Also, if the UK Government or any another donor were interested in reducing CO₂ emissions by supporting projects in Anguilla, it should prioritize support to renewable energy projects that are win-win solutions: those that have a negative abatement cost. As shown in the figure, these represent the majority of renewable energy options in Anguilla.

The two technologies with a positive abatement cost (small scale wind, and small scale solar PV with a battery) should not be priorities for greenhouse gas mitigation—certainly not until all other options are fully realized. Further, neither of these technologies has a cost of abatement lower than the current price for Certified Emissions Reductions (CERs)—about US\$9.50. Therefore, if global greenhouse gas mitigation were the objective, rather than supporting small scale wind or battery-provided solar PV in Anguilla, one could purchase

CERs. By doing so, one would support other projects elsewhere in the world that also avoid global emissions of greenhouse gases—but that are more efficient in doing so, requiring a lower cost.

Appendix I explains the calculation of the marginal cost of carbon abatement.

6 Barriers to Renewable Energy

Having identified which renewable energy technologies may make economic sense, we now assess the barriers that are blocking them. We define ‘barrier’ as something that prevents an economically viable renewable energy project from happening. For this, we only focus on solar, wind, and waste-based renewable energy technologies identified as viable in the previous section. (As noted, we include waste in spite of an uncertain availability of the primary energy resource, since smaller sized units might be viable in the medium-long term.)

One way to understand barriers is to think of them as the lack of critical success factors that allow viable renewables to happen. Critical factors for the successful development of any renewable energy project are summarized in the table below, divided into three categories (commercial, legal and regulatory, and other).

Table 6.1: Critical Factors for the Successful Development of Renewable Energy

Commercial	Commercial viability	Utility scale renewables must be able to generate electricity at a competitive cost (US\$ per kWh) Distributed scale renewables must be able to generate at a cost that saves money on a customer’s bill
	Right to use the primary renewable energy resource	The legal and regulatory framework should ensure that there are clear processes for establishing the right to use a resource. Primary renewable energy resources that are available in Anguilla usually have clear property rights (anybody who owns land should be allowed to harness the solar and wind energy on their property; and anybody who owns solid waste should have the right to use it to generate electricity). Other types of primary renewable energy resources not available in Anguilla, such as water or geothermal energy, pose greater problems
Legal and regulatory	Right to access and develop the site where the renewable energy project is to be set up and operated	The legal and regulatory framework should ensure there is a clear process for developing on Government land and for acquiring private land, including a process for the compulsory acquisition of land and the granting of easements
	Ability to sell electricity generated	The legal and regulatory framework should ensure that a developer can sell their electricity at a profitable price. Different rules are needed for distributed scale generation (for which, to reduce transaction costs from many small projects, a standardized authorization and price is best), and utility scale generation (for which there may be individual authorizations and a customized price, case-by-case)
	Adequate regulatory framework for electricity	There needs to be a complete body of rules that ensure good quality of service at a reasonable cost; as well as some regulatory body with the power and ability to effectively administer and enforce those rules
Other	Financing	Sufficient funding should be available at terms that correctly reflect project risk
	Equipment availability	Sufficient availability of good quality equipment at competitive prices
	Institutional capabilities	Institutions involved in the sector should have adequate financial and human resources, and adequate skills in the renewable energy field
	Technical skills	Expertise in assessing, installing, operating and maintaining, and inspecting projects
	Information and awareness	Knowledge about costs, benefits, and functioning of renewable energy projects

Based on our assessment of the existence of these critical success factors in Anguilla, Table 6.2 summarizes our analysis of barriers for utility scale and distributed scale renewable energy technologies in Anguilla. The sections below explain our assessment in detail. As a reminder, the focus of our assignment is on legal and regulatory barriers; we assess other barriers to the extent possible.

Table 6.2: Barriers to Economically Viable Renewable Energy Technologies

	Utility Scale Renewables	Distributed Scale Renewables
Commercial barrier		
Lack of commercial viability	0 (all commercially viable)	0 (all commercially viable)
Legal and regulatory barriers		
Lack of clear rights to use a resource	0 (no unclear property rights for solar, wind, and waste energy)	0 (no unclear property rights for solar, wind, and waste energy)
Lack of right to access and develop a site	0 (clear rights in place in the rules—although flaws and social norms affect the efficiency and effectiveness of these rules)	1 (clear rights—but often buildings are such that solar water heaters are impossible or too costly to install)
Inability to sell electricity generated	1 (IPPs can operate under ANGLEC’s licence; DBOM contracts are possible; but no own licence is possible for IPPs)	3 (customers cannot connect their systems or sell their excess electricity to the grid)
Regulatory distortions	3 (no obligation to operate on least cost basis; limited rate review process; uncertain cost recovery, unlike for fossil fuels)	3 (tariff structure is disincentive to allow sale of excess electricity generated from customer-owned distributed systems)
Other barriers		
Limited financing	0 (no significant financing barrier for larger actors)	2 (high upfront cost and general limited access to credit)
Limited availability of equipment	0 (no particular barrier)	1 (equipment mostly available, not always competitively priced)
Limited institutional capabilities	1 (limited capabilities, but can be overcome or contracted out)	2 (limited capabilities, but can be overcome or contracted out; limited capacity for electrical inspection)
Limited technical skills	1 (limited expertise, but can be contracted or acquired quickly)	2 (limited expertise, with some exceptions)
Limited information and awareness	2 (limited information on wind and waste for power generation)	2 (limited awareness about solar PV and water heating)
Notes: 0 = not a barrier; 1 = low barrier; 2 = medium barrier; 3 = high barrier; NA = Not Applicable. DBOM = Design, Build, Operate, and Maintain; IPP = Independent Power Producer		

6.1 Commercial Barrier—Lack of Commercial Viability

If any economically viable renewable energy project is not happening in Anguilla, it is certainly not for lack of commercial viability:

- Utility scale solar PV and wind projects could generate at less than the variable cost of generation, and waste-based projects (if technically feasible) could generate at less than the all-in cost of medium speed diesel plants. There is enough margin to accommodate cost savings and profits for developers
- Distributed scale technologies could generate electricity at less than the tariff (solar PV), or (in the case of solar water heaters) heat water at a lower cost than that required for electricity generated by the utility. There are enough savings on the electricity bill to make these systems very attractive to customers who implement them, and to account for the fact that not all water heated may be used. If anything, tariffs provide an excess of incentives for distributed scale technologies, since also non-economically viable options can be commercially viable (such as small wind).

That there should not be any commercial barrier seems like a foregone conclusion, but it helps focus attention on what is in fact important. The reason why renewables are not happening is not that they do not allow making or saving money. Therefore, the reasons must be others—as we explore below. The fact that there is no commercial barrier also has important policy implications.

Policy measures that further enhance the commercial viability of distributed scale technologies (such as duty exemptions) are well intended, and may be very visible and well perceived by the public. However, limited financial resources could be employed otherwise to tackle actual barriers.

6.2 Legal and Regulatory Barriers

For economically viable renewable energy projects to happen, persons or entities interested in developing them need to ensure three basic elements:

- The right to use an energy resource (6.2.1)
- The right to access and develop a site (6.2.2)
- The ability to sell electricity generated (6.2.3).

The right regulatory framework for electricity also needs to be in place (6.2.4).

6.2.1 The right to use an energy resource—no barriers

Developers of renewable energy need to secure the right to use any particular renewable energy resource. Each resource has different physical characteristics and economic constraints. Also, some resources are adequate for own use, while others allow selling electricity to the system operator or other third parties.

Harnessing solar and wind generation does not require any special licensing. Anybody who owns land is allowed to harness the solar and wind energy on their property. Also, whoever owns biomass or solid waste has the right to use it.

Using solar, wind, and waste *to produce electricity* is regulated. Anguilla’s laws provide a legal framework that controls the right to use these resources to produce electricity through a licensing regime. This regime has already allocated the legal right to produce electricity at both the utility scale and the distributed scale. In particular, ANGLEC is authorized by a public supplier’s licence to use any type of electric plant—including a solar, wind, or waste-

based plant—to supply electricity to the public. At the distributed scale, anyone can use a solar or wind system to generate electricity for one’s own consumption without the need for a licence under the Electricity Act, R.S.A. c. E35. Only a public supplier can use waste to generate electricity. However, the quantity of waste available in Anguilla is so limited that, if it is to be used in a viable manner, all of the available waste would need to be used by one very small plant, operated commercially by ANGLEC or by an IPP operating under ANGLEC’s licence. Therefore, there is no real barrier to the right to use waste for electricity generation, because a customer would be unlikely to achieve a sufficient scale for doing so individually.

6.2.2 The right to access and develop a site—no barriers for utility scale renewables, but solar water heaters face a problem

Anguilla’s laws are complete with regard to accessing and developing a site for utility scale renewables. Laws provide clear rules for obtaining land (including easements for access to it) to locate energy plants, obtaining the right to develop the land, and obtaining the necessary rights over land in the possession of others for electric poles and other apparatus.

Under the Registered Lands Act, R.S.A. c. R30 the following rights can be obtained by private treaty for wind power, solar power, or waste-based renewable energy projects: absolute title to land, leasehold interests in land, and easements for access to the land in which these interests are held. In addition, contractual licences, if desired, can be obtained for solar systems, and *profit-à-prendre* can be obtained for waste-based projects.

Under the Electricity Act, R.S.A. c. E35 and the Land Acquisition Act, R.S.A. c. L10 absolute ownership of land and easements over neighbouring land existing for the benefit of the land can be compulsorily acquired by the Government and transferred to a renewable energy developer. Further, the Registered Land Act, R.S.A. c. R30 declares that all land in Anguilla is held subject to the Government’s right of compulsory acquisition.

Obtaining the right to develop land to establish a renewable energy plant is provided for under the Land Development (Control) Act, R.S.A. c. L15. The relevant authorities have powers and discretion that are broad enough to grant the necessary approvals after considering issues of environmental sustainability and other matters.

As to the statutory rights, ANGLEC has statutory rights to place its poles and other apparatus on any land under the Electricity Act, R.S.A. c. E35.

The only significant barrier is at distributed scale, for solar water heaters. Viable technologies may not happen when agents who should make the decision to invest in them (paying for their purchase) are not the same people who would use them (paying for their operation). This mismatch between capital and operating expenditure decisions is known as an ‘agency problem’, and its effect for the purposes of our analysis is to neutralize incentives for solar water heaters. In the development of new construction (residential or non-residential) there may be a perverse incentive for both the developer and the buyer to keep capital costs down, and disregard the possibility to install water heating. Or, a buyer may want to install one, but be unable to because the building cannot accommodate one (or require a very high cost for doing so). Building codes specifying requirements for material, equipment, and design can make it compulsory to comply—but Anguilla’s Building Code does not do so, and is still in draft form.

Although the rules are (with the exception of solar water heaters) complete, there are additional legal flaws and social norms that affect the efficiency and effectiveness of these rules:

- ***Acquisition of land rights for locating utility scale renewable energy plant is complex***—most land is privately owned. Ownership is fragmented, and there is no land use zoning that enables renewable energy plants to be given priority in any area. Enforcement of compulsory land acquisition rules has been frustrated in the past by political considerations and opposition from private interests, despite the legal rules giving the Government clear compulsory powers and clearly imposing restrictions on legal title
- ***The development process is inefficient, being allocated to different Ministries***—planning approval, handled under the Land Development (Control) Act by the Ministry responsible for lands and planning, is separate from building monitoring and enforcement in accordance with a draft Building Code administered by the Ministry of Works. The streamlined approach proposed under the Physical Planning Bill is designed to address this issue
- ***Enforcement of building rules is difficult***—as noted, the Building Code is still in draft form. The proper functioning of the enforcement process through the use of stop orders is affected by political considerations
- ***Planning powers and discretion, though ample, are vague***—the broad discretion in the rules enables the Land Development Control Committee (LDCC) to do what they consider necessary in reviewing development applications. The downside is that the rules do not give sufficient guidance to ensure that relevant matters (like environmental sustainability) are taken into consideration, or to define the criteria with which environmental sustainability is to be assessed. Obtaining setbacks for a wind project would be difficult, because there are no utility corridor or setback rules. Further, a potential developer is not sufficiently informed about what is expected of it to obtain approval. More detailed rules such as those in the draft Physical Planning Bill and the Environmental Protection Bill would be an improvement on the existing rules
- ***Enforcement of planning powers is difficult***—the adoption of special development areas, a streamlined planning and development process, and the detailed rules concerning environmental sustainability assessment in the Physical Planning Act are hindered by political and social norms. These norms give precedence to private interests in a manner that conflicts with the legal restrictions on a landowner's rights as spelt out in the Registered Lands Act, R.S.A. c. R30
- ***Enforcement of statutory rights of the public supplier is difficult***—cultural norms dictating that the placement of electricity supply apparatus be placed along public roads have, for all intents and purposes, displaced the statutory norms under which the utility can place apparatus on any land. There is no extensive public road network in Anguilla, and the

prevalence of private land ownership may negatively impact the establishment of roads adequate for locating electrical apparatus.

6.2.3 The ability to sell electricity generated—minor barrier for utility scale renewables, significant barrier for distributed scale renewables

Of the two types of licences that are possible under Anguilla’s framework, only one—the public supplier’s licence—gives authorization to sell electricity. Private suppliers must only produce for their own consumption. This means that:

- ***At utility scale, options to sell renewable electricity exist, but are somewhat limited***—ANGLEC’s licence enables IPPs to enter the sector through the assignment rights given in clause 11—operating under ANGLEC’s own licence. Specialized contractors can also enter the sector under a design, build, operate, and maintain (DBOM) contract with ANGLEC. However, ANGLEC’s licence is exclusive, and covers the entirety of Anguilla. Also, the Electricity Act, R.S.A. c. E35 does not have any mechanism for an IPP to obtain its own licence to generate electricity to supply to ANGLEC. There is also no adequate framework of rules governing the terms of power purchase agreements to allow the effective participation of third party generators without imposing unnecessary restrictions. The current arrangements have the advantage of ensuring that IPP participation is possible in the near term without any legal or regulatory reform setting up a new licensing regime. It also has the advantage of ensuring that IPP participation is compatible with ANGLEC’s interests. The downside is that this may limit Anguilla’s options for renewable energy integration for plant that ANGLEC may be unwilling or unable to develop
- ***At distributed scale, customers cannot interconnect their systems, or sell excess electricity to ANGLEC***—current laws allow customers who own small scale renewable energy systems to benefit from the reduction in their electric bills, since they can generate for own consumption with solar and wind energy without a licence. However, the exemption from needing a licence does not cover the case of selling excess electricity to the public supplier, and the framework includes no rule to authorize them to do so. There are also no grid code or rules that make it easy and safe for customers to interconnect while preserving reliability and power quality (for which the utility, as grid operator, is responsible). Therefore, customers are prevented from capturing the value of any excess generation. Such excess generation would be valuable to customers individually if they do not require the full capacity of their system. Not being able to capture the full value of an investment increases the cost of that investment. Excess generation would also be valuable to the country as a whole, when the cost to generate saves money otherwise spent on imported fuel.

6.2.4 Existence of adequate regulatory framework for electricity—significant barriers at both utility and distributed scale

In addition to the three basic needs for developers of renewable energy systems to be able to access the resource, access and develop the site, and sell their generation, an adequate

regulatory framework for electricity needs to be in place. This means the existence of an adequate body of rules that ensure good quality of service at reasonable price; and of someone with the power and ability to effectively administer and enforce those rules. Specifically:

- ***For utility scale renewable energy***, an adequate regulatory framework would ensure that renewables are treated on a par with conventional generation options when planning and developing generation capacity. It would also enable the utility to recover efficiently incurred costs through tariffs
- ***For distributed scale renewable energy***, an adequate tariff structure would not jeopardize the utility's financial viability as an increased number of its customers generate with their own small renewable energy systems. Instead, it would allow the utility to be remunerated for services it offers to customers (and for which it incurs costs).

As explained in detail in Appendix E, Anguilla's regulatory framework is rudimentary. Rules are limited, as are arrangements and institutional capacity to administer them. The public supplier's service standards (section E.2) and criteria for tariff adjustments are broad (section E.3). The regulatory function of monitoring and enforcement of licence conditions is equally broad, and fragmented (section E.1).

The existing framework does not act as a barrier to integrating renewable energy per se. However, it does contain some regulatory distortions that prevent Anguilla from implementing that integration well, because ANGLEC is not given the correct economic incentives to integrate renewable energy:

- ***ANGLEC has no obligation to operate on a least cost basis***—ANGLEC is able to recover all of its costs once it shows that they are reasonable. It is not required to show that they are based on least cost planning—in particular, that its choice of generation investment is likely to lead to the lowest cost power for the country. This means that ANGLEC is not required to consider renewable technologies (including those that may be developed by third parties, large and small), and to adopt them if they offer lower cost power to conventional generation. This does not mean that ANGLEC has not considered renewable energy. In fact, it has, including those from third parties (as noted in section 3.2). The flaw is in the regulatory framework, not in the actual management of utility operations
- ***There is no requirement for periodic reviews of the tariff, and no detailed rules on the application process***—rate reviews must be initiated by ANGLEC, and there is no requirement as to the frequency with which this must be done. The last rate review was requested almost two decades ago. The rate review principles do not comprehensively detail the information required, or the form in which it should be submitted. The resulting process is uncertain, and uses approaches to presenting and assessing financial information that are outdated

- ***The design of the fuel surcharge provides a disincentive to ANGLEC to use renewable technologies***—ANGLEC may be able to lower the total cost of power generation by using renewables, but still be unable to recover all of that lower cost. With conventional generation, ANGLEC is more certain to recover the full cost of generation through its base rate and fuel surcharge. With renewable generation, ANGLEC trades a variable cost (buying diesel fuel to generate electricity) with a capital cost (much higher capital costs for renewables), but there is no equivalent tariff mechanism to recover that capital cost. This is not to argue against a fuel surcharge mechanism, which is needed to preserve the utility’s financial viability. It is simply to point out that this regulatory design reduces incentives for the use of renewables, even when they are lower cost
- ***The tariff structure is a disincentive to allowing sale of excess electricity from customer-owned distributed systems***—Anguilla’s tariff structure bundles all services provided by ANGLEC into one base rate, which is adjusted with the fuel surcharge. As noted, although many customers may not realize, they receive more than one service from ANGLEC: (i) the sale of electricity (kWh), which requires high variable cost of generation (mostly fuel); (ii) provision of backup and standby capacity, which requires fixed capital and O&M costs; and (iii) connection to the distribution grid, which also requires fixed costs. Under the current tariff structure, if ANGLEC sells less kilowatt hours because more and more customers generate with their own systems while keeping their utility interconnection, ANGLEC is unable to recover the costs of services (ii) and (iii), because their recovery is bundled together with the service of providing kilowatt hours (i). This means that connected customers with distributed renewable energy systems continue enjoying services that ANGLEC provides, and incurs costs for, without paying for them.

Most of the limitations above cannot be solved in the near term, or simply with the drafting of new rules. New rules would require expertise that is costly, and not currently available. There would be financial and technical constraints for the Government to fully perform the regulatory function and to administer these new rules.

Also, the best way to solve the above limitations is not necessarily to create a complex regulatory system for Anguilla as in larger countries. This would entail high costs that may not be justified given the limited amount of regulatory activity needed in Anguilla.

Finally, some of the limitations (such as the lack of a well established process for rate reviews) go beyond renewable energy integration per se, and involve broader power sector reform.

6.3 Other barriers

There are other reasons that help explain why viable renewable energy projects may not be happening and that relate to: financing (6.3.1), availability of equipment (6.3.2), institutional capabilities (6.3.3), skills (6.3.4) and information (6.3.5). Our assignment does not specifically focus on these. Therefore, the assessment below is intended to stimulate further analysis under subsequent steps of renewable energy integration in Anguilla.

6.3.1 Financing—a barrier for viable distributed scale renewables

According to several stakeholders met during our assignment, access to credit is a general problem for many households and businesses in Anguilla, particularly in the current economic situation. Financing does not seem like a barrier specific to renewable energy. Interest rates are as low as 9 percent—but only for creditworthy entities. In particular, entities in the business of utility scale projects certainly do not face constraints that households and smaller businesses do.

The upfront cost of distributed renewable technologies is high. Many households in Anguilla have limited access to credit, so that expensive equipment is unaffordable for them, even if the equipment would pay for itself overtime. Access to credit is made worse by the fact that the technologies are new and unfamiliar, so banks are unwilling to lend against them. Equipment suppliers have not yet developed hire purchase schemes or other consumer finance arrangements for these technologies. The most likely way to obtain a loan is as part of a larger development project.

6.3.2 Limited availability of equipment—a low barrier for viable distributed scale renewables

Distributed renewable energy equipment is available, but it may be relatively expensive in the country since it has to be imported (for example, solar water heaters are being imported from Barbados, St. Lucia, and even Australia). Anguilla’s small size limits bulk purchases.

However, this is a low barrier in Anguilla: there are suppliers that provide solar PV systems at competitive prices even when compared to the US market. We use these competitive prices in our analysis.

To the extent that this is a barrier, it is a chicken and egg problem: given limited uptake of solar technologies in Anguilla, they may be harder to purchase on the island, or may be sold at relatively uncompetitive prices. In turn, the limited availability and high costs may slow down uptake.

6.3.3 Institutional capabilities—minor barriers, but limited electrical inspection capacity

MICUH, AREO, and ANGLEC are the three main institutions with a key role for renewable energy development in Anguilla. To do so, they need: availability of adequate financial resources; availability of adequate human resources; and adequate skills and experience in renewable energy.

Table 6.3 below summarizes our assessment for MICUH, AREO, and ANGLEC based on these three aspects. The assessment focuses on what is related to renewables, and considers the functions that each institution should be able to carry out on a continuous basis.

Table 6.3: Assessment of Institutional Capabilities

	MICUH	AREO	ANGLEC
Availability of financial resources	Low—budget constrained, limited resources and options for renewable studies or activities	Medium—budget for renewable energy activities, dependent on donor funding with limited duration	Medium—financially viable, but constrained for new investments

Availability of human resources	Medium—structure and management in place, although only one full time staff member working on public utilities	Medium—structure and management in place; one full time staff member; administrative and public relations support available	High—adequate quantity of qualified management and staff
Skills and experience in renewable energy	Medium—adequate familiarity and experience although no formal training	Medium—adequate familiarity and experience although no formal training	Medium—no internal capability to inspect distributed renewable systems or operate and maintain utility scale plant, but could acquire relatively quickly

In addition, the Government’s **Electrical Inspector’s Office** plays a critical role for inspecting renewable energy installations, and enforcing safety and operating standards that they must meet.

MICUH

MICUH has limited financial resources and options available to fund renewable energy activities for Anguilla. However, it has overall adequate human resources and skills regarding renewable energy.

- **Availability of financial resources**—MICUH is funded by the Government’s general budget, which the UK Government stresses should be balanced. In 2010, the Government was able to balance its budget given revenues obtained through the development of a new resort in Anguilla. Fuel taxes are also an important source of revenue (Government gets 40 to 50 EC cents per IG in tax revenue on 80 percent of the diesel consumed by ANGLEC). Since 2011, the Government’s budget is tighter, and MICUH has very limited funds for studies on renewable energy or electricity sector reform. As pointed out by AREO, Anguilla’s options to obtain funding for renewable energy activities are limited. Anguilla is not eligible for funding by entities such as the World Bank, the Inter-American Development Bank, or the Organization of American States. Anguilla can access funding from the Caribbean Community (CARICOM) and the Caribbean Development Bank, but only for investment stage activities. Securing pre-feasibility funding has been difficult. The funds that may be secured must be secured through the public sector, but the public sector has little time to search or apply for these funds
- **Availability of human resources**—MICUH’s energy department comprises the Permanent Secretary; one full time officer (the Director of Public Utilities and Telecommunications); and a Chief Engineer responsible for all infrastructure (who provides support to the Energy Department). Regulatory capabilities are limited, but that is consistent with a limited set of rules to administer, and a limited number of occasions when they could be administered anyway in a small system. Functioning is efficient in spite of small size. The Government expects to transfer its

regulatory and governance functions for utility services to the Public Utilities Commission. The Public Utilities Commission Act was drafted with this intention

- ***Skills and experience in renewable energy***—MICUH’s staff is familiar with the main concepts, technologies, barriers, and opportunities regarding renewables in Anguilla. Most staff have self-trained on the topic of renewable energy (attending several workshops and conferences, doing research and taking online courses, and discussing with experts). Self-training builds on solid academic credentials.

AREO

AREO has been effective in securing financial resources in spite of limited options. It has overall adequate human resources and skills regarding renewable energy.

- ***Availability of financial resources***—AREO is funded by grant resources. The Anguilla National Trust (a registered non-profit organization) channels the grant money to AREO. In 2008, AREO received its first two and a half years of funding from the Overseas Territories Environmental Programme (OTEP). Currently, AREO is being funded by CDKN with resources of the UK Department for International Development (DFID), and has established an effective cooperation with these entities. Since the grants are typically for short periods, AREO needs to periodically identify and apply for different ones. When AREO cannot access to grant resources, it becomes a volunteer organization. AREO faces the same limitations of MICUH in terms of options for securing funding for Anguilla
- ***Availability of human resources***—AREO consists of one full time member, who is responsible for management and implementation of all of its activities. The Anguilla National Trust provides administrative support. One public relations specialist also supports AREO. AREO reports on its progress and results to the different donor organizations that fund it. Functioning is efficient in spite of small size
- ***Skills and experience in renewable energy***—AREO’s full time staff member has no formal educational training in renewable energy, but has developed thorough skills and understanding on the job during the past five years. She has also built a broad international network in the renewable energy sector through conferencing, research, and public outreach activities.

ANGLEC

ANGLEC is a financially viable company. It has adequate human resources, and has a good basis upon which it may build skills for renewable energy.

- ***Availability of financial resources***—ANGLEC is a commercially viable company, thanks to direct fuel cost-pass through and despite very infrequent adjustment of base rates. However, ANGLEC is not a cash-rich utility. ANGLEC management states that the company has been able to finance new required investments by paying out lower returns and no large dividends to shareholders, improving the efficiency of its plants, and

benefitting from increases in sales. Lack of base rate reviews constrains the ability to make new investments, particularly highly capital-intensive ones in renewable energy. ANGLEC management states that the company aims to operate as a private entity, but a socially responsible one—even limiting increases in the fuel surcharge, absorbing part of that cost. As a result, actual tariffs—although high—are lower than what they could be according to the law. ANGLEC’s cash position is constrained due to an expansion in capacity to meet increased demand prior to the global economic crisis. The company’s cash position is now gradually recovering in spite of lower than usual collection rates and customer disconnections (some of which have been reintegrated—see footnote 2 on page 4)

- ***Availability of human resources***—ANGLEC has adequate human resources. It has about seventy staff, divided into the Administration, Transmission and Distribution (T&D), and Generation areas. Management comprises eight people. The Administration area comprises the General Manager, the Chief Financial Officer, the Human Resource Manager, the Accountant, and the IT Manger. The Generation area comprises the Systems Control Engineer, the Generation Superintendent, and the Maintenance, Operations, and Electrical Supervisors. The T&D area comprises the Network Operations Engineer, the T&D Superintendent, the Technical Services Engineer, the Customer Service Engineer, and three supervisors. Decisions go through the management team, which tables them with the Board, which in turn adopts them
- ***Skills and experience in renewable energy***—ANGLEC has no formal renewable energy expertise, but could handle distributed scale projects quickly because of its general qualifications. For example, it hired a contractor to install the hospital’s system, but is now operating and maintaining it directly. For general technical assistance, ANGLEC states that it would rely on the Caribbean Electric Utility Service Corporation (CARILEC) or PV Power in the UK. For utility scale renewable energy plants, ANGLEC envisions either contracting a specialized company to Design, Build, Operate, and Maintain (DBOM); design and build with just a few days’ training; or buying from an IPP. The O&M component of a DBOM contract could also be limited in time for simpler plant such as solar PV, and be handed off to ANGLEC after a few months or less; any waste-based technology may require a longer time.

Electrical Inspector’s Office

The Government’s Electrical Inspector Office, which is part of the Planning Department, does not have the expertise or resources to inspect distributed renewable energy systems on buildings to make sure they comply with reliability and safety technical requirements. In particular, the Office could not handle inspecting an increased amount of renewable systems, or enforcing a new set of safety and operating standards for renewables.

6.3.4 Technical skills—minor barriers

There are a few qualified installers of distributed renewable energy systems, but no certification to inform people about who they are. Most retailers of renewable energy

systems do not have the capability to install them. Several solar water heating systems were poorly installed in the past, causing malfunctioning and slowing down uptake of this very cost-effective technology.

The Building Code is in draft form. Prepared in 1994, it provides insufficient guidance for proper installation of renewable energy systems. Also, it provides no mandatory predisposition for installation of viable equipment such as solar water heaters.

At utility scale, most skills can be contracted given the limited amount of transactions, and transferred to ANGLEC.

6.3.5 Information and awareness—barriers for solar, wind, and waste energy

There is limited information about the actual technical, economic, and financial viability of renewable energy options in Anguilla. For solar PV, limited information is not a problem given Anguilla's situation in the Caribbean. However, wind and waste need more site-specific assessments. ANEC has proposed preliminary plans for 'Zero Energy' Development Zone in Corito that could include wind, solar, and waste-based energy installations. A wind data analysis by Mistaya Engineering Inc. for Green Island Power, LLC provides some resource data on Corito and the East part of the island, suggesting high capacity factors. Information on waste volumes and weight is regularly collected (including a breakdown by origin), but no specific information on the waste's composition is available to allow assessing the viability of specific technologies.

There is also limited awareness regarding the installation, import, and benefits of renewable energy systems in Anguilla. As noted, many customers are unaware of costs and benefits of solar water heaters, and arguably even less of those of more complex systems such as solar PV. According to conversations held in Anguilla, most customers are not aware of the duty free concession for importing solar water heaters that has existed for the last twenty years; or that for other renewable energy equipment, as recommended in the National Energy Strategy (and as upheld in practice for the past few years). Also, consumers must apply for duty free concessions on a case by case basis using a long procedure. There are no training programs at the community college level to increase awareness or capacity on renewables, nor any technical schools or city and guilds vocational programs in Anguilla.

7 Recommendations to Integrate Renewable Energy

Anguilla can use renewables for saving on fuel costs for power generation—and it should do so as soon as possible, given the energy crisis that its households and businesses face.

Table 7.1 summarizes our recommendations for overcoming barriers discussed in the previous section. The table shows recommendations that should be followed **now** (in the short term) and others that may be followed **later**—but as soon as possible (in the medium term, and no later than 2015, consistent with the Roadmap presented in the following section).

Where no barrier exists, we recommend no measure (cells shaded in lighter grey in the table):

- All economically viable technologies (both at utility, and at distributed scale) are also commercially viable. Therefore, nothing additional should be done to increase their commercial viability. In particular, this means that technologies that are already commercially viable do not need to be subsidized. Current duty exemptions might be left as they are if desired. However, they should not be increased, because it would not be economically justified. Lost revenue from exempted duties could be better used to solve actual barriers, such as limited access to financing
- There are no barriers to the right of using solar, wind, and waste resources for generating electricity. Therefore, nothing more is needed
- There is nothing in the existing rules that blocks the right to access and develop a site for utility scale renewable energy generation. New procedures in the Physical Planning Bill and new details provided in the Environmental Protection Bill may improve the current situation, streamlining the process and guiding the authorities' broad discretion under existing rules
- There are no particular barriers to financing utility scale renewable energy, or obtaining the equipment at a reasonable cost. The flexibility in the existing licensing regime that allows ANGLEC to contract an IPP under its public supplier's licence may help let others finance renewable energy projects, if needed.

In the remainder of this section, we recommend how to solve actual barriers identified:

- We start by recommending **measures that should be taken now** for realizing Anguilla's immediate renewable energy potential, with the strictly necessary changes and additions to the existing rules (7.1)
- Then, we recommend **further legal and regulatory measures than may be taken later** (7.2)
- Finally, we recommend **other measures to solve barriers not related to the legal and regulatory framework** (7.3).

Table 7.1: Recommendations for Integrating Renewable Energy Technologies

	Utility Scale Renewables	Distributed Scale Renewables
Commercial barrier		
Lack of comm. viability	No barrier —no measure	No barrier —no measure
Legal and regulatory barriers		
Lack of clear rights to use a resource	No barrier —no measure	No barrier —no measure
Lack of right to access and develop a site	No barrier —no measure	Now —Mandate solar water heaters for new buildings
Inability to sell electricity generated	<p>Now—Amend ANGLEC’s licence and the Electricity Supply Regulations by adding ‘Rules for Renewable Energy’ to develop, procure, or contract utility scale renewables under ANGLEC’s licence</p> <p>Now—Publish a request for EOIs for the planned solar PV tender</p> <p>Now—Include O&M in RFP for solar PV tender</p>	<p>Now—Amend ANGLEC’s licence and the Electricity Supply Regulations by adding ‘Rules for Renewable Energy’ to create a SOC</p> <p>Now—Amend Electricity Act by extending licence exemption to the sale of excess renewable electricity to the public supplier under a SOC</p> <p>Now—Issue a pilot SOC with a limited cap and a pilot disaggregated tariff</p> <p>Later—Issue a revised SOC with a revised cap</p>
Regulatory distortions	<p>Now—Amend ANGLEC’s licence and the Electricity Supply Regulations by adding (i) a definition of ‘Approved Renewable Energy Costs’; and (ii) a cost recovery principle for ‘Approved Renewable Energy Costs’</p> <p>Later—Commission COSS; Amend Electricity (Rates and Charges) Regulations with disaggregated tariff structure; Determine best option for regulator to administer rules</p>	
Other barriers		
Limited financing	No barrier —no measure	Later —Use this report to secure low-cost financing, guarantees, and grants for solar projects (water heating, PV); Set up consumer financing initiative
Limited availability of equipment	No barrier —no measure	
Limited institutional capabilities	Now —Secure funding for further activities, such as a cost of service study or broader power sector reform	Later —Secure funding for further activities; Strengthen capacity of Electrical Inspector’s Office to deal with SOC
Limited technical skills	Now —Include O&M when procuring a specialized contractor	Later —Check any rules related to electrical wiring or installation
Limited information and awareness	Later —Assess quantity and quality of wind and waste resources	Later —Adopt external certification for installers of renewable technologies
<p>Notes: DBOM = Design, Build, Operate, and Maintain; O&M = Operations and Maintenance; IPP = Independent Power Producer; COSS = Cost of Service Study; RFP = Request for Proposals; EOI = Expression of Interest; SOC = Standard Offer Contract. ‘Now’ = short term; ‘Later’ = as soon as possible after the short term measures are implemented, and no later than 2015.</p>		

7.1 Measures for Realizing Anguilla’s Immediate Renewable Energy Potential

Anguilla can and should take immediate steps to develop renewable energy—in particular at utility scale, which represents the most cost-effective option; but also at distributed scale.

For both utility and distributed scale projects, ANGLEC’s licence and the Electricity Supply Regulations should be amended by adding:

- ‘Rules for Renewable Energy’ to develop, procure, or contract renewable energy at a utility and distributed scale and distributed scale according to best practices (7.1.1)
- A definition of ‘Approved Renewable Energy Costs’, and a cost recovery principle for ANGLEC to safely recover them and make its allowable return on them (7.1.2).

In addition, for utility scale renewables, ANGLEC should:

- Issue a request for expressions of interest for the solar PV plant it intends to procure (7.1.3)
- Add a brief period of operations and maintenance (O&M) in its draft Request for Proposals for solar PV (7.1.4).

For distributed scale renewables:

- The Government should amend the Electricity Act to extend the exemption from a licence to also cover the sale of excess electricity produced by solar and wind generation to a public supplier if the person has a contract with the public supplier to do so (7.1.5)
- ANGLEC should develop a pilot Standard Offer Contract (SOC) with a pilot disaggregated tariff (7.1.6)
- The Government should mandate solar water heating for new facilities (7.1.7).

7.1.1 Utility and distributed scale renewables: amend ANGLEC’s Licence and Electricity Supply Regulations by adding Rules for Renewable Energy

The Government wants renewables to reduce electricity costs over the long term, and to contribute as much as possible to satisfying current and projected demand.

Utility scale solar PV represents the most immediate opportunity for achieving both goals. The Government can achieve those goals by incentivizing ANGLEC to follow Rules for Renewable Energy (‘the Rules’), so that ANGLEC may develop a solar PV plant and any other utility scale renewable project in the best possible way.

Distributed scale solar PV can also make its contribution to achieving the Government’s goals. Customers who supply excess electricity at an economically viable cost with solar PV should be compensated for the higher fossil fuel costs that they offset.

Appendix J contains a draft of the recommended Rules. Below we explain how we recommend adopting the Rules; what the rules should contain for utility scale renewables;

what the options are for implementing utility scale renewable energy projects; and what the Rules should contain for distributed scale renewables.

How to adopt the Rules for Renewable Energy

We recommend adopting the Rules by amending ANGLEC’s Public Supplier’s Licence and the Electricity Supply Regulations, adding a Schedule to both. The Schedule would be the only schedule to the Public Supplier’s Licence (which has no other schedules), and would also be placed at the end of Schedule 1 of the Electricity Supply Regulations. ANGLEC’s Public Supplier’s Licence is a schedule to the Electricity Supply Regulations. However, any change to the Electricity Supply Regulations would only affect licenses issued after these are changed. Therefore, to be effective, all recommended changes to the Electricity Supply Regulations would also need to be made to ANGLEC’s Public Supplier’s Licence.

ANGLEC may also want to consider either of these two options:

1. Amending its by-laws, or
2. Adopting a new ‘Policy for Renewable Energy’.

Under the first option, ANGLEC would ensure compliance with the Rules by an amendment to its by-laws. This way, the Rules would bind the company, shareholders, and directors—and by extension, officers who manage ANGLEC on behalf of the directors—to follow the Rules. Appendix K contains proposed language for implementing this option. The procedure for amending the by-laws is set out in the Companies Act in section 63:

By-law powers

63. (1) Unless the articles, a by-law, or any unanimous shareholder agreement otherwise provides, the directors of a company may by resolution make, amend, or repeal any by-laws for the regulation of the business or affairs of the company.

(2) The directors of a company shall submit a by-law, or any amendment or repeal of a by-law made under subsection (1) to the shareholders of the company at the next meeting of shareholders after the making, amendment or repeal of the by-law, and the shareholders may, by ordinary resolution, confirm, amend or reject the by-law, amendment or repeal.

(3) A by-law, or any amendment or repeal of a by-law, is effective from the date of the resolution of the directors making, amending or repealing the by-law until—

(a) the by-law, amendment or repeal is confirmed, amended or rejected by the shareholders under subsection (2); or

(b) the by-law, amendment or repeal ceases to be effective under subsection (4);

and, if the by-law, amendment or repeal is confirmed or amended by the shareholders, it continues in effect in the form in which it was confirmed or amended.

(4) When a by-law, or an amendment or repeal of a by-law is not submitted to the shareholders as required by subsection (2), or is rejected by the shareholders, the by-law, amendment or repeal ceases to be effective, and no subsequent resolution of the directors to make, amend or repeal a by-law having substantially the same purpose or effect is effective until the resolution is confirmed, with or without amendment, by the shareholders.

(5) A shareholder who is entitled to vote at an annual meeting of shareholders may make a proposal to make, amend or repeal a by-law.

This first option of amending the by-laws to ensure compliance with the Rules presents advantages and disadvantages:

- The key advantage would be greater certainty that the Rules would actually be implemented, and also greater certainty that investments done in accordance with them would be recoverable through tariffs (see section 7.1.2 below)
- On the other hand, if ANGLEC were unable follow all the Rules in certain circumstances, this could be considered a violation of the Rules. This, in turn, could expose management to liability in front of the company and shareholders. To mitigate this disadvantage, the language we propose for the by-law amendment in Appendix K adds flexibility, introducing the possibility for the directors to obtain approval for deviations from the rules (before or after the deviation). In these cases, however, there would be greater uncertainty as to cost recovery.

Under the second option, ANGLEC would issue a new policy stating that the company will use its best endeavors to allow renewable energy to be developed in accordance with the Rules. Language for implementing this option is contained in Appendix K, too. Also this option presents advantages and disadvantages:

- On the side of advantages, there would be additional likelihood for renewable energy to be implemented according to the Rules—and actually, for the very Rules to be implemented—without any risk of liability, compared to only having the economic incentive of cost recovery and ensured return
- The disadvantage would be, of course, that Rules would not actually be binding for ANGLEC. The sanction in case it did not use its best endeavors to follow the Rules would be relatively small (mostly limited to public opinion).

ANGLEC could also decide to follow neither of these options. In this case, there would only be an economic incentive to follow the Rules—but it would be a strong incentive, because renewable energy can be profitable, and following the Rules would allow ANGLEC to be financially viable also in the face of an increased number of its customers self-generating with solar PV systems. Even if neither option were chosen, Anguilla’s legal and regulatory framework for renewable energy integration would be complete. There would just be no legal or policy commitment to actually use such framework.

What the rules should contain for utility scale renewables—a best practice process

The rules would establish a best practice process to develop, procure, or contract new renewable energy generation capacity that consists of:

- A **demand forecast**—ANGLEC management would prepare this
- A **least cost generation plan with full consideration of renewable energy options** (including those at distributed scale) alongside conventional ones, while

also preserving system reliability, power quality, and creating no unreasonable financial risk. ANGLEC management would prepare this

- A **consultation with the public**—one such as under our assignment would also be appropriate, since ANGLEC participated, and an independent assessment of candidate renewable energy options was presented
- An **approval of the least cost generation plan**—ANGLEC’s Board of Directors would sign off on this
- An **identification of the best option to design, build, operate, maintain, and finance** new renewable energy generation capacity. ANGLEC management would have to assess three possible options (see Table 7.2 for an explanation and comparison of these three options) and select from them the one that is most likely to deliver power reliably and at least cost:
 1. Fully developed by ANGLEC
 2. Procured to a specialized contractor under a Design, Build, Operate, and Maintain (DBOM) contract
 3. Contracted to an Independent Power Producer (IPP)
- A **transparent and competitive procurement process when the best option identified involves third parties** (that is, either procurement under a DBOM contract, or contracting an IPP). The process would provide clear eligibility and evaluation criteria, and include a prequalification phase (publishing of a request for expressions of interest) before issuing a full request for proposals to shortlisted bidders, for limiting the amount of proposals to be reviewed to just those of most qualified bidders. The Board of Directors would sign off on bidding documents and any contract awards, while the rest of this step would be delegated to management to carry out.

This process would also be subject to regular reruns, with updated demand forecasts and least cost generation plans, and public consultations at each update.

What are the options to do utility scale renewable energy under the rules?

Table 7.2 explains what entity would design, build, operate, maintain, and finance a project under each of the three options that ANGLEC would have to assess, and from which it should select the best one to deliver least cost power reliably.

Below we explain each option’s advantages and disadvantages in greater detail.

The **fully utility-integrated option** would have ANGLEC design, build, operate, and maintain the plant (with the option to hire a contract for design and build) just like it does for conventional plant.

- **Advantages.** This option would have an easier and quicker implementation process, which would largely be internal to ANGLEC. It would also allow using ANGLEC’s relatively low cost of capital
- **Disadvantages.** On the other hand, ANGLEC’s capacity to raise the financing may be constrained. Its capability to design, build, and especially operate and maintain the plant once it is built may be limited.

The **DBOM contract option** would be a form of public-private partnership—a way to share operational and financing responsibilities for providing the electricity service. This option would represent an intermediate option between the other two.

- **Advantages.** This option would leave it to a specialized contractor to do what it can do most effectively (precisely the activities identified by the acronym D, B, O, and M). It would also be relatively quick and easy to implement, and enjoy ANGLEC’s relatively low cost of finance. Further, it would allow the contractor to train ANGLEC’s staff for a certain period (shorter or longer, depending on the technology) on O&M, making sure there is an adequate skills transfer before a potential hand-off to the owner that financed the plant
- **Disadvantages.** We see no disadvantages to this option, apart from being subject to any financing constraint of ANGLEC’s. This financial constraint is limited because the Caribbean Development Bank has agreed to lend ANGLEC money at low interest rates.

Table 7.2: Options for Implementing New Utility Scale Renewable Energy Projects

Option	Design	Build	Operate	Maintain	Finance	Summary Assessment
Fully developed by ANGLEC	ANGLEC/ contractor	ANGLEC/ contractor	ANGLEC	ANGLEC	ANGLEC	Pros: relatively easy and quick; low cost of capital Cons: ANGLEC financial constraints, and limited ability to operate/maintain
Procured under DBOM contract	Contractor	Contractor	Contractor (may transfer to ANGLEC after initial period)	Contractor (may transfer to ANGLEC after initial period)	ANGLEC	Pros: relatively easy and quick, efficient, low cost of capital, allows capability transfer to ANGLEC Cons: ANGLEC financial constraint, although the Caribbean Development Bank has agreed to provide soft loans to ANGLEC
Contracted to an IPP	IPP	IPP	IPP	IPP	IPP	Pros: not subject to ANGLEC financial constraints, no need for new licensing regime Cons: relatively complex and long, likely higher cost of capital

The **IPP option** would be fully developed by a third party that would sell all electricity to ANGLEC under a power purchase agreement (PPA), which would in turn re-sell it to customers.

- **Advantages.** This option would let third parties implement technologies that the utility is unwilling or unable to implement, such as more complex ones involving waste. It would also be a way to alleviate ANGLEC's financial burden, transferring it to a third party. Further, the IPP could operate under ANGLEC's licence, with no need to create and administer a third party licensing regime
- **Disadvantages.** This option would be longer and more complex to implement. It would involve preparing and negotiating a PPA, and enforcing grid interconnection standards on the IPP. Ultimately, this option may even be more expensive, depending on an IPP's cost of finance, and on the need to attract specialized labor from abroad to settle in Anguilla for a long period. Finally, it may be difficult to implement in practice, since most qualified bidders may be more interested in a DBOM contract (or just a design and build contract) so that they may pursue other business opportunities as soon as they complete one.

What the rules should contain for distributed scale renewables—arrangements for a well designed Standard Offer Contract

For distributed scale renewable energy, ANGLEC would:

- Identify the **technically and economically viable cap** for eligible distributed generation to contribute to the energy mix. This cap could be set at a lower amount initially. Then, it could be expanded as much as the grid can progressively handle, for example thanks to additional backup and standby capacity
- Create a **grid and distributed generation code** setting out rules for safely interconnecting distributed renewable energy generation to the grid, as well as limits on the maximum unit size and total capacity, if required. This would ensure that interconnecting customers' systems is easy and safe; that individual systems are set up primarily for own use; and that the system can handle all distributed systems together
- Create a **Standard Offer Contract (SOC)** under which ANGLEC would buy excess power from eligible customers:
 - At a **fair rate set at actual avoided fuel cost** (that is, considering ANGLEC's cost of generation that is offset by distributed generation under realistic dispatching conditions). This would mean implementing a net billing arrangement, and not a net metering arrangement. As we explain in more detail below, we believe that actual fuel cost would be a good and relatively easy way to calculate avoided cost
 - In **compliance with the grid and distributed generation code**, which would be part of the terms and conditions of the Standard Offer Contract
 - For a **term no less than a system's useful lifetime** (usually 20 years). This would be necessary to provide certainty to customers who decide to invest in a distributed renewable energy system
- Introduce, in accordance with ANGLEC's licence, **any changes to tariffs and supply conditions that are necessary** to ensure that customers who both buy

from, and sell electricity to ANGLEC pay for no more and no less than the services they actually receive

- Provide the opportunity for the Minister to object to how the SOC is designed. This rule would specify that the possible objections would regard the appropriateness of: (i) the maximum eligible cap to preserve grid stability and reliability of service; (ii) the technical requirements to ensure safe interconnection; (iii) the rate to reflect actual avoided cost under realistic dispatching conditions; and (iv) the term to reflect economic lifetime of systems.

What a well designed SOC looks like is likely to be a controversial matter, in Anguilla like in most places. Different actors—the utility, customers as individuals, sellers and installers of systems—are likely to have a different opinion, depending on the interest of each. The best way to address the matter of a well designed SOC is from the perspective of the country as a whole (all customers collectively). This would be appropriate for an assignment contracted by the Government, to pursue the interest of the entire population instead of any particular sectors of it. The questions below address the matter from this perspective.

Why a complex package of several items? A SOC (in some countries called a feed-in tariff) is technically a standing offer to purchase power from small scale systems at some predetermined (but not necessarily fixed) price, for a predetermined period of time, and subject to certain technical requirements. It is a set of standardized tools for implementing projects that transaction costs would make it impracticable to implement on an individual basis. All details are provided for upfront in a standard way. This requires more time and effort upfront for an apparently complex package. On the other hand, it requires less time and effort for customers to sign up one after another (and for the utility to contract with them) once the package is ready.

Why a cap on individual and overall eligibility? ‘Distributed generation’ is defined by its connection to the distribution network. Therefore, it needs to be of a certain size consistent with the voltage of the distribution network, and consistent with the systems being developed primarily for self-generation. Individual caps could be set by customer type (in Anguilla, levels of consumption); for example, a maximum of 50kW for residential customers, and 150kW for small non-residential ones, and perhaps more for larger non-residential ones.



Capping total eligibility to an amount that the system can handle allows preserving the quality, stability, and reliability of service. A total cap can increase once the system is upgraded. However, the two actions should happen in the following order, in the interest of quality of service (for which the utility is responsible): first, the system is upgraded; then, the total cap may increase. The limit could be established as a percentage of peak demand on a first come, first served basis. An initial cap would be set at a lower level. Then, it could be updated once it is evaluated, and once its effects on the utility’s finances and operations are analyzed.

Why a grid code? A system operator may be legitimately concerned that interconnecting renewables (especially intermittent ones) may affect the quality of service. If this concern is not solved, the result may be that even viable options are not allowed to connect to the grid. Instead, a standard grid code or interconnection agreement would allow anyone (especially installers hired by customers) to know in advance what needs to be done to comply. It would

include technical and operating standards, but only those that are necessary to ensure safety, reliability, and stability of service.

Why net billing at avoided fuel cost, and not net metering? The figure below illustrates the difference between net metering and net billing.

Figure 7.1: Difference between Net Metering and Net Billing

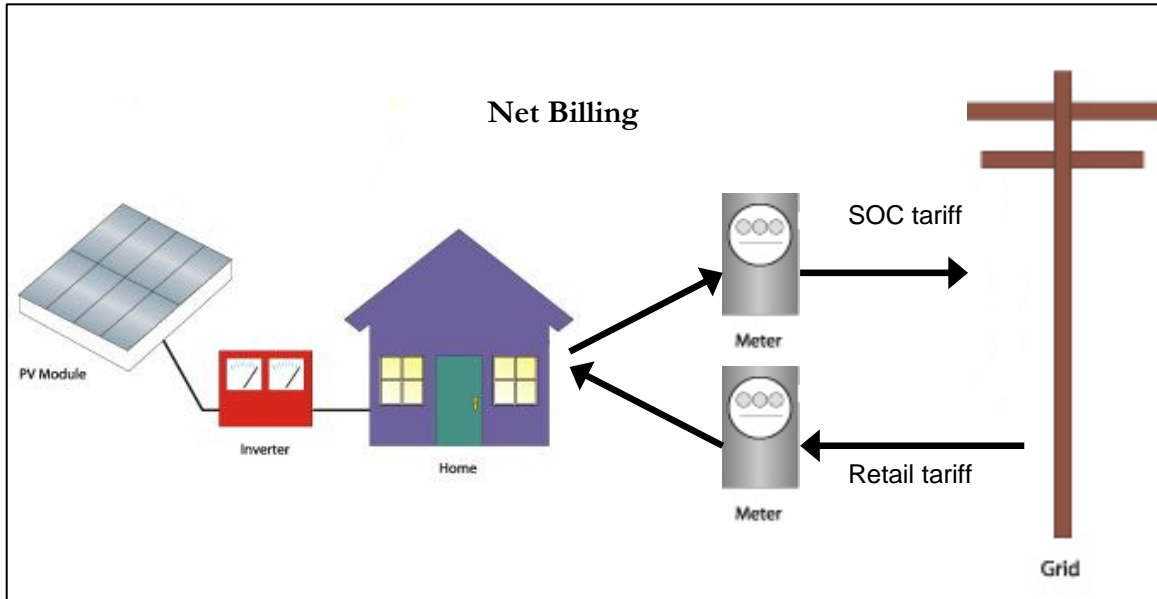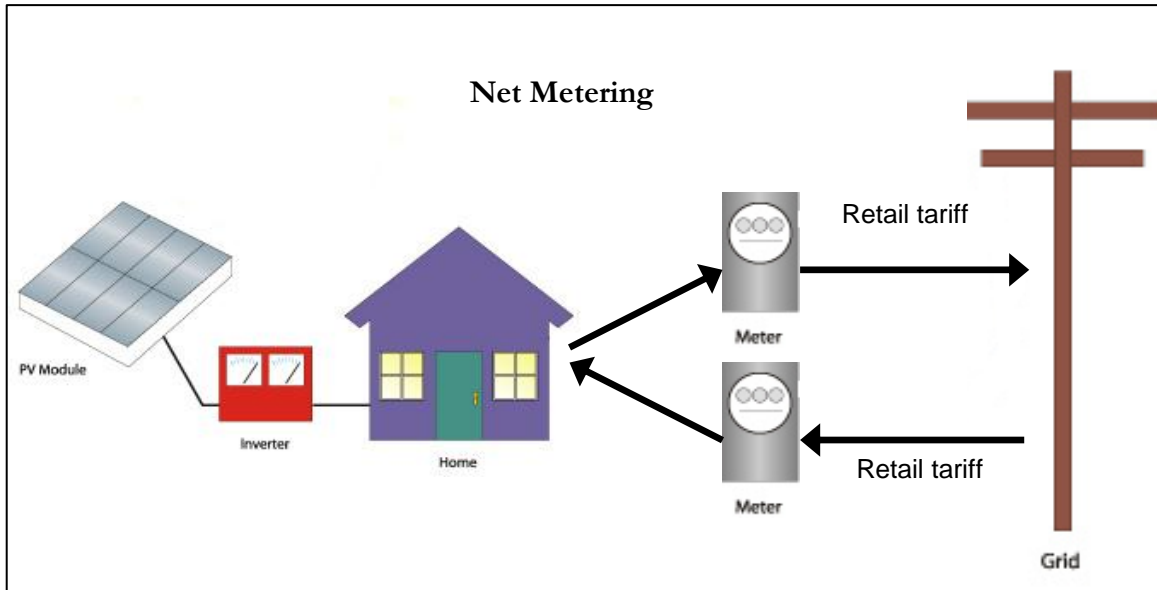

Net metering spins a customer's meter backwards when it sells excess electricity. This causes the utility to supply some of the electricity it sells to its customers at the retail price that customers pay for electricity on their bills (higher value), instead of at the actual cost to generate that electricity (lower value). This means that, for a utility to remain financially viable, it must recover those higher costs. A utility will do so by charging all customers more

on their electricity bills so that it can recover the cost of purchasing more expensive electricity from the distributed renewable generator (since it will have to pay for that electricity at the retail price, which is higher than the utility's own cost of generating electricity using diesel). The result of purchasing this electricity at retail price is that it raises the electricity costs and tariffs of everyone in the country. Customers that participate in the SOC are subsidized by other customers that do not have renewable energy systems. Net metering is easier to implement and provides an incentive to individual customers to install renewable energy systems. However (even if eligible system size is limited) it raises customers' bills—even just by a small amount, if eligibility is limited. Increases in costs and prices would be contrary to the priority objective for Anguilla to integrate renewable energy. The incentive to individual customers (in addition to being at the expense of others) is also an unnecessary one in Anguilla, where solar PV is already commercially viable (it saves on the tariffs).

On the other hand, net billing measures the electricity that a customer buys separately from the electricity that a customer sells; and applies two different rates to these two flows: the retail rate, and the SOC rate (which we recommend be set at avoided cost), respectively. This arrangement ensures that the country as a whole pays no more than it should for its electricity, while customers that contribute to the energy mix with least-cost power get a fair price for it (no more than what it would cost the utility to supply it, and no less either). Net billing still allows customers to capture the entire value of their investment since they can sell the excess electricity generated back to the grid. Net billing is a little more complex to implement—but not too complex, as we further explain below. In particular, it is consistent with Anguilla's priority objective for renewable energy integration.


Which avoided cost should be used, and what does 'realistic dispatching conditions' mean? The time of peak electricity demand in many Caribbean countries, including Anguilla, tracks peak solar production, which means that solar PV could be supplied at the time when the utility needs it most, and at the time that the utility consumes the most amount of fuel to generate this electricity. However, neither solar PV nor wind can offset fixed costs of investing in firm generation that can provide backup and standby. They only offset variable costs, which are those that fluctuate depending on how much electricity is generated (mostly fuel; as well as variable O&M costs such as lube).

The actual avoided cost encountered by a utility over an extended period of time will vary from year to year depending on fuel prices obtained, and which plant is available for dispatch. However, if a utility operates economically, it should be dispatching the most efficient units first, then the next most efficient, and so on (as described in section B.2.4, ANGLEC's high speed units, the least efficient, provide only about 2 percent of generation).

As more distributed renewable energy is interconnected, utilities may be concerned that running units at a lower regime may make them far less efficient. This concern has some merit, but should not affect the result if the avoided cost is calculated taking into account realistic dispatching conditions. At all time, all units except the marginal one should generally be optimally loaded, so the quantity of power generation provided by a non-optimally loaded unit should be relatively small. Fuel consumption of the engines is usually specified by the manufacturer for about 80 percent loading. In our experience, one can expect a variation in fuel efficiency that causes about 2 percent lower efficiency at full power, and between 2 and 5 percent lower efficiency at about fifty percent load, depending on the manufacturer. The

extent of the variation is usually dependent on the type of fuel injection and turbocharging technology used. Figure 7.2 below shows typical results for a Wartsila engine.

Figure 7.2: Relative Fuel Consumption of a Wartsila Engine at Different Loads

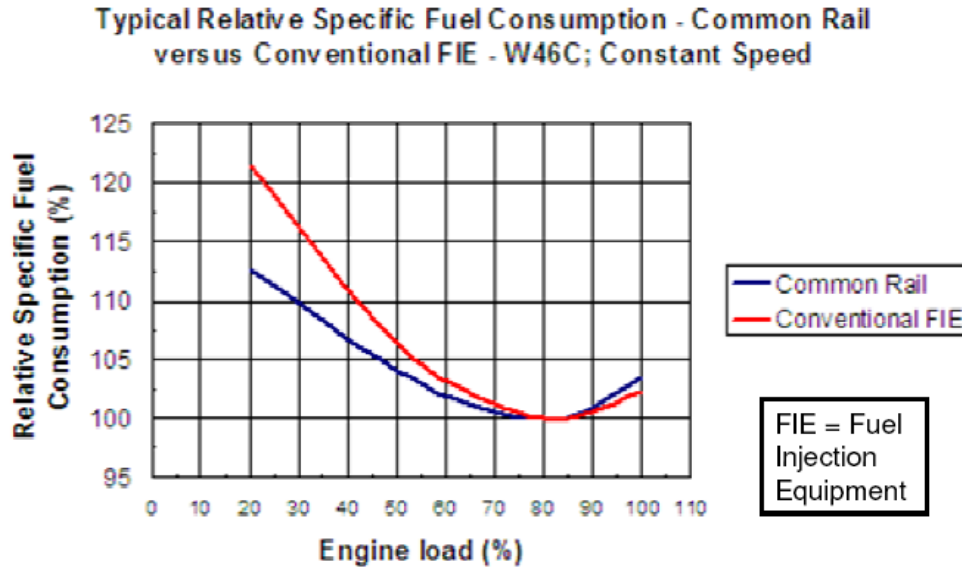

Source: P. Hakkinene, *diesel engines*, https://noppa.aalto.fi/noppa/kurssi/kul-24.4410/materiaali/Kul-24_4410_chapter_3.pdf

Avoided cost should certainly be quantified. However, the quantification should not be very difficult (fuel cost incurred per kilowatt hours generated over a certain period). Also, the increase in fuel cost calculated as a result should not be large, and should not hurt customers. Further, in the longer term there would be mechanisms to ensure recovery of these costs (see section 7.1.2).

We recommend providing consumers with the possibility of selecting between two options on how the avoided fuel cost they receive is calculated:

- The **short-run avoided fuel cost**, to be updated on a periodical basis (for example annually, or even monthly) based on actual value. This would be calculated based on realistic dispatching conditions that take into account the machines' fuel efficiency curves, which the company would review periodically (annually, at least). Customers may choose this option if they believe that actual future costs will be higher
- The **current estimate of long-run avoided fuel cost**. This would be calculated based on realistic dispatching conditions and a likely generation expansion plan. Customers may choose this option if they believe that actual future costs will be lower.

Wouldn't net metering at the retail tariff be better than net billing at avoided fuel cost? The question of net billing versus net metering is probably the one that was asked more frequently, and more passionately, during our visits to Anguilla. It is a very important question that deserves extra attention.

In the table below we provide answers to the more detailed arguments that are typically made in favor of net metering.

Table 7.3: Key Questions and Answers on the Net Metering vs. Net Billing Debate

Argument in favor of net metering	Answer
<p>Solar PV should be given a financial incentive like in every successful implementation of it worldwide.</p> <p>Net billing at avoided cost provides no incentive for solar PV—instead, it removes the main incentive to customers to install solar PV, and will probably kill progress.</p> <p>Only net metering can provide the incentive needed. Without sufficient financial incentive, the SOC will not be successful. Given the limited access to finance, without net metering it will be more difficult to secure financing.</p> <p>Financing depends on provable returns, and by lowering the returns, one lowers the likelihood that a bank will want to offer financing.</p>	<p>The best financial incentive for doing solar PV in Anguilla is that it is, in itself, a commercially viable investment there—it already saves on customers’ bills, and has good returns (see Box 7.2). Therefore, it is incorrect to state that net billing removes the main incentive to solar PV—the main incentive for solar PV is that it is commercially viable. This is a significant result in a country where electricity costs are so high, and where about a fifth of the population lives below the poverty line. Financial incentives in successful examples worldwide have been given in rich countries where solar PV is not commercially viable.</p> <p>This is not to say that solar PV faces no financial barrier. In fact, it does in terms of access to good loan terms for systems that have a relatively high upfront cost. Therefore, there is a case for a financial incentive—but instead of making other Anguillan customers pay for it (as would surely happen with net metering), taxpayers of developed countries should be paying (as would happen if the subsidy were given through a low-cost consumer finance instrument for distributed renewables funded by a bilateral or multilateral donor).</p> <p>Net metering alone would not be a sufficient financial incentive, because all it would do would be to make an already commercially viable technology even more viable for those who can already afford it. It would not, by itself, address the real barrier—access to finance, which (as recommended in section 7.3) should be overcome with other instruments (concessional loans, guarantees, or a dedicated consumer finance facility). There can be ‘provable returns’ even under net billing: the rate would simply be at a lower level since it would be set at avoided fuel cost, but it would vary in time just like the tariff, because also tariffs vary depending on the price of fuel.</p>
<p>The matter of how ‘avoided cost’ is established will be subject to mistrust and suspicion, and can be easily manipulated. It is best avoided altogether by a net metering mechanism.</p>	<p>In fact, a SOC at actual avoided fuel cost would increase transparency rather than hinder it, and help convince customers that they are getting a fair price. Currently customers do not even know what the fuel cost portion of the tariff is, or how it is calculated—mistrust and suspicion are present today. The proposed solution, instead, strongly argues that fuel cost (EC\$ per kWh) should be the avoided cost used. Fuel cost is not at all difficult or uncertain for the utility to determine, and it should be published on a regular basis.</p>

<p>Net metering creates more certainty, while net billing creates more uncertainty.</p>	<p>Net billing and net metering provide similar certainty, since both the retail tariff and avoided fuel cost vary directly with the utility’s varying cost of diesel—only, the retail tariff varies at a range that is higher than that of the cost of fuel alone.</p> <p>The real key to greater certainty for customers is the term granted for the SOC, which (as recommended) should be as long as the system’s lifetime (20 years). A shorter term does create uncertainty, and is the key reason behind the limited success of other regional programs.</p>
<p>Since the amount of solar PV eligible for the SOC would be limited, any negative effect of net metering incentives would be minuscule; and if the installed systems are capped, the effect of net metering on the utility’s profitability would be very small.</p>	<p>This may be true in the short term, but this assignment aims to create a legal and regulatory framework that is valid in the long term when the amount of distributed renewable generation is likely to increase. A net billing arrangement at avoided cost, with gradually increasing caps as soon as technically and economically feasible, is a better and more sustainable solution.</p>
<p>Nowhere (particularly in the Caribbean) is net billing successful—not even in Jamaica, which has offered a 15% premium over avoided cost.</p>	<p>It does look like no Caribbean country has developed distributed generation correctly for now (although several have been trying different approaches). Anguilla could well be the first country to do so the first time around. As summarized in Box 7.1, Grenada started with net metering, but switched to a buy-all/sell-all arrangement at avoided cost since net metering was costing the company too much (the utility cannot pass extra costs on to customers). Barbados’s net billing arrangement has had limited success, mostly due to a very short term that makes the arrangement highly uncertain. Applications in Jamaica, on the other hand, have been picking up. The Cayman Islands have embarked on net billing—but to provide for a feed-in tariff that is even higher than the retail rate; the additional cost is recovered through all customers’ bills.</p>
<p>Net metering is fair because customers are paid for the power they generate exactly what they pay to the utility for the power it generates.</p>	<p>Many customers argue that if they sell electricity to ANGLEC, they should get the same rate that ANGLEC charges them. Actually, the proposed solution would be a powerful way to do precisely that. The rate paid to customers for solar PV-generated electricity would be the same paid by customers for diesel-generated electricity: the fuel surcharge, which is the cost that the customer offsets by generating electricity itself. The fuel surcharge is a direct pass-through for power generation on which the utility makes no profit.</p>

In summary:

- **Net metering** at the retail tariff would be better from the perspective of individual customers, and would be easier to implement. However, it would make the country as a whole worse off, as it would make all

customers pay so that solar PV (which is already a viable investment) would be even more viable for customers who can afford it

- **Net billing** at avoided fuel cost would be better from the perspective of the country; it would be a little more difficult to implement—but not too difficult, and more transparent and fair.

Box 7.1: Experience with Distributed Generation in the Caribbean

Grenada. In February of 2007, Grenada Electricity Services Ltd. (GRENLEC) issued a Phase I feed-in tariff (FIT). This FIT was a net metering scheme for renewable energy systems up to 10kW that capped total nameplate capacity total at 300kW (roughly 1 percent of GRENLEC’s peak demand). The FIT’s total installed capacity reached 272kW as of March 2012, with the remaining 18kW expected to be installed by September 2012. The Phase I FIT costs ANGLEC approximately ECD500,000 per year. These costs cannot be passed onto the consumer because GRENLEC operates under a price cap system. In addition, GRENLEC cannot charge a separate rate to recover the costs of providing backup power and the use of its wires under the current tariff structure. Given the cost created by this program, in January 2011 GRENLEC launched a modified Phase II FIT (individual cap 100kW per system, total cap 500kW). One hundred percent of the electricity generated by customer-owned renewable energy is metered and purchased by GRENLEC at about ECD0.5 per kWh. Selling all electricity to customers at retail rate and buying customers’ excess electricity at avoided cost enables GRENLEC to recover its fixed costs.¹⁹

Barbados. Barbados Light & Power (BL&P) offers a Renewable Energy Rider for distributed renewable energy under a net billing arrangement at avoided cost. The maximum system size is 5kW for residential customers, and 50kW for commercial customers. The Rider is available on a first-come first-serve basis up to a maximum of 200 systems, or a combined installed capacity of 1.6MW, whichever comes first. Electricity purchased is supplied to the grid at 1.8 times the Fuel Clause Adjustment or 31.5 Barbados cents per kWh (a ‘floor’), whichever is greater.²⁰ Currently, the Rider has 13 participants (10 residential and 3 non-residential) for a total capacity of 92.4kW. Ten additional commercial customers have applied for systems of 100-150kW—the regulator recently gave BL&P permission to add a limited number of commercial systems up to a maximum of 150kW on a buy all/sell all basis that would allow BL&P to recover its fixed costs. Uptake to date has been slow mainly because of the uncertainty about the continuation of the renewable energy rider. BL&P is currently reviewing the RER, aiming to set up a new arrangement by July 2012.²¹

¹⁹ Communication with management of WRB Enterprises and GRENLEC, 27-29 March 2012.

²⁰ The Barbados Light & Power Company Limited. “Renewable Energy Rider”. http://www.blpc.com.bb/bus_energyrider.cfm (accessed May 31, 2012).

²¹ Castalia exchange exchanges with Stephen Worme at BL&P 2 April 2012.

Jamaica also recently started implementing a net billing system for distributed renewable energy generation, based on avoided cost plus a 15 percent premium. The Government announced its plans to implement net billing at the end of 2011; implementation was delayed for some time, mainly due to the need to approve the technical requirements for the interconnection. As of May 2012, the regulator has received 10 applications. The renewable energy generation is expected to be paid about US\$0.18-0.25 per kilowatt hour based on current market prices (avoided cost + 15% renewable energy premium).²²

Cayman Islands. The Electricity Regulatory Authority approved, in September 2012,²³ feed-in tariffs for a customer-owned renewable energy (CORE) program that are even higher than retail tariffs: CI\$0.375-0.385 per kilowatt hour, compared to CI\$0.35 per kilowatt hour. Additional costs are recovered through an increase in all customers' bills.

Why a long term? A SOC at avoided cost should not mean uncertainty. Customers in other Caribbean countries where a short-term, avoided cost arrangement is being offered—such as Barbados, whose Renewable Energy Rider is at avoided cost, but for a limited term—are not buying in, and with good reason. Customers need to know that they will be fairly remunerated for what they provide for the long term, not just for a few years—arguably, providers of financing need to know the same.

A long term will also reduce transaction costs for the utility that buys electricity, to avoid renewing or reissuing interconnection agreements once they have expired after too short of a period.

Why change the tariff too? Supply of energy (sale of electricity measured in kilowatt hours) should be the separate tariff component that eligible SOC customers may avoid paying (at least to some extent), because their systems offset the variable (mostly fuel) cost of supplying that energy. However, their systems do not avoid the cost of being connected to a distribution system that is required to sell the excess electricity to the grid, or having backup and standby capacity when the sun is not shining or the wind is not blowing. For this, tariff structures should charge separately for supply of energy, distribution, and backup and standby capacity. Otherwise, by implementing renewable distributed generation, grid-connected customers may be enjoying services they do not pay for, and force other customers to bear those costs.

Disaggregating a tariff structure needs to be done correctly. In section 7.1.6 we explain what could be done in the immediate term, while in section 7.2.2 we recommend what to do in the longer term.

²² Jamaica Observer. “Net billing to be implemented this month”. http://www.jamaicaobserver.com/news/Net-billing-to-be-implemented-this-month_11394396#ixzz1wTnksR5Q (accessed May 31, 2012).

²³ ERA, CUC. Press Release (3 September 2012). The Electricity Regulatory Authority of the Cayman Islands approves new Feed-in Tariffs for Consumer-Owned Renewable Energy Generation Programme.

Box 7.2: Solar PV with Net billing at Avoided Fuel Cost from a Customer's Perspective in Anguilla

A typical 2kW thin-film PV system with a turnkey cost of about US\$8,000 could generate net savings amounting to a net present value (NPV) of about US\$3,801 over a period of 20 years, assuming: (i) a capital cost of US\$4,000 per kW; (ii) an annual O&M cost of US\$60 per kW, (iii) a loan to finance 60 percent of the capital cost over a period of five years at an interest rate of nine percent per annum; and (iv) 50 percent of the solar PV output consumed by a customer, with the remainder 50 percent being sold to ANGLEC at an avoided cost of grid power generation of US\$0.28 per kWh. The payback time of the solar PV project to the customer would be eight years, and the solar PV system would yield an Internal Rate of Return (IRR) of 17 percent. If the interest rate on the loan were 6 percent (a concessional rate such as one that could be obtained through donor funding), the net present value of the solar PV project would increase to US\$4,169, IRR would increase to 19 percent, and the payback time would be 7 years.

7.1.2 Utility scale: amend ANGLEC's licence and Electricity Supply Regulations by adding tariff setting principles on recovery of sustainable energy costs

The Rules for Renewable Energy that we recommend cover how to correctly plan and develop renewable energy investments. However, in themselves they do not fully ensure that ANGLEC may actually recover those investments, and make an allowed return on them. Anguilla's rate review process is uncertain, with little detail as to what steps it should involve, or what information should be provided apart from financial statements. There is also no provision for rate adjustments to happen at regular intervals (the last rate adjustment was done in 1994); and limited regulatory capacity to carry out the rate adjustments.

Setting up a thorough rate review process to solve these problems, and setting up the entity to administer it, are matters that go well beyond renewable energy integration alone. They are matters of broader power sector reform that need to be addressed for any type of investment (renewable, but also conventional generation, and other non-generation investments too). As such, these matters are not part of the scope of this assignment. A rate review process only for renewable energy would create a parallel set of rules to the rate adjustment process that is established under the Electricity Supply Regulations. This would exacerbate regulatory uncertainty instead of mitigating it. It is far more advisable to build upon the existing rate adjustment process to allow renewable energy costs to be recovered following the same process as conventional generation.

There are two very different approaches any person or entity exercising the regulatory function could take to encourage renewables:

- The most obvious would be to simply order the utility to invest in particular projects that the regulator (broadly intended) considers beneficial
- The other is to provide incentives for the utility to make the most efficient decisions itself, based on the power of the regulator to allow or disallow the costs that the electric utility may pass on to consumers through electricity tariffs.

We recommend the latter strategy, because it promotes economic efficiency for the benefit of customers without interfering with the utility's day-to-day business. This would be done by inducing the electric utility to: (i) develop least cost renewable energy plant itself, or (ii)

procure or contract least cost electricity from third parties—specialized contractors under a DBOM arrangement, or IPPs, respectively, or (iii) purchase the electricity from distributed renewable energy generators. Given an approved tariff level that only covers least cost plant selected from a range that includes renewables, the utility would have to invest in (or purchase from) least cost renewable energy plant if it wants to be financially viable.

The way to induce the utility to follow a best practice process would be to offer it an incentive to follow the Rules for Renewable Energy. This would mean stating that, as long as it follows the best-practice process to implement renewables at utility and distributed scale (as established in the recommended Rules for Renewable Energy), it would recover the cost of investing or purchasing from cost-efficient renewables. Costs incurred in accordance to due process and rules would be identified as ‘approved renewable energy costs’, and considered *prima facie* to be used and useful and to have been prudently incurred. As such, they would be approved for recovery through tariffs.

This approach could be achieved by adding the following definition in section 1.1 of both ANGLEC’s Public Supplier’s Licence and Schedule 1 of the Electricity Supply Regulations:

‘Approved Renewable Energy Costs’ are any of the following costs, if the Licensee complied with the Schedule ‘Rules for Renewable Energy’ in incurring them:

- *renewable power generation investments that are made by the Licensee, and operating and maintenance expenses, depreciation, and any taxes of those investments that are incurred by the Licensee,*
- *utility scale renewable power purchase costs that are incurred by the Licensee, as a consequence of purchasing renewable power from third parties, and*
- *distributed scale renewable power purchase costs that are incurred by the Licensee, as a consequence of purchasing renewable power from its consumers.*

And by adding the following statement in section 4.4 of both ANGLEC’s Public Supplier’s Licence and Schedule 1 of the Electricity Supply Regulations:

The Minister or the Arbitrator shall consider that Approved Renewable Energy Costs are reasonably incurred.

To be effective, the recommended changes would need to be made to both the Electricity Supply Regulations and to ANGLEC’s Public Supplier’s Licence.

Appendix J contains these same amendments. The definition of ‘Approved Renewable Energy Costs’ could also be expanded to include investments in energy efficiency (both on the supply side, for ANGLEC; and on the demand side, for ANGLEC’s customers) that ANGLEC may make. In that case, the adjective could be changed from ‘Renewable’ to ‘Sustainable’. These costs could then be recovered through tariffs, and the utility could make an allowed return on them benefitting customers and itself.

7.1.3 Utility scale: ANGLEC immediately to publish request for expressions of interest for solar PV

ANGLEC’s initiative to procure a 1MW solar PV plant is an excellent idea, and should not be delayed.

Consistent with the best practice process described in the rules, we recommend that ANGLEC publish as soon as possible a request for expressions of interest. This will allow a broad range of qualified bidders to learn about the opportunity and prepare competitive offers adequately. It would also allow limiting the number of full proposals that should be evaluated, since it would enable selecting a short list of bidders. ANGLEC has implemented this recommendation.

7.1.4 Utility scale: ANGLEC to add O&M in the solar PV Request for Proposals

ANGLEC's draft RFP to procure the design and build of a 1MW solar PV plant looks well designed and structured. We recommend that ANGLEC consider adding an O&M component (even a short one, given the relative simplicity of operating and maintaining a solar PV plant compared to other technologies), turning it into a DBOM contract; and once the rules for renewable energy are adopted, check that the RFP complies with them.

7.1.5 Distributed scale: amend Electricity Act to extend exemption from licence also to the sale of excess electricity once the person has a contract with the public supplier

We recommend amending the Electricity Act, Part 2, Section 2, subsection 2 by adding the following text in bold, and deleting the word 'only' from the phrases "for the purpose only of supplying electricity"(Appendix L contains this same amendment):

(2) Subsection (1) shall not apply to the use of any electrical plant which—

*(a) is powered only by wind and which is used by any person for the purpose ~~only~~ of supplying electricity to his own premises, **or selling excess electricity to a public supplier if the person has a contract with the public supplier to do so;***

*(b) is used only for the photovoltaic generation of electricity by any person for the purpose ~~only~~ of supplying electricity to his own premises, **or selling excess electricity to a public supplier if the person has a contract with the public supplier to do so;***

This amendment would overcome the barrier of inability to sell renewable electricity at distributed scale. Unlike solar PV, small scale wind is not economically viable. However, as long as the rate it obtains under a SOC is no more than avoided cost, making it eligible for the SOC would not harm other customers.

7.1.6 Distributed scale: ANGLEC to develop pilot Standard Offer Contract (SOC) with pilot disaggregated tariff

Anguilla's distributed renewable generation potential is likely to be high, and should be implemented as soon as feasible. However, a gradual approach would be wise to begin. A gradual approach would allow assessing operational and financial implications, test customer interest, and provide time to prepare for broader uptake.

As explained above, implementing grid-connected distributed renewables requires two elements that must be both provided together:

- A well designed SOC
- A disaggregation of the tariff structure.

The calculation of avoided cost (both short and long term) may take relatively less time, but accurately disaggregating the tariff would require a Cost of Service Study (COSS). A COSS would estimate what it actually costs to supply different services to different customers, even at different times of the day. A COSS will be useful, but will take some time to procure and carry out—and additional funding.

Anguilla should not wait for all of this to happen, and should start piloting a SOC as soon as possible, with a limited cap. A pilot disaggregated tariff could be estimated, and be offered by ANGLEC as part of the SOC package. This can be done with no changes to laws or regulations, simply pursuant to sections 4.1 of both ANGLEC's public supplier's licence and Schedule 1 of the Electricity Supply Regulations:

(4.1) (...) if, having due regard to the nature and circumstances of a supply of electricity to any consumer or potential consumer, the Licensee considers that the terms and conditions of affording such a supply under the provisions of this Licence are inappropriate, any or all of such terms and conditions may be amended by agreement in writing between the Licensee and such consumer or potential consumer: Provided further that details of any such amendment shall be notified to the Governor in writing and published in the Gazette.

The technically and economically viable cap for eligible distributed generation that can be part of the pilot SOC would limit to a negligible value the effect of any error in the tariff calculation before a cost of service study can be done.

The pilot SOC can also include other clauses such as a breach of contract clause. If the customer interconnects a system with an installed capacity larger than the one allowed (and unless it agrees with ANGLEC that it can do so), or violates any technical rule that jeopardizes safety or service reliability, the customer could be subject to penalties including the termination of the SOC. Terminating the SOC would not be equal to disconnecting a customer (for doing this Anguilla's regulatory framework establishes certain conditions, violating the SOC not being one of them). Any disconnection would only be temporary, just like for any works that need to be done on a residential or commercial load.

Once ANGLEC has prepared the pilot SOC, the Minister responsible for energy would then check it to verify that the renewable energy caps, grid and distributed generation code, rates to purchase the excess renewable energy, and term of the pilot SOC are set in accordance with the requirements in paragraphs 1, 2, and 3 of the distributed renewable energy generation section of Rules (see the Schedule Rules for Renewable Energy Appendix J). The way to solve any remaining difference would be consistent with how the Government and ANGLEC address any difference—through an Arbitrator. The Arbitrator would be empowered to state whether the Minister's objections are justified.

Afterwards, ANGLEC would issue the pilot SOC, and start interconnecting and purchasing renewable energy from eligible customers.

7.1.7 Distributed scale: mandate solar water heating for new facilities

For new buildings, the Government should mandate that when a water heater is installed, it be a solar water heater, and one compliant with a Caribbean appropriate certification such as one used in Barbados, Saint Lucia, or Jamaica. The mandate could be included in the draft Building Code, or by amending the Building Regulations. An effect of this mandate would be that new buildings that need a solar water heater must be constructed with the necessary space, plumbing, and wiring for installing solar water heating systems.

The requirement would affect builders. However, they would recover costs from sales just as they do with any other requirement of the draft Building Code. If homeowners do not need a water heater, they would not be required to buy and install one.²⁴ Certain exemptions could be made to opt out under certain circumstances (such as for low income households). Even in these cases, nonetheless, there should be a requirement for buildings to be roughed-in with the necessary plumbing and wiring in case an owner wants to install a solar water heater in the future.

Amending the Building Regulations could also enable the Government to (i) mandate and enforce guidelines for proper installation of renewable energy systems, and (ii) make mandatory, when renovating or retrofitting old buildings and constructing new buildings, the installation of necessary piping and plumbing to make the fitting of solar water heaters possible.

Alternatively, mandating solar water heaters could be a simple step in the permitting process. There is a precedent for this in Anguilla: new buildings are not granted a permit unless they are fitted with an underground water tank to collect rainwater.

We make a few recommendations for existing buildings in section 7.3.

7.2 Additional Legal and Regulatory Measures for Later

With the measures recommended in section 7.1, Anguilla could implement in a relatively short period a significant part of its potential—especially at utility scale, which enjoys the least costs. As soon as those immediate measures are implemented, there are four other measures that Anguilla should take:

- Commission a Cost of Service Study (7.2.1)—as the basis for a better tariff structure that works for promoting distributed renewables, and as a key way to identify opportunities for cost savings other than renewables
- Amend the Electricity (Rates and Charges) Regulations with a disaggregated tariff structure (7.2.2)—charging separately for energy, distribution, and capacity; and potentially including a special component for recovering all clean energy investments
- Issue a revised SOC (7.2.3)—with an increased total cap, and based on the experience with the pilot
- Determine the best option for a regulator to administer rules (7.2.4)—selecting it from different domestic and regional options. The Government intends to move the regulation and governance of ANGLEC from MICUH to the Public Utilities Commission (PUC).

7.2.1 Utility and distributed scale: commission a Cost of Service Study

As noted above, the Government of Anguilla or ANGLEC should commission a COSS to assess what it actually costs to supply different services to different customers (and ideally, by time of day for larger customers). The COSS would provide the necessary information for changing the tariff structure to a disaggregated one and setting the value of the various

²⁴ Also, when mandating solar heaters for buildings, it might be sensible to also have an exemption for builders of vacation homes, that are only used for short periods each year, if they show that they have a more cost-effective solution.

components (as recommended below). It would also be critical to identify ways other than renewables to reduce costs—particularly reducing generation operating costs (which, as shown in section B.2.4, are among the highest in the region) and reducing losses.

7.2.2 Utility and distributed scale: amend the Electricity (Rates and Charges) Regulations with a disaggregated tariff structure

The Electricity (Rates and Charges) Regulations state what the tariff components are (Schedule I, section 2.(1)), how much they amount to, and—in the case of the fuel surcharge—how they are calculated. They were developed as a result of a rate adjustment that was done in accordance the Electricity Supply Regulations and ANGLEC’s licence.

However, these Regulations and the licence do not state that a base rate and a fuel surcharge must be the only tariff components. In other words, they do not mandate which components there should be. There could be other and different tariff components.

Therefore, there could be a rate adjustment under which a disaggregated tariff structure is approved, resulting in new Electricity (Rates and Charges) Regulations being made to reflect this approved new disaggregated tariff structure. No specific legal or regulatory reform would be required in addition to the rate adjustment.

Such a tariff structure (which could be defined as ‘sustainable tariff structure’) would be disaggregated and cost-reflective, charging consumers separately for:

- Supply of energy, measured in kilowatt hours sold (energy charge)
- Connection to the distribution system (connection charge)
- Provision of generating capacity (capacity charge).

Cost of fuel should be included fully in one component (fuel surcharge), and not split between a base charge and the fuel surcharge.

We also recommend publishing the fuel surcharge (in EC\$ per kilowatt hour) monthly, for transparency. Current ANGLEC bills do not do so, and the way that the fuel surcharge is calculated and included in tariffs makes it even more difficult to appreciate.

The ‘sustainable energy tariff structure’ may also:

- Reduce cross-subsidies between consumer classes—to the extent that is consistent with the Government’s policy objectives of affordability (the Government could maintain a lifeline tariff for the lowest-consuming customers, but at least it would be clear how much this costs and what the effect is on other customers; or provide for cash transfers that do not distort the cost-reflectiveness of rates)
- Charge consumers on a variable basis, depending on the time of day, so far as this is practical and cost-benefit justified.

Finally, we recommend that ANGLEC apply, within a rate review, for the creation of a special, separate tariff component that could be called ‘Renewable Energy Recovery Clause’. All Approved Renewable Energy Costs, as defined above, could be recovered through this tariff component. In turn, this tariff component would require a rate review just for being set up the first time, but then it could be adjusted without one, as soon as approved investments are operating and benefit customers. Customers would see the ‘Renewable Energy Recovery

Clause’ as a separate item on their bill, and know what it is for. Especially, they would know that it corresponds to reductions in the fuel surcharge. This same tariff component could also be used for energy efficiency investments, of course (and in this case be called ‘Sustainable Energy Recovery Clause’, and approved costs ‘Approved Sustainable Energy Costs’).

7.2.3 Distributed scale: issue a revised Standard Offer Contract

Based on the experience of the pilot SOC, and once a COSS allows a general revision of all customers’ tariff structure, ANGLEC should issue a revised SOC with an increased cap, updated rates based on avoided cost, and again a term equal to the systems’ lifetime. Customers participating in the pilot program might be given the option to migrate under the new regime, and to have their term reset.

7.2.4 Utility and distributed scale: determine the best option for a regulator to administer rules

There would be three options for a regulator to administer the rules of a reformed regulatory framework (including new rules for renewables, as well as broader rules for the power sector). Each option has advantages and disadvantages:

- **Assign regulatory functions to the Public Utilities Commission (PUC)**—this would require changes to the Electricity Act, and ANGLEC’s public supplier’s licence. The PUC could be a well functioning regulator, but would need to hire new staff with power sector expertise. (Currently the PUC only regulates Anguilla’s telecommunications sector.) Therefore, it may end up being a costly solution. This is the option preferred by the Government, and it is consistent with the intent with which the PUC Act was drafted
- **Maintain the current situation, and appoint an Electricity Commissioner**—this would be a quick solution, and would require no amendments of laws or regulations. However, this solution might not be very effective, since any Minister would be unlikely to have the specialized skills required, and the Electricity Commissioner’s powers would be subject to the current limitations. It may also be a costly solution if a skilled Electricity Commissioner were hired to perform limited functions infrequently
- **Assign regulatory functions to the Eastern Caribbean Electricity Regulatory Authority (ECERA), once it is set up**—the ECERA could be a good option for an effective body at reduced cost, since the cost would be pooled among several countries. However, the ECERA may take several more years to set up, as well as international agreements between countries of the Organization of Eastern Caribbean States (OECS), in addition to changes to domestic laws and regulations.

7.3 Other Measures

For problems of limited financing and limited availability of equipment, we recommend **using this report to secure low-cost financing and other financial resources for distributed solar systems—both solar water heaters and solar PV**. A consumer financing facility, even if limited, could help address the problem of a high upfront cost (in a

context of limited loans) much better than duty exemptions. Two main options for securing financing would be possible:

- Funds could be sought from the UK Government and its agencies, arguing that a widespread program for funding solar water heaters would generate CO₂ emissions reductions at a relatively low cost
- ANGLEC could be allowed to fund the cost of purchasing and installing the systems, and recover these costs through their tariffs.

Loan guarantees, concessional loans (that is, loans with better-than-market terms, such as a lower rate or a grace period), and grants for project preparations would be the main financial tools possible.

To help solve limited institutional capabilities, we recommend:

- **For distributed scale renewables, that the Government strengthen the capabilities of the Electrical Inspector's Office** (human resources, financial resources, and skills) so that it may (i) handle an increased number of inspections under the SOC, and (ii) enforce any new operating and safety standards. The Electrical Inspector's broad powers under the Electricity Act, R.S.A. c. E35 and Electricity Supply Regulations R.S.A. c. E35 allow him to enter any premise, inspect any installation, wiring, or fitting (this includes renewable energy installations), and have ANGLEC disconnect any customer if it does not meet the requirements of the Electricity Supply Regulations
- **For utility and distributed scale renewables, that the Government and ANGLEC secure funding for further studies and reforms**—such as a COSS, or broader power sector reform matters.

To help increase skills for renewables in the country, we recommend:

- **For utility scale renewables, including an O&M component (even short) when procuring a specialized contractor**
- **For distributed scale renewables, checking whether any licence arrangements and the Electrical Code²⁵ related to electrical wiring and installation are appropriate** for small PV and wind systems, and for solar water heating, respectively. If there are no licence arrangements in place, or the arrangements and the Electrical Code are inadequate, the Government may want to put adequate arrangements in place to ensure safety. The grid and distributed generation code that is part of the SOC will ensure grid safety and stability for these interconnected systems; however, other standards may be warranted for stand-alone systems that are not interconnected to the grid.

²⁵ Electrical Code means the National Electrical Code as published by the National Fire Protection Association of Boston, Massachusetts, United States of America as amended or replaced from time to time; as indicated in the Electricity Supply Regulations R.S.A. c. E35.

One concern about the installation and operation of distributed renewable energy generation on an electric power system is a condition which is referred to in the industry as ‘islanding’. Generally, islanding refers to the condition existing when a distributed generator continues to feed power into the system even though electrical power from the electric utility grid to which it is connected is no longer present. A common example of islanding is the failure of a grid supply line that has solar panels connected to it. In such a case, the solar panels will continue to deliver power as long as the sun is shining.

Islanding can be dangerous to utility workers, who may not realize that the circuit is still powered by the distributed renewable energy source. For that reason, distributed renewable energy generators must be able to detect islanding and immediately stop producing power. This is referred to as anti-islanding. For this reason, the inverters that are designed to supply power to the grid are generally required to have some sort of automatic anti-islanding circuitry built into their controls. These controls will have the ability to detect, whether by way of sensing a decrease in the line voltage immediately prior to the grid failure, or the existence of particular transient conditions, that the grid to which it is connected has failed.

Typically, all manufacturers who make renewable energy generating equipment designed to be connected to the grid have the capacity to incorporate some level of anti-islanding functionality into the design of the equipment. This should be a requirement in all equipment specifications to ensure that the equipment may detect electrical islands and disconnect itself from the electric power system properly.

If the licence arrangements and Electrical Code do not adequately address this issue, MIUCH may consider setting minimum quality standards (such as requiring an anti-islanding functionality) to ensure that the renewable energy systems that are installed in Anguilla are safe and appropriate for the Caribbean. Anguilla could look at United Kingdom, United States, Canada, or international standards for guidance to set these renewable energy system standards, such as those of the British Standards Institute²⁶, National Institute of Standards and Technology²⁷, the American National Standards Institute²⁸, Standards Council of Canada²⁹, or the International Electrotechnical Commission.³⁰

To help enhance information and awareness, we recommend:

- For utility scale renewables, **further assessing the quantity and quality of wind and waste resources**. Wind might be even more economical than solar PV (although much more difficult to develop, operate, and maintain). Waste is very little, but for a small island like Anguilla solving the waste

²⁶ British Standards Institute. <http://www.bsigroup.com/>. Last accessed (21 August 2012).

²⁷ National Institute of Standards and Technology. <http://gsi.nist.gov/global/index.cfm/L1-5/L2-44/A-171>. Last accessed (21 August 2012).

²⁸ American National Standards Institute. <http://webstore.ansi.org/RecordDetail.aspx?sku=CAN%2fCSA+F383-2008>. Last accessed (21 August 2012).

²⁹ Standards Council of Canada. <https://www.standardsstore.ca/eSpecs/index.jsp>. Last accessed (21 August 2012).

³⁰ International Electrotechnical Commission.

<http://webstore.iec.ch/webstore/webstore.nsf/mysearchajax?Openform&key=solar&sorting=&start=1&onglet=1>. Last accessed (21 August 2012).

management problem is worth an additional effort—some of the smallest biogas units could be useful

- For distributed scale renewables, **adopt external certifications for installers** of solar water heaters, solar PV, and other renewable energy systems and technologies, to solve any information asymmetry between installers and customers. The purpose of a certification is to provide information giving customers confidence that they are dealing with properly trained, skilled, and competent professionals. Anyone with the necessary skills and competencies would be able to get certified. The Government may recognize one or more certifications that it considers appropriate, to encourage customers to use certified professionals. This would help minimize problems of safety and performance of renewable energy systems. For guidance, Anguilla could consider the National Occupational Standards in place in Great Britain³¹, and the National Vocational Qualification for Solar Water Heaters that the Technical and Vocational Education and Training (TVET) Council of Barbados³² is preparing.

³¹ National Occupational Standards. <http://nos.ukces.org.uk/Pages/index.aspx>. Last accessed (21 August 2012).

³² Technical and Vocational Education and Training (TVET) Council of Barbados. <http://www.tvetcouncil.com.bb/>. Last accessed (21 August 2012).

8 Roadmap for Renewable Energy Integration in Anguilla


Figure 8.1 shows a Roadmap for implementing the recommendations contained in the previous section. The Roadmap suggests a primary entity responsible for carrying out each action (as well as other entities involved). It also indicates the critical path for implementing our recommendations divided into four areas: completing the legal and regulatory framework (8.1), implementing utility scale renewables (8.2), implementing distributed scale renewables (8.3), and carrying out ancillary activities (8.4). The Roadmap outlines the steps and the proposed timeline to implement the recommendations. However, the actual timeframe needed to implement these steps may vary compared to what is presented in the Roadmap.

8.1 Complete Legal and Regulatory Framework for Renewable Energy

After completion of our assignment, the priority is to ensure that Anguilla's relevant rules are appropriately amended. The first three actions should be done by the end of 2012

1. **Mandate solar water heating for new facilities**—MICUH should be in charge of leading the amendment of the Building Regulations. It should collaborate with the Building Board, ANGLEC, and the Electrical Inspector's Office, and secure drafting and legal support from the Attorney General's Chambers. The Minister of Energy would then submit the Amendment Regulations to EXCO with the necessary EXCO Memorandum for approval
2. **Amend the Electricity Act with licence exemption for distributed renewables**—MICUH should be in charge of leading the amendment of the Electricity Act with drafting and legal support from the Attorney General's Chambers. The Minister of Energy would then submit the Amendment Act to EXCO with the necessary EXCO Memorandum for approval. Once approved he would table it in the House of Assembly to be passed and then assented to by the Governor. Recommended changes would be minimal; therefore, this action could also be implemented by end-2012 (contingent on the frequency of meetings of EXCO and the House of Assembly, and the priority given to this Act in the legislative agenda)
3. **Amend Licence and Electricity Supply Regulations with Rules for Renewable Energy and Tariff Setting Principles**—MICUH should be responsible for leading these actions. The Governor could lawfully and effectively amend ANGLEC's licence but, to avoid liability for breach of contract, it would be preferable if the amendment were by agreement between the Governor and ANGLEC. MICUH would need to lead the process of amending the Electricity Supply Regulations to include the Rules for Renewable Energy and tariff setting principles, with legal support from the Attorney General. The Minister of Energy would then submit the revised legislation to EXCO for approval. The proposed language is already being reviewed by the Government and ANGLEC as part of our assignment.

Figure 8.1: Roadmap for Renewable Energy Integration in Anguilla

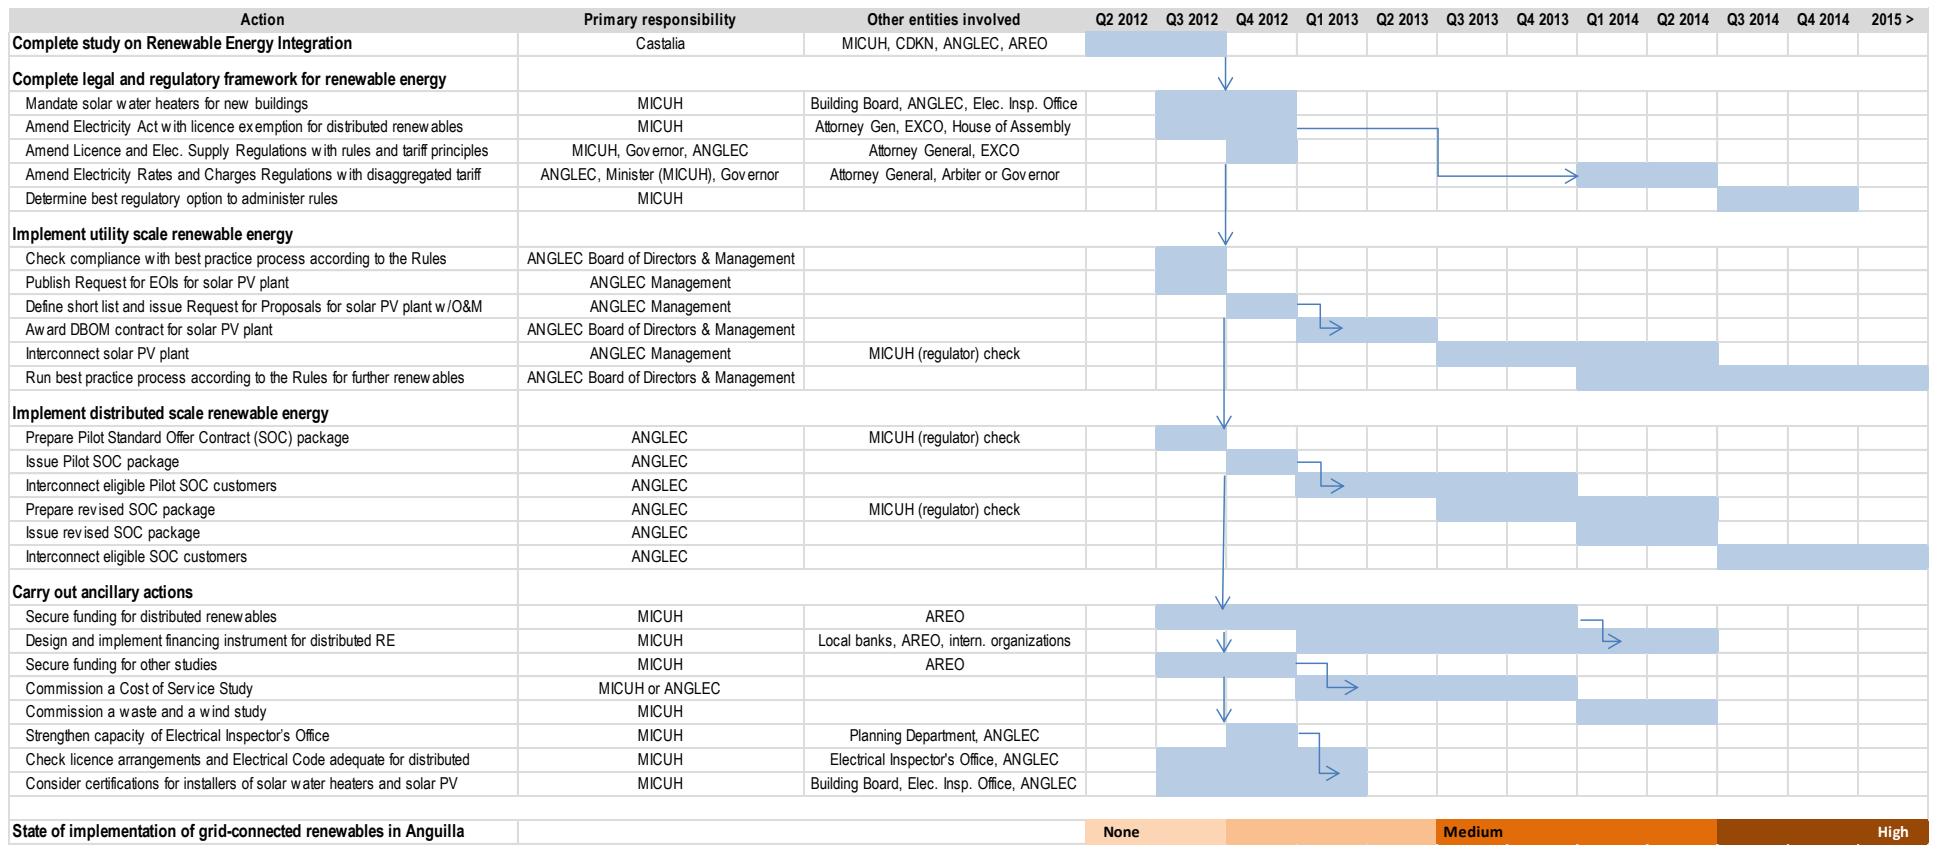

The remaining two actions should be done in the medium term:

1. **Amend the Electricity (Rates and Charges) Regulations with disaggregated tariff**—ANGLEC should be responsible for proposing a disaggregated tariff (supported by consultants for previously carrying out a cost of service and tariff study—see below), and then submitting the proposal to the Minister of Energy for approval through the normal rate adjustment process. If the rate adjustment request published by ANGLEC were not approved by the Minister within 30 days of notification, the decision would be made by an Arbitrator or the Governor. Afterwards, the Governor would issue new Electricity (Rates and Charges) Regulations, with drafting support from the Attorney General’s Chambers, corresponding to the adjusted rates. ANGLEC could initiate this process at the beginning of 2014 once a Cost of Service Study with a disaggregated tariff proposal is completed, and the Governor could issue the new regulations by the second quarter of 2014
2. **Determine best regulatory option to administer rules**—MICUH should determine how to administer the renewable energy integration legislation (as part of its broader power sector reform program). MICUH could do this in 2014.

8.2 Implement Utility Scale Renewable Energy

The other side to completing the formal rules is making sure that they are being implemented. On the utility scale side, this would mean to:

1. **Check compliance with best practice process according to the Rules for Renewable Energy**—to draft the RFP for a solar PV plant, ANGLEC must have already developed a demand forecast, assessed least cost generation options and identified solar PV as a viable one, and decided how to implement it on a design-build basis. As part of this assignment, ANGLEC has also participated in a public consultation, and may refine the procurement method to a DBOM contract. This means that everything should be in place for ANGLEC to already be in compliance with the Rules for Renewable Energy for the solar PV tender, once it adopts them. However, carefully considering the Rules for Renewable Energy and matching a specific item or document to each step of the best practice process would be a useful exercise if ANGLEC wants to recover these renewable energy costs
2. **Publish Request for EOIs for solar PV plant**—ANGLEC management should be responsible for publishing a request for EOIs. This may be done immediately to increase competition for the solar PV plant, and completed by the third quarter of 2012—indeed, ANGLEC has done so already
3. **Define short list and issue Request for Proposals for solar PV plant w/O&M**—ANGLEC management should be responsible for this after the Board has checked to make sure the best practice process

is being followed. ANGLEC could complete this action by the last quarter of 2012

4. **Award DBOM contract for solar PV plant**—the Board would be responsible for awarding the DBOM contract, based on the evaluation of bids and award recommendation from ANGLEC’s management. The award could be made by the first semester of 2013
5. **Interconnect solar PV plant**—ANGLEC management would be responsible for interconnection, once the solar PV plant complies with its interconnection rules, and compliance with these standards is verified by MICUH (the Regulator). This action could be implemented by the first half of 2014
6. **Run best practice process according to Rules for Renewable Energy for further renewables**—this action would come at a later stage, once more utility scale renewable energy capacity is needed, and then be repeated as necessary. The Board and ANGLEC management would be responsible for continuing to follow the Rules for Renewable Energy on an ongoing basis if ANGLEC wants to recover these costs through tariffs.

8.3 Implement Distributed Scale Renewable Energy

At distributed scale, actions for the short term would be the following:

1. **Prepare Pilot Standard Offer Contract (SOC) package**—ANGLEC would design this pilot SOC during the third quarter of 2012. To prepare the SOC, ANGLEC should:
 - a. Identify the technically and economically viable cap
 - b. Create a grid and distributed generation code
 - c. Set the rate at which ANGLEC would buy excess power
 - d. Set the term of the SOC
 - e. Develop a pilot disaggregated tariff (ANGLEC would first develop a standard pilot disaggregated tariff for all customers. Each customer would agree on the standard pilot tariff in writing when entering into a pilot SOC with ANGLEC. ANGLEC would notify the Governor of the amended tariff (pilot tariff) and publish it in the Gazette).
2. **Issue Pilot SOC package**—ANGLEC should issue the pilot SOC package after it has completed all of the steps above, ideally by the end of 2012
3. **Interconnect eligible Pilot SOC customers**—after signing a SOC with the eligible customers, ANGLEC would be responsible for interconnecting them. Interconnection under the pilot SOC could be carried out starting in 2013.

In the medium term, the Pilot should become a full-fledged SOC program through the following actions:

1. **Prepare revised SOC package**—improving it based on the experience with the pilot. ANGLEC could revise SOC from the second half of 2013 until the first half of 2014
2. **Issue revised SOC package**—ANGLEC would issue the revised SOC by the end of the first half of 2014
3. **Interconnect eligible SOC customers**—ANGLEC could begin interconnecting customers under the revised SOC beginning the second half of 2014 until the total RE interconnection cap is reached. This cap can be increased in the future once ANGLEC is able to handle additional renewable energy.

8.4 Carry Out Ancillary Actions

Finally, the Roadmap shows a number of ancillary actions that would need to be carried out to ensure successful implementation of renewables in Anguilla:

1. **Secure funding for distributed renewables**—MICUH should be responsible for this, with AREO’s help. MICUH can begin exploring options for funding as soon as our final report is submitted, using it as a tool
2. **Design and implement financing instrument for distributed RE**—MICUH should be responsible for this action, with assistance from local banks, AREO, and international organizations. MICUH could work on this throughout 2013, and the first half of 2014
3. **Secure funding for other studies**—MICUH should be in charge of this, with support from AREO. MICUH could start by targeting funding sources such as the UK Government, the Climate and Development Knowledge Network, the Overseas Territories Environmental Programme, the Caribbean Community, the Caribbean Development Bank, and the Clinton Foundation. MICUH should work to secure additional funds for the remainder of 2012
4. **Commission a Cost of Service Study**—MICUH or ANGLEC (or both parties in partnership) would hire international experts to carry out this study once additional funding is obtained. The study could then be carried out during 2013, and should also include a proposed new disaggregated tariff structure and schedule based on the cost of service assessed
5. **Commission a waste and a wind study**—MICUH could contract experts to perform a waste and a wind resource study that can be carried out during the first half of 2014
6. **Strengthen the capacity of Electrical Inspector’s Office**—MICUH would be in charge of this, but support would be provided by the Planning Department in Ministry of Home Affairs, and ANGLEC. This capacity building could be done by the end of this year, prior to ANGLEC rolling out the pilot SOC

7. **Check that any licence arrangements and the Electrical Code related to electrical wiring and installation are adequate for distributed renewables**—MICUH would be responsible for this, with assistance from the Electrical Inspector's Office, and ANGLEC. This action should be completed by the first quarter of 2013
8. **Adopt certifications for installers of solar water heaters, solar PV, and other renewable systems and technologies**—MICUH would make this decision, with advice from the Electrical Inspector's Office, Building Board, and ANGLEC. MICUH may also choose to first consult with installers in Anguilla. This decision could be made by the first quarter of 2013. MICUH in conjunction with the Electrical Inspector's Office would determine who the certification body, or bodies, would be.


The Government, in particular MICUH, would be responsible for supervising the implementation of this Roadmap and also for implementing many of the measures. MICUH would welcome additional financial and technical support from the UK Government, CDKN, or other entities to help it to implement this Roadmap for achieving renewable energy integration in Anguilla.

Appendix A: Institutional Outline of the Power Sector

The main actors in Anguilla’s power sector are: (i) the Government, which sets policy, regulates the sector, and owns the majority of the Anguilla Electricity Company Limited (ANGLEC); (ii) ANGLEC itself, the vertically integrated public electricity supplier that produces, transmits, and distributes electricity; and finally (iii) non-profit organizations that promote the transition to renewable energy supply.

Figure A.1 shows the actors in Anguilla’s power sector. We describe each of them below.

Figure A.1: Power Sector Governance in Anguilla

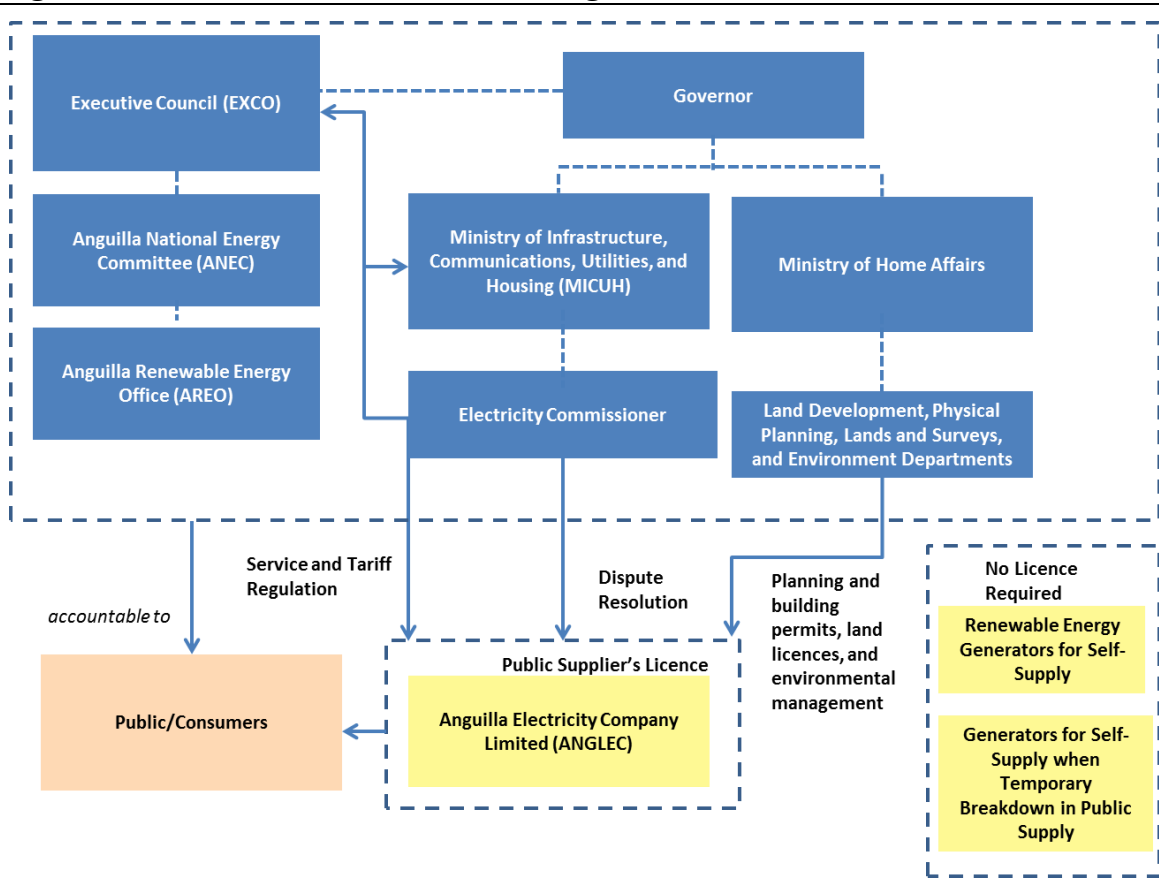

A.1 Government entities

The **Governor** is the representative of the Queen and the Constitutional Head of State in Anguilla. The constitution gives the Governor certain responsibilities, including oversight for external affairs, defense, internal security, and international financial services or any directly related aspect of finance. He is also the presiding officer of the Executive Council (see below).³³ The Governor is responsible for all public and civil service in Anguilla. The Electricity Act, R.S.A. c. E35 gives the Governor the powers to: grant, renew, and revoke all

³³ HM Governor’s Office. <http://anguilla.fco.gov.uk/en/about-us> (last accessed April 5, 2012).

licences for electricity provision; take action to acquire land for public electricity supply under the Land Acquisition Act; grant tax exemptions for public suppliers of electricity; impose an environmental levy;³⁴ appoint the Electricity Commissioner and the Government Electrical Inspector; direct the Electricity Commissioner and require the Electricity Commissioner to request information from the public supplier that it may reasonably require; direct the Electricity Commissioner or other appointed person to assume control of and exercise of the public supplier's licence if the public supplier is failing; and make regulations under the Electricity Supply Act to make it effective.³⁵

The **Executive Council (EXCO)** is a body consisting of the Governor, who presides it; the Deputy Governor; four ministers of the Crown—the Chief Minister and three line Ministers (currently the Minister of Infrastructure, the Minister of Home Affairs, and the Minister of Social Development); and the Attorney General.

It is important to note that EXCO deliberates on policy documents, laws, and regulation based on the principle of collective responsibility—the relevant Minister tables a matter, and EXCO deliberates by consensus.³⁶ EXCO is responsible for:

- Formally approving Cabinet decisions, adopting policy directives from the Governor, and adopting Government policies (for example, it adopted the National Energy Policy; if it is to become effective, it will have to adopt the National Climate Change Policy)
- Approving Bills before they go to the House of Assembly for final approval
- Approving Regulations, which do not have to go to the House of Assembly for final approval
- Approving electricity rates and rate adjustments.

The **Ministry of Infrastructure, Communications, Utilities and Housing (MICUH)** is responsible for energy. MICUH is in charge of setting energy policy, regulating the electricity sector, and implementing the Government's policy objectives. The Minister responsible for energy is in charge of tabling electricity Bills and Regulations with EXCO.

The **Electricity Commissioner** ('the Commissioner') is appointed by the Governor; none is currently appointed. The Commissioner is situated within MICUH, but reports to the Governor. The Commissioner plays an ombudsman role, responsible for settling disputes between the public supplier of electricity and customers. The Commissioner is in charge of requesting and collecting information from the public supplier of electricity on accidents, assuming control of and exercising the public supplier's licence if directed to do so by the Governor (if the public supplier is failing), consenting to the public supplier of electricity's connection of circuits, easements, and being informed about compensation for losses or damage resulting from works carried out by public supplier when laying lines across land or

³⁴ Electricity Act, s.32(2): 'the Governor may, by regulation, impose an environment levy based on a percentage of the total income from electricity supplied by a public supplier or on such other basis as he may determine'.

³⁵ Electricity Act. December, 2004.

³⁶ Guide to the Operation of the Executive Council. 2002. Section 3.

roads. The Commissioner can also set maximum rates in his sole discretion at which electricity supplied by a public supplier (ANGLEC) may be resold by persons to whom the electricity is supplied (consumers). However, the Governor approves normal electricity rates through regulations, and rate adjustments are approved by the Minister responsible for energy.

The **Ministry of Home Affairs** is responsible for lands, physical planning, and environment policy and regulation in Anguilla. Within the Ministry of Home Affairs,

- The **Land Development Control Committee (LDCC)** is responsible for reviewing and approving applications for new development (including utility scale renewable energy projects) on land, and issuing planning permits
- The **Department of Physical Planning, Department of Lands and Surveys** is responsible for managing the registered lands system, and reviewing and approving land licence applications
- The **Department of Environment** is responsible for preparing environment policy (such as the Climate Change Policy) and environmental legislation (such as the draft Environmental Protection Bill); and for carrying out national environmental management.

The majority of the planning and permitting processes for large renewable energy projects fall under the Ministry of Home Affairs.

For smaller renewable energy projects, the **Ministry of Works** is responsible for monitoring and enforcing building policies in accordance with a draft Building Code. The Ministry's building board provides the necessary building permits. Distributed scale renewable energy systems, unless they are large enough to classify as a development project (see section E.4), would not need to submit an application or apply for any of these licences or permits.

A.2 Electricity service providers

The **Anguilla Electricity Company Limited (ANGLEC)** is an investor-owned electric utility with an exclusive public supplier's licence to produce, transmit, and distribute electricity in Anguilla for fifty years, ending in 2041. The Government and Government Social Security have a majority shareholding (a combined 56 percent of ANGLEC's shares); the remaining 44 percent is held by the National Bank of Anguilla, the Caribbean Commercial Banks, other local companies, and the general public.

ANGLEC's total number of customers is 7,250 as of April 2012,³⁷ which accounts for nearly 100 percent of total demand (with the exception of a few distributed renewable energy systems). An average domestic customer consumes about 300 kWh/month, and total average customer consumption is 850 kWh/month (domestic and commercial customers).

Total revenues for 2010 increased to EC\$69.23 million (US\$25.6 million), a 10.7% increase over the previous year due to growth in demand and the opening of a new resort on the island. Gross operating profit decreased by 32.1% to EC\$11.29 million (US\$4.18 million) in 2010, and Net Profit for the year was EC\$5.98 million (US\$2.21 million), a 42.7% decrease

³⁷ Conversation with ANGLEC management, 22 April 2012.

in profits due mainly to the higher absorption of fuel costs by ANGLEC in 2010. Long-term liabilities were EC\$29.6 million (US\$10.96 million) (borrowings and contributions for construction), and current liabilities were EC\$10.4 million (US\$3.85 million) (borrowings were EC\$4 million (US\$1.48 million) of this amount)³⁸.

No one holds a private supplier's licence in Anguilla. However, there are some customers who generate electricity using renewable energy for self-supply, and that generate electricity with backup diesel generators for their own consumption when the national electricity system is down (no licence is required for these activities, as explained in section E.1.1).

A.3 Non-profit organizations

The **Anguilla National Energy Committee (ANEC)** is a volunteer organization that comprises a diverse group of professionals that are working together to advance Anguilla's climate change and environmental sustainability agenda. ANEC's members are: a representative from MICUH, ANGLEC's General Manager, a representative of the Anguilla Renewable Energy Office, the Director of the Department of Environment, a former Permanent Secretary for Economic Development, the Chief Financial Officer of the National Bank, builders, renewable energy system owners, and the Anguilla National Trust (which provides administrative and office support). ANEC drafted Anguilla's National Energy Policy, held the public consultations on the Energy Policy, and brought it to EXCO for its consideration (see section D.1).

The **Anguilla Renewable Energy Office (AREO)** is the active arm of ANEC. AREO is a Non-Governmental Organization (NGO) that was part of the consultative group that contributed to and reviewed Anguilla's draft Climate Change Policy (see section D.2). AREO was founded in 2008 to promote a transition to renewable energy on Anguilla. AREO works with both public and private entities involved in the energy sector. It also works with donors and funding organizations to support renewable energy development in Anguilla. In addition, AREO does public outreach and facilitates stakeholder consultations.

³⁸ ANGLEC. "ANGLEC: Giving Power to the People". Annual Report 2010.

Appendix B: Electricity Demand and Supply in Anguilla

In this appendix we analyze electricity demand (section B.1) and supply (section B.2) in Anguilla.


B.1 Electricity Demand in Anguilla

Below we analyze peak demand in ANGLEC's service area, ANGLEC's load factor, and ANGLEC's electricity sales.

B.1.1 Peak Demand

Demand for power has grown consistently since 2003. As shown in Figure B.1 below, peak demand for electricity was 15.3MW in December 2010, compared to 14.9MW for the same period in 2009.³⁹ This increase is due to demand growth throughout all sectors, and the opening of a major resort in Anguilla at the end of 2009. Average historical growth in peak demand was 7 percent from 2001 to 2010. ANGLEC's load forecast for the period December 2011 through December 2015 expects that peak demand will increase on average by 5 percent per year, from about 16.6MW in 2011 to 19.8MW at the end of 2015,⁴⁰ as shown in the figure.

Figure B.1: ANGLEC Peak Demand (2006-2010)

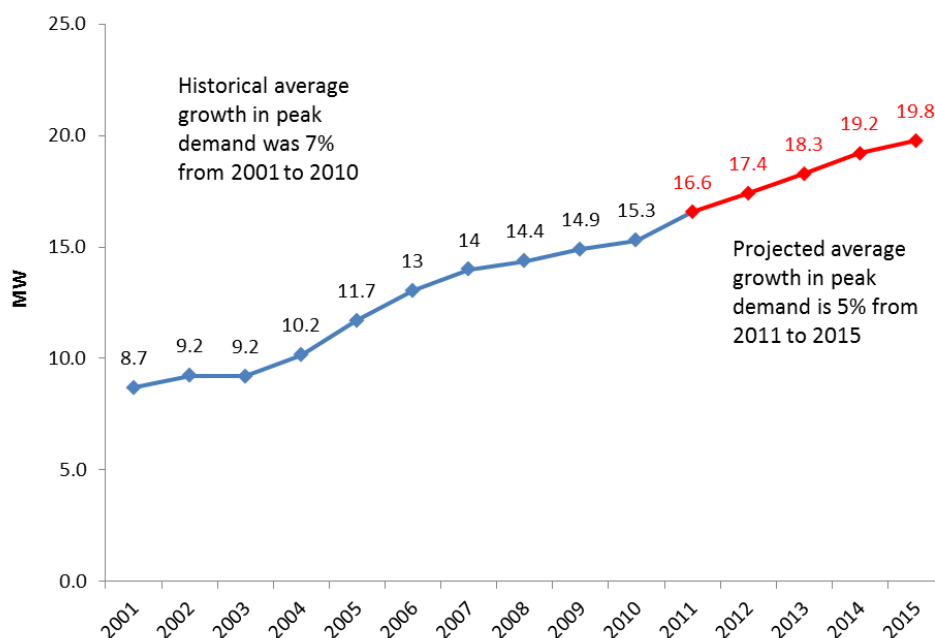

Source: Based on ANGLEC's Annual Reports for 2010, 2006, and 2005

³⁹ Anguilla Electricity Company Limited. "Anglec: Giving Power to the People." Annual Report 2010.

⁴⁰ Anguilla Electricity Company Limited. "2013 Corito Power Station Expansion Justification". 2011. As many utilities commonly do, ANGLEC carries out demand forecasts and expansion plans every five years. Demand trends post-2015 are uncertain, but is likely to be mostly driven by the tourism economy (even one additional hotel has a large effect on demand for a country like Anguilla).

Given the current economic situation, ANGLEC is considering reducing its peak demand growth projection down to 1 percent per year for the next five years. In that case, ANGLEC expects that it could extend the commercial operation of existing plant, or use new utility and distributed scale renewable energy to meet demand. However, with Anguilla’s small electricity system, one new commercial project (such as another large hotel) can easily change the load forecast.

B.1.2 Load factor

The system load factor—defined as the ratio of the average load to peak load during a specified time interval, typically a year—was approximately 92 percent in 2010. From 2000 to 2010 the average load factor was 90 percent, which means that the majority of the time the company operated at 10 percent below the yearly peak.⁴¹ A higher system load factor indicates a steadier load, with less need for generation capacity per unit of power consumed. Anguilla’s high load factor ranks well in comparison to other similar countries in the Caribbean, which had load factors below 80 percent in 2009.


The load factor could be improved even more by encouraging customers to shift their electricity consumption from peak time to off-peak time. By successfully displacing more demand to off-peak times, generation costs as well as customer bills could decrease. This could be done through more demand-reflective tariffs that charge people more for consuming at peak compared to off-peak times, and through awareness campaigns.

B.1.3 Electricity Sales

Figure B.2 shows the trends in total annual electricity sales from 2001 to 2010. During this period, total electricity sales grew steadily at an average 8 percent per year, from about 46GWh in 2001 to 87GWh in 2010, fueled by economic growth across all sectors and the boost in the tourism industry during that period.

⁴¹ Roach, Mariscia S. “Anglec’s Load Forecast 2012-2010.” Anguilla Electricity Company Limited, 2011.

Figure B.2: ANGLEC Total Electricity Sales (2001-2010)

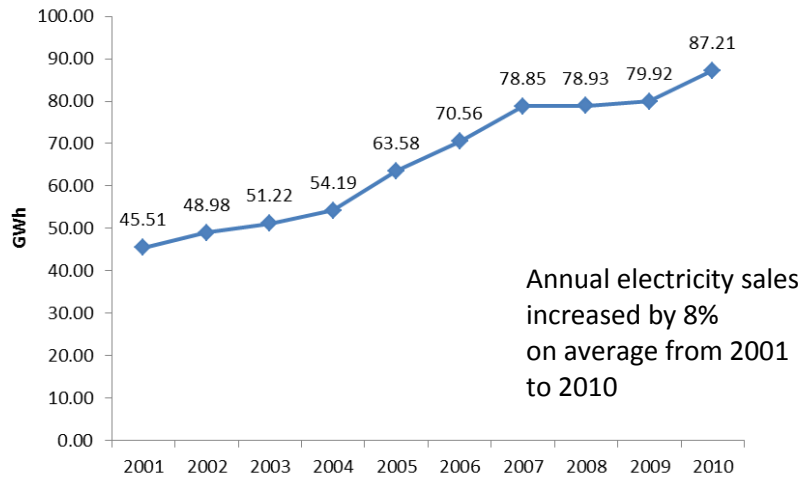

Source: Based on Roach, Mariscia S. “Anglec’s Load Forecast 2012-2010.” Anguilla Electricity Company Limited, 2011.

B.2 Electricity Supply in Anguilla

Below we review ANGLEC’s plant mix, reserve capacity margin, expansion planning, electricity generation costs, fuel efficiency, constraints and opportunities for fuel supply, and system losses.

B.2.1 Plant Mix

ANGLEC generates electricity running medium speed and high speed diesel units. It has eleven generators manufactured by Caterpillar, Mirrlees, and Wartsila. All units run on diesel No. 2 fuel.⁴² The table below gives basic information about ANGLEC’s generating units.

In the past, ANGLEC’s generating capacity included both high and medium speed diesel generators, with a large portion of its generation coming from less efficient high speed diesel units. In recent years, however, the commissioning of additional medium speed units, including the 2008 commissioning of a new Wartsila 5.1MW medium speed diesel generator has effectively allowed putting the two remaining high speed units in reserve 98 percent of the time. Total installed capacity in 2010 was 33.1MW. As of 2012, ANGLEC has 9 medium speed generators in operation; and two high speed units that remain on standby as backup capacity.⁴³

⁴² Information provided by ANGLEC Management, January 15, 2012.

⁴³ Information provided by ANGLEC Management, January 15, 2012

Table B.1: ANGLEC Generating Units in Service


Generating Unit	Type	Installed Capacity (MW)	Commercial Operation Date	Expected Retirement Date
0	High speed	1.6	2006	2021
2	Medium speed	1.4	1986	2014
3	Medium speed	1.4	1987	2015
6	High speed	1.2	1999	2016
4	Medium speed	3.8	1988	2016
10	Medium speed	3.8	1998	2018
11	Medium speed	3.8	2000	2020
12	Medium speed	3.1	2000	2020
13	Medium Speed	3.9	2005	2025
14	Medium speed	3.9	2005	2025
15	Medium speed	5.1	2008	2028

Source: ANGLEC Expansion Strategy and discussions with ANGLEC Management

B.2.2 Reserve capacity margin

Generation capacity is built to meet peak demand, plus a reserve margin. A standard measure of the ability of generation capacity to meet peak demand is the reserve capacity margin. The reserve capacity margin is calculated as the difference between generation capacity less peak demand, divided by generation capacity. A reserve capacity margin of zero means the country's generating capacity is exactly equal to the country's peak demand. Most electricity systems target a reserve capacity margin of at least 15 percent to ensure that the system can withstand unplanned outages during periods of peak demand—although in island countries they are typically higher due to these systems' isolation, need to mitigate risks from extreme weather events (for example, hurricanes), and small size. In addition, in a very small island system, the addition of one new generator can boost the reserve capacity margin significantly.

Figure B.3: ANGLEC’s Reserve Margin Compared to Other Caribbean Utilities (2010)

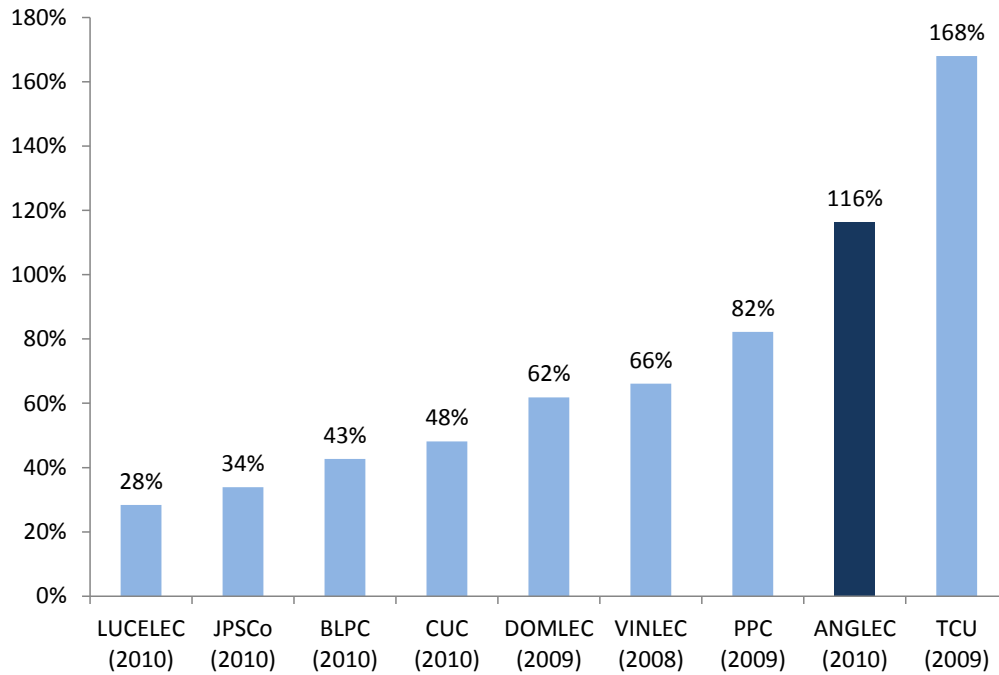

Source: Utilities’ Annual Reports, 2010

At the end of 2010, ANGLEC had a reserve capacity margin of 116 percent, well above that of most other Caribbean countries as shown in Figure B.3. Peak demand that year was 15.3MW, significantly below the generating capacity of 33.1MW. Even excluding high speed diesel units, ANGLEC’s reserve capacity margin would stand at about 98 percent.⁴⁴

ANGLEC uses a N-2 standard for its reserve capacity margin (that is, requiring backup capacity for the two largest generating units on the system) plus an additional 15 percent capacity in the event that the remaining generators are functioning poorly.⁴⁵ The equation below illustrates the way that ANGLEC calculates its required reserve capacity:

$$\begin{aligned}
 \text{Required Reserve Capacity} = & \text{Capacity of Largest Generator} \\
 & + \text{Capacity of Second Largest Generator} \\
 & + .15(\text{Capacity of Remaining Generators})
 \end{aligned}$$

For ANGLEC, N-2 security would require 9MW of reserve capacity. Adding 15 percent to account for potential poor functioning of remaining generators, ANGLEC’s target reserve capacity would require 12.6MW. The current 14.8MW of reserve capacity is above target reserve capacity—although ANGLEC estimates that with projected peak demand growth and the need to retire units #2 and # 3 in the medium term (2012-2015)—which have a combined capacity of 2.8MW—it may soon fall below its target reserve capacity margin.⁴⁶

⁴⁴ Information provided by ANGLEC Management, January-March 2012.

⁴⁵ ANGLEC. “2013 Corito Power Station Expansion Justification.” 2009

⁴⁶ ANGLEC. “2013 Corito Power Station Expansion Justification.” 2009

B.2.3 Expansion Planning

At current demand growth rates, the reserve capacity margin will require additional generating capacity to accommodate consumption growth in ANGLEC's service area for the next five years, as well as continued decommissioning of the two older units. For this reason, ANGLEC's expansion plan calls for to add one additional Wartsila 5.1MW medium speed diesel unit. This will provide ANGLEC with significant excess capacity. ANGLEC, however, continues to revise its demand forecasts, considering the effects of the economic downturn and the potential of adding renewable energy capacity instead of firm capacity.⁴⁷

Each year ANGLEC prepares a five year load forecast based on planning, economic, and financial data. ANGLEC prepares its expansion plan, based on its load forecast, and installs new capacity as needed before large development projects come online. To determine if it has enough capacity, ANGLEC evaluates whether or not its firm capacity may meet its target reserve capacity under the load forecast. When the firm capacity does not provide enough capacity to meet demand with sufficient reserve capacity, ANGLEC invests in new plants. The timeframe for getting a new unit to commercial operation can be up to two and a half years given the planning and approval process, and construction time.

In addition, ANGLEC has stated that its acquisition of the Wartsila unit will improve efficiency (these units' heat rate—energy consumed per kilowatt hour produced—is better than the other units that ANGLEC operates) and allow it to meet increasing demand. This suggests that the utility will consider replacing older units with more cost-effective generation to improve efficiency—in addition to when meeting the target reserve capacity margin calls for it—provided it sees the right incentive for doing so.⁴⁸

ANGLEC does not need ministry approval to add capacity, just internal approval by its Board.

B.2.4 Electricity Generation Costs


ANGLEC's generation operating costs (defined as the sum of all fuel and generation-related operating expenditures, divided by gross generation) are relatively high. Figure B.4 compares ANGLEC's generation operating cost against those of other Caribbean utilities. High generation operating costs are common in the Caribbean due to the small size of generating units (which limits the efficiency compared to larger units) and high cost of imported fuel (often made even higher by relatively uncompetitive fuel procurement).⁴⁹ ANGLEC's generation operating costs are higher than those in Barbados, Grenada, Dominica, the Cayman Islands, or Saint Lucia. As we recommend in section 7.2.1, commissioning a cost of service study would allow identifying ways to reduce generation operating costs.

⁴⁷ Information provided by ANGLEC Management, January-March 2012

⁴⁸ ANGLEC. "2013 Corito Power Station Expansion Justification." 2009

⁴⁹ Information provided by ANGLEC Management, January-March 2012. Improving fuel procurement is outside the scope of this assignment, but ways to do so could be identified by a cost of service study.


Figure B.4: ANGLEC’s Generation Operating Cost compared to other Caribbean Utilities (2010)

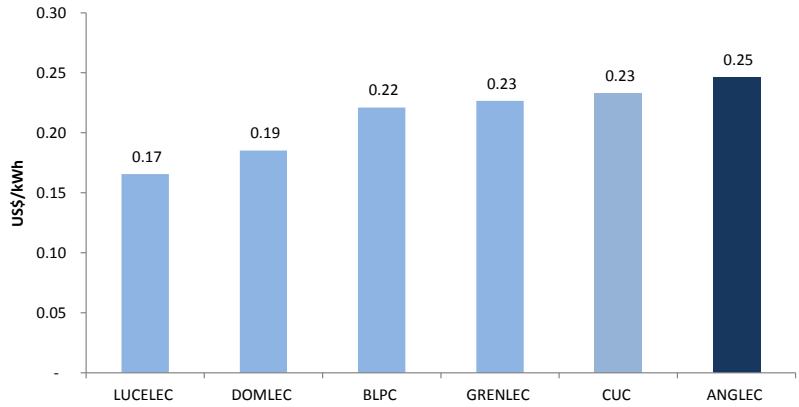

Source: Utilities’ Annual Reports, 2010

Figure B.5 shows the correlation between the average price of fuel paid by ANGLEC compared to the average price of West Texas Intermediate (WTI) crude oil.

Figure B.5: ANGLEC’s Average Price of Fuel (US\$/IG) and WTI Crude (US\$/bbl)

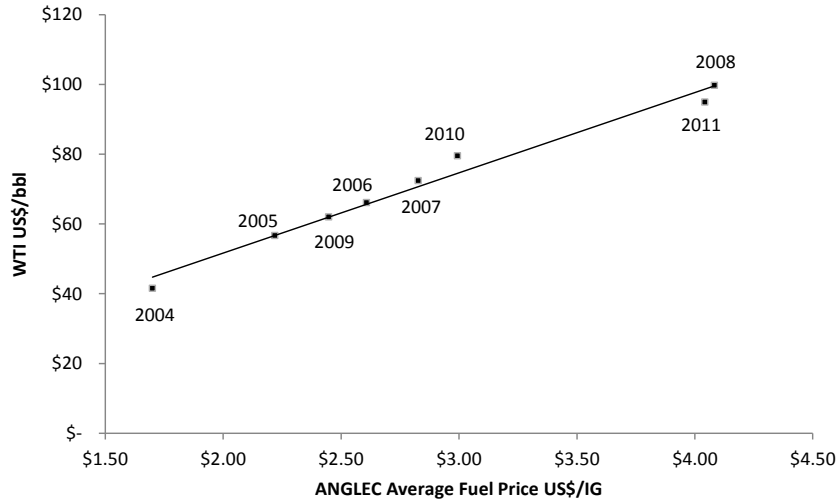

Source: ANGLEC Annual Reports, information from ANGLEC Management, CME Group

In 2008—the most recent year where WTI crude oil averaged US\$100 per barrel⁵⁰—ANGLEC paid an average of about US\$4 per imperial gallon (IG) for diesel.⁵¹ In 2010, ANGLEC’s average fuel price was about US\$3 per IG, and WTI averaged about US\$80 per

⁵⁰ U.S. West Texas Intermediate and Gulf Coast No 2 Diesel Low Sulfur Spot Price FOB, US Energy Information Administration, *Spot Prices for Crude Oil and Petroleum Products*, http://www.eia.doe.gov/dnav/pet/pet_pri_spt_s1_d.htm


⁵¹ The price is derived from dividing ANGLEC’s fuel cost for the year by the number of gallons that it used in its operations in that year

barrel. In 2011, ANGLEC’s average fuel price was about US\$4 per IG, with WTI average at about US\$95 per barrel.⁵²

B.2.5 Fuel efficiency

Figure B.6 compares fuel efficiency—gross kWh generated per IG of fuel consumed, considering diesel plants only—across various Caribbean countries. ANGLEC’s relative efficiency is shown by its middle ranking even when compared to some larger systems such as Saint Lucia (76MW installed capacity, 56MW peak demand). To ensure an accurate comparison, Dominica’s figures are based only on its diesel plants, excluding hydro-based generation.

Figure B.6: ANGLEC’s Fuel Efficiency compared to other Caribbean Utilities (2010)

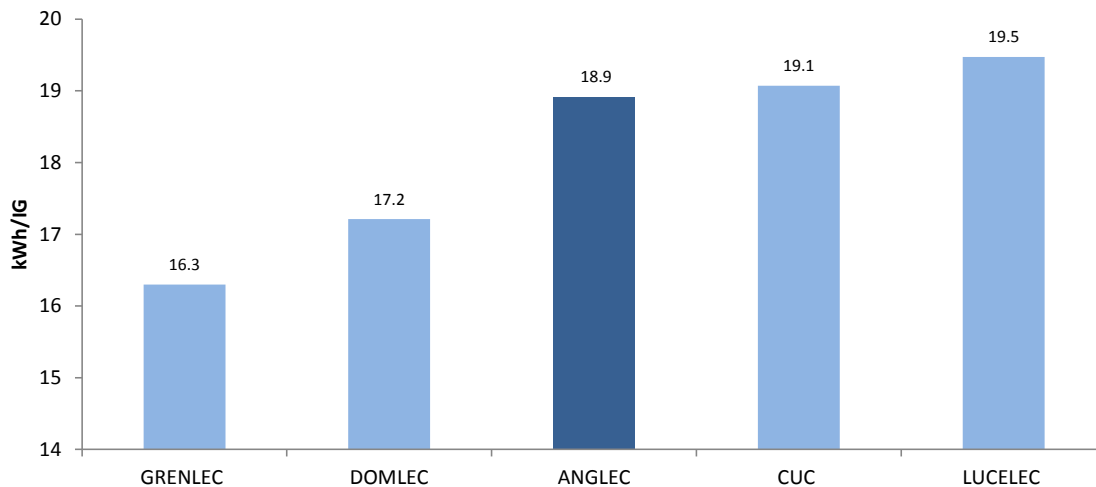

Source: Source: Utilities’ Annual Reports, 2010 (diesel-based generation only considered)

B.2.6 Opportunities and constraints for fuel supply

Fuel supply in Anguilla is characterized more by constraints than opportunities. Fuel is provided in small barges due to lack of deep seawater ports. This increases the frequency and costs of supply, and limits the competitiveness of procurement.⁵³ The use of cheaper fuels such as heavy fuel oil is limited by the size of the plants used for ANGLEC’s market (low speed diesel plants in Barbados, for example, are about 12.5MW each—245 percent larger than ANGLEC’s largest unit); the lighter diesel No. 2 remains the most convenient option for fossil fuel-based generation. Finally, Anguilla lies far from ongoing initiatives for increased energy integration in the Caribbean, such as the planned East Caribbean Gas Pipeline from Trinidad and Tobago.⁵⁴ A submarine connection to Nevis could be considered

⁵² U.S. West Texas Intermediate and Gulf Coast No 2 Diesel Low Sulfur Spot Price FOB, US Energy Information Administration, *Spot Prices for Crude Oil and Petroleum Products*, http://www.eia.doe.gov/dnav/pet/pet_pri_spt_s1_d.htm and http://www.eia.doe.gov/dnav/pet/hist/LeafHandler.ashx?n=PET&s=EER_EPD2DL_PF4_RGC_DPG&f=D

⁵³ Information provided by ANGLEC Management, January 15, 2012


⁵⁴ Unlike other OECS countries, Anguilla is not considered for the Eastern Caribbean Gas Pipeline by the latest publications available on the topic: World Bank, Energy Sector Management Assistance Programme (2006). *OECS Energy Issues and Options*; and World Bank (2010). *Caribbean Regional Electricity Generation, Interconnection, and Fuels Supply Strategy*.

assuming that sufficient geothermal capacity is developed on Nevis to be exported to countries other than St. Kitts, but geothermal development in Nevis has been much slower than expected.⁵⁵

B.2.7 System losses

System losses are equal to net energy generated minus energy consumed by customers—they account for losses of electricity during transmission and distribution, as well as theft and under-billing. Electricity systems in industrialized countries typically have system losses below 10 percent. ANGLEC’s system losses in 2010 (13 percent) were relatively high compared to those of other Caribbean utilities, as shown in Figure B.7. ANGLEC management estimates that current losses are about 12 percent (10 percent for transmission and distribution losses, and 2 percent for commercial losses). Again as recommended in section 7.2.1, a cost of service study could identify opportunities to reduce losses.

Figure B.7: ANGLEC’s System Losses compared to other Caribbean Utilities (2010)

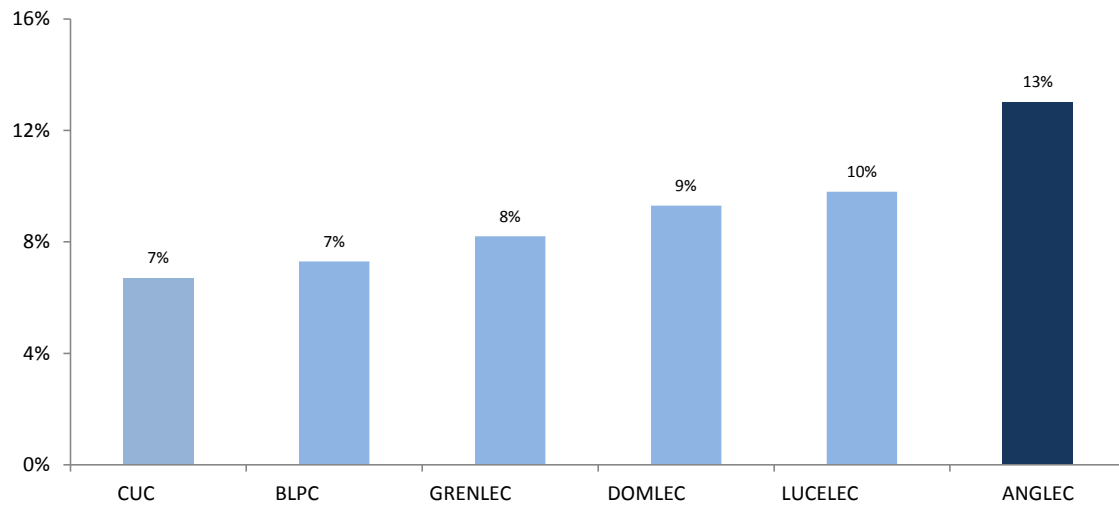

Source: Utilities’ Annual Reports, 2010

⁵⁵ This possibility is mentioned in the National Energy Policy, part II, page 14. As of today, however, geothermal development in Nevis has stalled—three slim holes were drilled in 2008 confirming good temperatures for a project of up to 35MW, but little progress has been made since (R. Bertani (2012). *Geothermal power generation in the world 2005-2010 update report*, in *Geothermics* 41 (2012) 1-29).

Appendix C: Electricity Tariffs in Anguilla

In this appendix, we review ANGLEC's tariff categories and components.

C.1 Tariff Categories

ANGLEC does not have specified tariff categories. In fact, its base rates are based only on monthly consumption level for residential and non-residential customers alike. However, in practice they roughly correspond to different customer segments:

- The first base rate equates to a 'lifeline tariff'⁵⁶ to ensure that the poorest in Anguilla can have access to a small amount of electricity. The first 40kWh are sold as a block for EC\$22. It is not possible to purchase an amount of electricity lower than 40kWh for a fraction of the price
- The second base rate applies mainly to residential and small commercial customers
- The third base rate applies to medium-large commercial operations with greater electricity needs (for example, hotels)
- The fourth base rate applies to ANGLEC's largest commercial customers (very large hotels, for example). There are no industrial customers.

C.2 Tariff Components

Tariffs charged by ANGLEC to its customers comprise a base rate per kWh, which includes a fixed portion of fuel costs; a fuel surcharge per kWh that depends on the cost per gallon of fuel oil; and an environmental levy.

- The **base rate** portion of the electricity tariff is intended to cover the operating expenses of the utility, and provide a return on assets for ANGLEC. It is set by the Government through regulation. According to ANGLEC's Electricity (Rates and Charges) Regulations, 2004 ANGLEC's base rates in Eastern Caribbean Dollars are as follows:

"Where consumption per month—

- does not exceed 40 units (kilowatt hours): US\$8.30*
 - exceeds 40 units but does not exceed 25,000 units (kilowatt hours): US\$0.24 cents per unit*
 - exceeds 25,000 units (kilowatt hours) but does not exceed 100,000 units (kilowatt hours): US\$0.23 cents per unit*
 - exceeds 100,000 units (kilowatt hours): US\$0.15 cents per unit, plus an additional fixed charge of US\$7,735."*
- The **fuel surcharge** portion of the electricity tariff is designed to recover expenses incurred by the utility due to variations in the cost of fuel with respect to the fixed reference of US\$1.35 per gallon. If and when the cost

⁵⁶ A pricing strategy designed to provide minimal amounts of electricity at low prices to households. Under a lifeline tariff, the first block of electricity used is provided for free or for a nominal price, with higher blocks carrying increasing prices.

per gallon of fuel imported differs from US\$1.35 per gallon, the fuel surcharge (positive or negative) is added to the base rate to adjust the overall rate. The fuel surcharge for ANGLEC’s service area is calculated by adding or subtracting US\$0.004 per unit for every US\$0.04 per gallon increase or decrease in the price of fuel oil over or below US\$1.35 per gallon


- The **environmental levy** is an additional seven percent (on the sum of the base rate and fuel surcharge) mandated by the Government to be used to pay for sanitation services unrelated to electricity. The levy is assessed to both the base rate and the fuel surcharge and then added to the total tariff.

In addition, the customer is charged a meter rental fee of EC\$1.88 per month.

C.3 Volatility of fuel surcharges based on the price of oil

Because all of ANGLEC’s generators operate on diesel fuel, the fuel surcharge portion of the tariff tracks the price of diesel No.2. This is illustrated in Figure C.1, which shows the direct correlation between the price of diesel No. 2 and the fuel surcharge in ANGLEC’s service area between 2007 and March 2012. The oil price spike of 2008 is well visible.

Figure C.1: Volatility of Fuel surcharge and Gulf Coast Prices of diesel No.2, 2007-2012

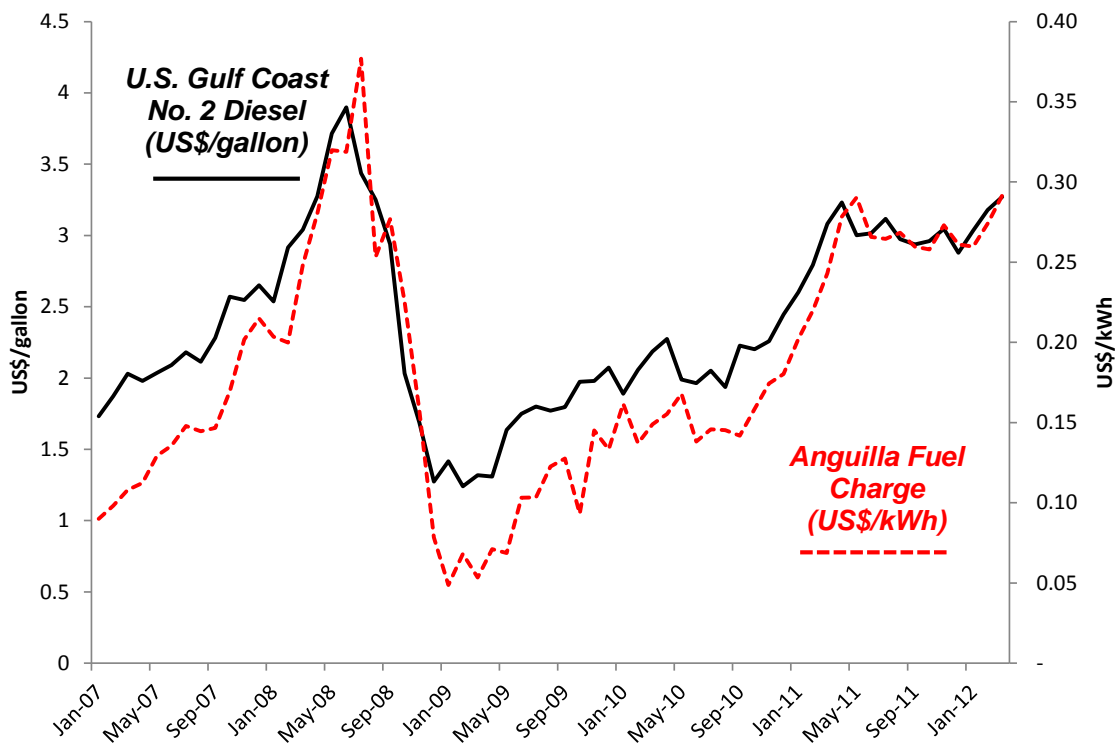

Source: ANGLEC (fuel surcharge) and US Energy Information Administration (diesel prices)

Appendix D: Analysis of Anguilla’s National Energy Policy and Draft Climate Change Policy

In this Appendix we analyze Anguilla’s National Energy Policy and draft Climate Change Policy, and the implications for electricity regulation.

D.1 National Energy Policy

ANEC drafted the National Energy Policy (NEP), and EXCO adopted it in December 2009.

The current administration has upheld the NEP adopted by the previous administration (for example, it is upholding the proposed tax incentives for renewable energy technologies), and is working on implementing it. However, the Government is considering updating and expanding, and re-tabling a revised version with EXCO.

Given the NEP’s primary focus is to provide reliable and quality supply of electricity at an equitable price, its first goal is to:

- 1. Ensure universal access to an affordable electricity supply for all Anguillans, particularly those below the poverty line for whom basic access is still in doubt.*⁵⁷

The NEP also includes sustainable energy policy goals to be achieved in the medium to long term, acknowledging that a transition to renewable energy will take time, and highlighting that this transition should be achieved “without compromising the reliability and quality of electricity supplies to customers of the Utility by over-accelerating the process of change.”⁵⁸

The NEP proposes a new mandate for assuring sustainability, which includes the following goals related to renewable energy:

- 2. Reduce dependence on fossil fuels for power generation and transportation.*
- 3. Use locally available renewable resources such as wind and solar power to the greatest extent possible to meet both existing and increasing demand for power generation.*
- 6. Support ANGLEC’s prudent and viable transition from primarily diesel-based to primarily renewably-based power generation.*
- 7. Create a legislative framework for customer-generated renewable power.*⁵⁹

Meeting these goals may require revising legislation and developing new rules that enable renewable energy integration. The Government recognizes this fact, and states as two of the key energy policy goals of the NEP:

- 1. Policies, legislation, regulations, standards and incentives that promote energy efficiency, foster the use of renewable energy resources, and facilitate the transition to and adoption of renewable energy technologies.*

⁵⁷ The Government of Anguilla. “The Anguilla National Energy Policy: 2010-2020.” Office of the Chief Minister, 2009.

⁵⁸ The Government of Anguilla. “The Anguilla National Energy Policy: 2010-2020.” Office of the Chief Minister, 2009.

⁵⁹ The Government of Anguilla. “The Anguilla National Energy Policy: 2010-2020.” Office of the Chief Minister, 2009.

*2. Integration of sustainable energy strategies into national sustainable development planning and programming.*⁶⁰

The NEP also includes a number of relevant policy recommendations, such as to identify the potential and viability of renewable energy in Anguilla, update legislation to encourage the utilization of renewable energy, mandate Environmental Impact Assessments (EIAs) for new energy projects (this would happen if the Bill for Environmental Protection, 2009 is passed and becomes an Act), implement appropriate pricing policies, and facilitate sustainable energy supply network by providing sufficient incentives to encourage private sector investments. The NEP also proposes further strategies for promoting renewables, such as providing tax incentives for the use of renewable energy technologies.

There are no specific targets for renewables in the NEP.

D.2 Draft Climate Change Policy

The Department of Environment of the Ministry of Home Affairs prepared the draft Climate Change Policy CCP based on a series of national consultations conducted from 2008 to 2010. This process was funded by DFID as part of the regional Enhancing Capacity for Adaptation to Climate Change in the Caribbean UK Overseas Territories (ECACC) Project. Anguilla's Climate Change Policy has not been adopted by EXCO.

The draft CPP complements and supports the NEP. The draft CCP's policy statement is to ensure that by filling policy, legislative, and institutional gaps, and cooperating between the Government and stakeholders, the country will be able to manage climate change impacts and transition to a climate resilient, energy efficient, and low carbon economy.⁶¹

The two policy goals that are relevant to renewable energy integration are:

8. Achieve energy independence and the ability of Anguilla to meet its vital energy needs with reliable, affordable and renewable energy resources, through the pursuit of a balanced and advantageous transition toward control of our energy future, built upon a solid and ever growing foundation of our own free, abundant, clean, and renewable energy resources - (the wind and the sun).

*10. Create a more competitive and environmentally responsible private sector by implementing "no regrets" measures that will protect the environment, promote low carbon energy efficient development while enhancing the resilience of natural ecosystems to climate change impacts.*⁶²

We would recommend that goal number 8 be rephrased as 'achieve *greater* energy independence' or 'pursue energy security'. Using renewables may improve energy security, since it may increase reliability and resilience. A better diversified portfolio benefits the country by increasing the likelihood that electricity is available when needed, and decreasing the share of electricity supply that is subject to external shocks. However, Anguilla should

⁶⁰ The Government of Anguilla. "The Anguilla National Energy Policy: 2010-2020." Office of the Chief Minister, 2009.

⁶¹ Government of Anguilla. "Transforming to a Climate-Resilient, Energy Efficient and Low Carbon Economy-Anguilla's Climate Change Policy". 2011.

⁶² Government of Anguilla. "Transforming to a Climate-Resilient, Energy Efficient and Low Carbon Economy-Anguilla's Climate Change Policy". 2011.

not pursue energy independence at any cost—only if the energy security benefits exceed the economic costs. Achieving energy independence at any cost could prove impossible given that Anguilla’s renewable energy options cannot provide firm power with today’s commercially viable technologies; may jeopardize the NEP’s main goal to “ensure universal access to an affordable electricity supply for all Anguillans”; and would be counter to the Government’s priority policy objective of enabling renewable energy integration to reduce costs, while increasing energy security and enhancing environmental sustainability.

The draft CCP also includes directives to ensure implementation of the goals, and objectives within the next five years to facilitate the transition to a climate resilient, energy efficient, and low carbon economy. There are several policy directives for energy security that would support implementation of the draft CCP. These policy directives include: (i) implementing the energy policy, (ii) implementing the recommendations of the energy policy to meet new energy demand using renewable energy sources, and (iii) enacting and enforcing the draft Environmental Protection Bill. These policy directives are appropriate ways to enable implementation of the draft CCP.

There are no specific targets for renewables in the draft CCP.

Appendix E: Analysis of Anguilla’s Relevant Laws and Regulations

E.1 Control of Supply of Electricity

Legal rules control the supply of electricity in Anguilla at two levels:

1. Rules regulating the supply of electricity generally through a licensing regime established under the Electricity Act, R.S.A. c. E35
2. Rules contained in the corporate instruments of ANGLEC to which it is subject as a company registered under the Company Act, C065 of the Revised Laws of Anguilla.

Below we discuss those rules that are relevant to renewable energy integration (E.1.1. Licensing; and E.1.2 Corporate Instruments).

E.1.1 Licensing

The licensing regime rules of the Electricity Act, R.S.A. c. E35 are set out in the Act itself; in Regulations made under the Act, namely the Electricity Supply Regulations R.S.A. c. E35 and the Electricity (Rates and Charges) Regulations E35-2 as amended by the Electricity (Rates and Charges) (Amendment) Regulations 2009; and in licences issued under the Act. The rules contained in a licence are statutory—that is to say, they are mandated under statute, in particular, regulation 2 of the Electricity Supply Regulations. However, the Governor is given the discretion to determine certain terms, for example, the term of the licence and the area of supply.

Below we examine the rules in the Act and Regulations separately from those in ANGLEC’s licence, which is the only licence issued to date.

Electricity Act and Regulations

The Electricity Act, R.S.A. c. E35 prohibits persons from using any electrical plant—including renewable energy plant—to supply any premises with electricity, unless the supply is authorized by a licence issued by the Governor, or the Act exempts the supply from the requirement for a licence.⁶³ If a person supplies electricity in violation of this prohibition he commits an offence and may be made to pay a fine of up to \$5,000 or be imprisoned for up to 6 months.⁶⁴

The Act empowers the Governor to issue only two types of licences: a public supplier’s licence to supply electricity to any part of Anguilla, and a private supplier’s licence to supply electricity to the person’s own premises. It does not contemplate a licence to supply electricity on a commercial basis to a public supplier who has a public supplier’s licence.

The Act exempts from the requirement for a licence any electrical plant that:

⁶³ Section 2.

⁶⁴ Section 4.

(a) is powered only by wind and which is used by any person for the purpose only of supplying electricity to his own premises;

(b) is used only for the photovoltaic generation of electricity by any person for the purpose only of supplying electricity to his own premises;

(c) is installed in any vehicle, vessel or aircraft for the purpose only of supplying electricity to that vehicle, vessel or aircraft;

(d) is used only for the purpose of supplying electricity at such times as there is a temporary breakdown in the supply of electricity under a public supplier's licence;

(e) is such electrical plant as mentioned in paragraph (d) at such times as the plant is being used only for the purpose of servicing or testing the plant;

(f) is used only in connection with the carrying on of any constructional or repair work, or any excavation, in any case where it is not reasonably practicable to use electricity supplied under a public supplier's licence; or

(g) is electrical plant of any class or description as may be prescribed by the Governor by regulation for the purposes of this subsection.

The Act deals comprehensively with the application and issue of the licence, but contains limited provisions as to the terms and conditions to which a licence is subject.

In the case of the private supplier's licence, the Act has only one condition apart from the requirement that the electric plant be used only to generate for one's own consumption: the electric plant must not be used in a manner likely to constitute a nuisance, or cause injury to, any other person. Failure to comply may result in the revocation of the licence by the Electricity Commissioner. The Act leaves all other terms to be set in the licence. No private supplier's licence has to date been issued, but the Electricity Supply Regulations R.S.A. c. E35 sets out (in four short paragraphs in Schedule 2) what must be included if and when such a licence is issued: the term, which can be no more than 5 years; and the notice and procedure for terminating, revoking, and renewing the licence.

In respect of the public supplier's licence, the Act imposes more conditions, but again the details and additional conditions are left to be established by Regulations, and in the licence. These terms and conditions relate to standards of service, tariffs, and land rights. These terms and conditions are more extensive than those of the private supplier's licence, as explained below.

As to the exercise of regulatory functions over the electricity sector, the Act gives the Governor the responsibility for the issue of licences. However, his discretion is limited as to the terms and conditions subject to which the licensee operates—the terms and conditions of licences are prescribed in the Electricity Supply Regulations R.S.A. c. E35. The regulatory function of monitoring and enforcement of these licence conditions is performed by the Electricity Commissioner (a post established by the Electricity Act, R.S.A. c. E35), the Governor, and the High Court. Enforcement involves warning notices and may escalate to heavy fines and revocation of the licence if the warning notices are not heeded. Despite the useful enforcement procedures, the enforcement aspect of the regulatory function is also limited because the standards to be enforced are set in terms that only seek to ensure that the public supplier meets overall objectives. (See the public supplier's broad service standards in section E.2, and the broad criteria for tariff adjustments in section E.3.)

ANGLEC's Licence

On 28 March 1991, the Governor issued an exclusive public supplier's licence to ANGLEC to supply electricity to the whole of Anguilla for a period of 50 years⁶⁵ (unless revoked or terminated under section 6 of the Act), starting on 1 April 1991 (the same day that the Electricity Act, R.S.A. c. E35 came into force). The licence states that it is issued 'in consideration of' the performance of ANGLEC's obligations under the licence.

Generally, the licence confirms that its provisions are subject to the Act. The important features for the purpose of understanding the legal and regulatory framework for electricity are the assignment rights it gives to ANGLEC, and the provisions relating to service standards and tariffs. Here we discuss the assignment rights—we explain the service standards below in section E.2, and tariffs in section E.3.

Assignment rights

Under clause 11, ANGLEC can transfer or assign 'the licence or the benefit of the whole or any part of it' if it has the prior written consent of the Governor. This provides ANGLEC with a legal basis, once it has prior approval:⁶⁶

- To hand over everything to another utility
- To give an independent power producer (IPP) the right to produce power under ANGLEC's licence, which power ANGLEC could repurchase in accordance with the terms of a power purchase agreement between ANGLEC and the IPP (the IPP would be using an electric plant under a licence—ANGLEC's licence—and so may be considered to satisfy the requirements of section 2 without a further licence in its own name)
- To hand over distribution once the reselling rates comply with the rates set by the Electric Commissioner under section 30 of the Electricity Supply Act, R.S.A. c. E35
- To enter into a contract under which it keeps possession of the electric plant, but permits another entity to operate the electric plant in its name.

Despite any power of ANGLEC under clause 11 to allow others to produce power on its behalf from which it can later purchase, ANGLEC cannot purchase power from the holder of a private licence or a person exempted from the requirement of a licence because the private licence holder and the exempted person is prohibited from using their plant for a purpose other than producing electricity for their own use.

E.1.2 Corporate Instruments

The corporate instruments of a company are the instruments that govern the affairs of the company. The key instrument that regulates who has the power to make decisions and how they are made is ANGLEC's by-laws. Under the by-laws, the business affairs are managed by directors, who are appointed by ANGLEC's shareholders. As the holder of a majority of

⁶⁵ The Anguilla Electricity Ordinance 1991. *Public Supplier's Licence issued to Anguilla Electricity Company Limited by the Government of Anguilla*. March 28th, 1991.

⁶⁶ Table 7.2 presents the various licence options for utility scale renewables, followed by a discussion of advantages and disadvantages of each option..

shares (as noted above, directly and through Government Social Security the Government holds 56 percent of the shares), the Government exercises considerable control over the appointment of ANGLEC'S directors, and the policies implemented by the company.

The directors exercise their powers by decisions taken by majority at meetings. Outside of meetings, a resolution signed by all directors entitled to vote at a meeting has the same effect as a decision taken at a meeting. The Managing Director and other officers of ANGLEC perform their duties under the authority and control of the directors, who are empowered to delegate its powers to committees of directors or officers of the company.

Under paragraph 4.11 of the by-laws, the directors may impose on the officers any terms and conditions or any restrictions that they think fit in respect of the powers entrusted to the officers. This means that—in addition to the terms and conditions in the Act, Regulations, and licence—ANGLEC is subject to any internal terms and conditions imposed by the directors on officers charged with carrying out the statutory duties of ANGLEC as a public supplier. This is an important provision for our recommendations (section 7.1.1).

E.2 Service Standards

The Act, Regulations, and licence set service standards with which the public supplier must comply. The Act contains only a few: the maximum power to be supplied, street lighting obligations of the public supplier, and the use and maintenance of meters. The Electricity Supply Regulations R.S.A. c. E35 contain detailed standards respecting the voltage at which electricity is to be supplied, and set out in Schedule 1, one main standard that must be included in a public supplier's licence, and which is included in ANGLEC's licence:

'[ANGLEC] shall operate, control, manage, and maintain the system for the generation, transmission, distribution and supply of electricity to the public ... with a view to providing a regular, sufficient and continuous supply of electricity.'

Having regard to ANGLEC's assignment rights discussed above (E.1.1), any or all of these activities may be carried out by a person to whom ANGLEC assigns the relevant rights under its licence.

The Act, Regulations, and ANGLEC's licence do not control how ANGLEC must meet this overall objective. In other words, they do not have restrictions concerning what electric plant can be used, when, to what extent, and how, the capacity of the plant can be increased (for example requiring that expansion is least cost or that renewable energy options are considered in preparing expansion plans). They do not create an obligation on ANGLEC to get approval of its generation expansion plans. To recover its cost of generation expansion and maintenance through tariffs, all ANGLEC must show is that the costs were reasonable (see section E.3). Expansion and maintenance is therefore a business decision to be taken in accordance with ANGLEC's corporate instruments, subject only to an overall requirement that the supply be regular, sufficient, and continuous; and costs reasonable.

E.3 Tariff Regulation

The Electricity Act, R.S.A. c. E35 contemplates two types of tariffs: (i) a tariff of rates for the charges that a public supplier can charge a customer; and (ii) a tariff at which a person to whom the public supplier supplies electricity can resell the electricity.

In respect of the rates for reselling, the Act empowers the Electricity Commissioner to set maximum rates in his sole discretion. In respect of the rates for selling to a consumer, a

more complex framework is set up. The Act empowers the Governor to establish a tariff of rates in regulations. Some tariff rules are also contained in the licence. These rules in the regulations and licence require that the tariff have a specific structure, establish specific rates, and set out a procedure for changing the value of the tariff. We explain the tariff structure and rates in section E.3.1; and the procedure for changing tariffs rates in section E.3.2.

E.3.1 Tariff structure and rates

The current tariff structure and rates are governed by ANGLEC's public supplier's licence, the content of which is mandated by the Electricity Supply Regulations, R.S.A. c. E35 and the Electricity (Rates and Charges) Regulations, E35-2 as amended by the Electricity (Rates and Charges) (Amendment) Regulations, 2009. The licence entitles ANGLEC to charge a base rate and fuel adjustment surcharge. The 'Rates and Charges' regulations establish the values of the rate and surcharge: the base rates vary according to usage; and the fuel surcharge is EC\$0.01 per unit for every 10 cents per gallon increase in the price of fuel oil over EC\$3.64 per gallon.

E.3.2 Rate Adjustment Procedure

The rate adjustment procedure is governed by the public supplier's licence, the content of which is mandated by the Electricity Supply Regulations, R.S.A. c. E35.

The responsibility for initiating the procedure is placed on ANGLEC. If the company wants a rate adjustment it must serve a notice on the Minister with responsibility for electricity, requesting a rate change of a specified amount, to commence on a future date (not less than 90 days from the date of the notice) stated in the notice. Together with the notice, ANGLEC must submit its most recent audited accounts; and its estimate for the 5 following financial years. ANGLEC must publish the notice for the information of the general public. If the Minister does not approve the notice within 30 days, ANGLEC may apply for the matter to be determined by an arbitrator chosen by the parties, or, if they cannot agree, by the Governor. If adjustment is agreed, it is given effect through new electricity (rates and charges) regulations, which would repeal the existing ones.

As required by the Electricity Supply Regulations, R.S.A. c. E35, ANGLEC's licence sets criteria to provide guidance for Minister and the Arbitrator in the exercise of their discretion as to whether, and to what extent, rates should be adjusted. In deciding whether to approve a rate adjustment requested by ANGLEC, they must ensure that the rates are at least sufficient to enable ANGLEC:

- To meet all expenses reasonably incurred in the production of such revenues, including (without limitation) depreciation of assets, provision for bad debts and interest on indebtedness
- To repay its indebtedness
- To provide for the cost of replacement of its capital assets
- To provide a reasonable proportion of the capital costs of expanding its undertaking to meet any demand for an increased service to the public
- To provide an annual return on its Ordinary Shareholders' Equity at a rate not less than 12 per cent per year (this rate enables ANGLEC to raise the capital that it needs to make the necessary investment in plant to meet its obligation of providing a reliable service).

If the Minister or the Arbitrator requires information other than the audited accounts and the five-year forecast for the purpose assessing ANGLEC, having regard to the criteria above, they may request this information. Although the Electricity Act, 035, and the licence do not expressly give this power, the Interpretation and General Clauses Act, I025 establishes that if a duty is given to an authority, the authority has the power to do all that is necessary to enable it to perform its duty:

Construction of enabling words

38. Where in any law power is given to any person to do or enforce the doing of any act or thing, all such powers shall be understood to be also given as are reasonably necessary to enable the person to do or enforce the doing of the act or thing.

The last time the rate adjustment procedure was invoked was after Hurricane Luis had caused considerable damage to ANGLEC's equipment and apparatus. By letter addressed to the Minister of Public Works, ANGLEC requested a ten percent rate increase from EC\$0.60 by EC\$0.66. It submitted audited financial statements with its request. In a letter from the Chief Minister in January, 1996, ANGLEC's application was rejected. It was indicated that the rejection was agreed upon in EXCO. ANGLEC brought the matter to arbitration. The Arbitrator was selected by agreement between ANGLEC and the Government. The Arbitrator awarded half the increase sought.

E.4 Land rights

Renewable electricity generation requires land on which the wind turbines, solar systems, or other projects (such as waste-based renewable energy projects) can be located, including the right to access this land over the land of others. Also necessary is the right to develop the land as a power plant. Thirdly, it is necessary to obtain rights to place poles and other apparatus on the land of others. Below we describe the legal framework for acquiring land (E.4.1), including the right to access it over the land of others; for obtaining the right to develop land (E.4.2); and for obtaining rights over the land of others to place poles and other apparatus (E.4.3).

E.4.1 Land acquisition

While the extent of land necessary for utility scale and distributed scale operations may differ, both operations require the same type of land rights for their operations. Generally an interest in land must be secured through outright purchase, or the lease of the land. If access to this land must be obtained by passing over the land of another, easements are necessary.

If waste-based renewable energy projects use gas from waste on the property of another, a servitude different from an easement—a *profit-à-prendre*—may also be required to entitle the developer to take the gas produced on the land of another.

For solar systems, one may opt to obtain not ownership or a lease, but a contractual licence to place solar panels on the property of another containing terms that restrict the licensor's right to revoke it.

All these rights are governed by land law. Anguilla's land law comprises the English common law of real property as codified, amended, and supplemented by Anguillan legislation.

The Common Law (Declaration of Application) Act, C60 declares that the English common law is in force in Anguilla. The English common law of real property establishes the interests that can be held in land and rules for how these interests can be created and transferred. The

Registered Land Act, R.S.A. c. R30 simplified these rules and introduced more certainty in land transactions. The Government Lands Regulation Act, G010, enables special rules to be established to govern land held by the Government, but no such special rules have been made. However, the Land Acquisition Act, R.S.A. c. L10 gives the Government special powers to compulsorily acquire land held by anyone. Also relevant is the Aliens Landholding Regulation Act, A055, which imposes restrictions on non-Anguillans to hold and transfer interests in land.⁶⁷

The effect of these laws is that land and easements can be acquired by private treaty between the developer and the landowner (whether private or Government), or by compulsory acquisition by the Government and transferred to the developer. The Electricity Act, R.S.A. c. E35 comprehensively deals with how and when compulsory acquisition, as opposed to private treaty, can be used. It states in section 10:

10. (1) When a public supplier needs land for the purpose of generating, transmitting, distributing or supplying electricity, the supplier shall endeavour to acquire such land by private treaty

(2) Where the public supplier fails to acquire such land by private treaty and where the Governor in Council considers that such land is necessary for the purpose of generating, transmitting, distributing or supplying electricity, the Governor in Council may, at the request of the public supplier, cause necessary action to be taken to acquire such land in accordance with the provisions of the Land Acquisition Act and, upon such acquisition, to transfer the land to the public supplier on payment of the full cost of acquisition to the Government by the supplier

(3) Acquisition of any land for the purpose of subsection (2) shall be deemed to be for a public purpose within the meaning of the Land Acquisition Act.

Land is not defined in the Land Acquisition Act, R.S.A. c. L10 or in the Electricity Act, R.S.A. c. E35. The Interpretation and General Clauses Act, I25 dictates that land has the following meaning when used in an Act, if the Act does not contain a definition:

“land” includes all tenements or hereditaments, and also all messuages, houses, buildings, or other constructions, whether the property of Her Majesty, Her heirs or successors, or of any corporation, or of any private individual, except where there are words to exclude houses and other buildings;

The legal principle established by the authorities is that:

When power is given by statute to acquire land compulsorily, the whole interest must be acquired notwithstanding the definition of ‘land’ in the empowering enactment as including easements or rights over land, unless special provision is made, and there is no power to require and acquire an easement, right or lease only...If the land acquired has attached to it the benefit of a right of way or other easement with respect to other land, that benefit will pass to the acquiring authority on the conveyance of the land acquired.⁶⁸

Therefore, section 10 of the Electricity Act, R.S.A. c. E35 and the Land Acquisition Act, R.S.A. c. L10 entitle the Government to compulsorily acquire the full rights of the registered proprietor over land. It is also clear that any existing easements over other land not being

⁶⁷ There are other statutes affecting land rights but which are not important for current purposes: the **Small Tenements Act, S40** regulating the rights of persons of property leased for little or no rent; the **Law of Property (Miscellaneous Provisions) Act, L025** which deals with the powers of others to execute or hold land documents on behalf of others.

⁶⁸ Halsbury's Laws of England, Compulsory Acquisition of Land, Vol.18 (2009) 5th Edition, para. 532.

acquired, which exist for the benefit of the land acquired, will pass with the conveyance to the Government, and then to the electricity supplier when the property is transferred.

However, whether the Government can acquire only a lease in the land being acquired, or create additional easements in land not being acquired that do not already exist for the benefit of the land being acquired, depends on the construction of the Electricity Act, R.S.A. c. E35 and the Land Acquisition Act, R.S.A. c. L10. The Government can acquire such lease or easements if these Acts can be interpreted as making special provision for this. Our review of these Acts reveals that there is nothing in them (except perhaps section 24 of the Land Acquisition Act, R.S.A. c. L10) from which such special provision can be inferred. On the contrary there is much from which it can be inferred that only acquisition of full title is contemplated. Indeed, section 2(3) of the Land Acquisition Act, R.S.A. c. L10 expressly declares that once the required notices are placed in the Gazette, ‘the land shall vest absolutely in the Crown.’ Under the Land Registration Act, a person with absolute title has absolute ownership. Absolute title is not consistent with a lease or an easement.

E.4.2 Land development

Unless a renewable energy developer has the prior written permission of the development authority (the Land Development Control Committee) or the development is exempted under the Land Development Control Regulations, R.S.A. c. L15, the developer will not be able to set up a renewable energy electric plant if setting up that plant amounts to developing the land within the meaning of the Land Development (Control) Act, R.S.A. c. L15.⁶⁹ Development is defined as follows:

“development”, in relation to any land, includes any building or rebuilding operations, engineering operations, mining operations (including the removal of sand) in, on, over or under any land, the making of any material change in the use of any building or land, the subdivision of any land, the laying out of roads, the filling of ravines or swamps, or any other preparatory work which indicates an intention thereby to change or alter the existing nature or character of any land and “develop” shall be construed accordingly;

Exempted developments under the Land Development Control Regulations, R.S.A. c. L15 include:

Class 1. Any enlargement, improvement or other alteration of a dwelling house subject to the conditions—

(a) that the external cubic content of the original house is not exceeded by one-tenth or 50 cubic metres, whichever is the greater;

(b) that the height of such enlargement or improvement or other alteration does not exceed the highest part of the roof of the original house; and

(c) that such enlargement or improvement or other alteration does not extend beyond the furthest point of any wall of the house abutting a road;

Under the Act, therefore, the installation on a dwelling house of apparatus for the generation of solar power may fall within the exempted developments prescribed by the Land

⁶⁹ There is a draft Physical Planning Bill which, if passed will repeal and replace this Act. While this Act may introduce changes to the procedure, the definition of develop and conditions of approval, this comment is equally valid in respect of this draft legislation.

Development Control Regulations, R.S.A. c. L15 (the Land Development Control Committee also stated this during our meeting). In contrast, the setting up of wind, waste-to-energy plants and solar plants (except those that fall within the exception cited above) would need approval.

To protect the environment, development applications are likely to involve environmental impact assessments. Although this is not an explicit requirement under the Act, it is facilitated by the broad powers in the Regulations to request additional information before approving applications for developments. There is draft legislation, the Physical Planning Bill, which proposes to make environmental impact assessments mandatory for ‘power plants’. Other draft legislation, the Environmental Protection Bill, proposes to provide a framework for the Minister responsible for the environment, and committees established under the Bill, to review activities—including electricity supply activities—proposed in Anguilla for their potential impact on the environment, and require environmental impact assessment reports where this is deemed necessary (such reports are mandatory for certain specified activities—but power generation is not listed as such).

E.4.3 Statutory rights

In addition to easements, which in theory are rights of a landowner to have certain rights over the land of his neighbour for the benefit of his land, the landowner needs statutory rights—that is, rights over any land of others even though the land is not neighbouring land, to erect poles or install wires or other apparatus necessary for the supply of electricity. The Electricity Act, R.S.A. c. E35 confers such statutory rights on a public supplier in section 9(2), which states:

For the purpose of a public supplier’s licence, a public supplier may from time to time cause standards, poles and towers together with fixtures and fittings to be erected, and electric lines to be laid and carried through, across, over or under any road or through, over or under any land whatsoever, enclosed or otherwise’

In addition to this, the Schedule of the Act sets out some details respecting those rights and the procedure that must be followed by the public supplier to take advantage of these rights.

Apart from conferring these statutory rights on the public supplier, the law of Anguilla, in particular the Registered Land Act, R.S.A. c. R30, section 28(h) and (i), expressly declares that the rights of all owners of registered land in Anguilla are subject to these statutory rights. It gives these rights the status of ‘overriding interests.’

Table E.1: Summary of Land Rights

	Utility Scale Renewables	Distributed Scale Renewables	Existing Legislation	Conclusion
Land acquisition	Requires purchase, or lease of the land, servitude if on another's property (waste projects), or contractual licence (to place solar panels on another's property), or compulsory acquisition of land by Government	Requires purchase, or lease of the land, or contractual licence (to place solar panels on another's property)	All land acquisition rights governed by existing land laws and Electricity Act	Land and easements can be acquired by private treaty between the developer and the landowner, or by compulsory acquisition by the Government and transferred to the developer
Land development	Developer needs permission from Land Development Control Committee to set up a utility scale renewable energy project	Exempted from permits if renewable system does not exceed a certain size defined in the land development control regulations	Land development governed by Land Development Control Regulations. Environmental impact assessment can also be requested in an <i>ad hoc</i> manner	Land development control legislation governs land development, but environmental legislation would strengthen environmental management
Statutory rights	Need rights over any land (even if not neighboring land), to erect poles or install wires or other apparatus necessary for the supply of electricity	Not required	Electricity Act confers statutory rights to ANGLEC, Registered Land Act provides that rights of all registered land owners are also subject to these statutory rights	Electricity Act and Registered Land Act provide the necessary statutory rights needed for utility scale projects, and not needed for distributed scale renewables


Appendix F: Estimated Conventional Generation Costs and Electricity Tariffs for Assessing Renewables

In this appendix we estimate conventional generation costs and electricity tariffs for assessing the economic and commercial viability of renewable energy in Anguilla. It is important to note that the numbers we estimate are not historical values, but theoretical ones for purposes of analysis, given a certain assumption on the cost of diesel fuel (as we explain below, we conduct our estimate assuming that diesel costs US\$4 per gallon).

F.1 Estimated Conventional Generation Costs

For our analysis of the viability of renewable energy technologies in section 5, we calculate a benchmark generation cost of ANGLEC's conventional plant. Figure F.1 shows an estimate of the all-in cost (or long run marginal cost, LRMC) of the two types of generators currently operated by ANGLEC (high and medium speed diesel plants) based on a diesel No.2 price of US\$4.00 per IG.

Figure F.1: Estimated All-in Costs of Generation of ANGLEC's Plants with diesel US\$4.00/IG

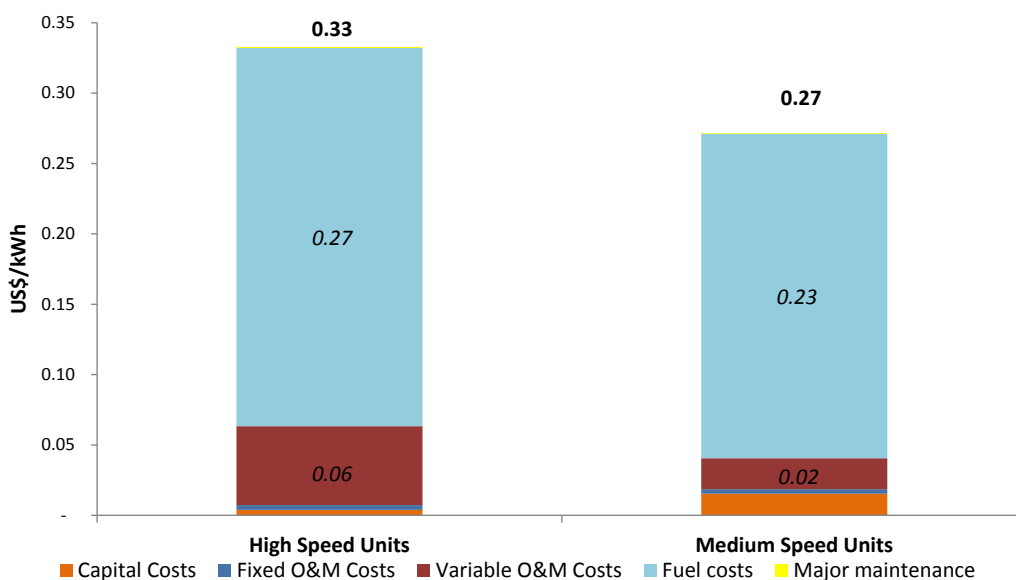

Source: Castalia estimate based on data on current plants provided by ANGLEC.

Note: Figures based on assumed diesel fuel costs of US\$4.00 per gallon.

We use a figure of US\$4.00 per IG because we need to use some estimate of future oil prices, and a good source for these is a futures oil contract. As of April 2012, WTI crude oil futures are trading at about US\$102 per barrel for December 2013, about US\$98 per barrel for December 2014, and about US\$95 for December 2015.⁷⁰ Based on the correlation shown

⁷⁰CME Group. "Light Sweet Crude Oil Futures." Accessed April 16, 2012 at: <http://www.cmegroup.com/trading/energy/crude-oil/light-sweet-crude.html>

in the past between ANGLEC's average fuel prices and WTI oil, US\$4 per barrel is a reasonable estimate for the period in which Anguilla may consider renewable energy options—as soon as possible, given the current situation commonly described as a crisis.

The figure shows that, at a fuel price of US\$4.00 per IG, the all-in cost of generation of high speed units is about US\$0.33 per kWh, while that of medium speed units is US\$0.27 per kWh. The fuel-only portion of the all-in cost is US\$0.27 and US\$0.23 per kWh, respectively.⁷¹

This estimate is based on the following assumptions:⁷²

- Capital costs: US\$1.2 million per MW (nominal) for medium speed units, and US\$250,000 per MW (nominal) for medium speed units
- Weighted Average Cost of Capital (WACC) = 10 percent (real); (WACC = Cost of Equity * Share of Equity + Cost of Debt * Share of Debt, that is $0.12 * 0.64 + 0.065 * 0.36 = 0.10$, as provided by ANGLEC)
- Annual inflation in Anguilla: 8.7 percent⁷³
- Tax rate: 0 percent (corporate tax rate)
- Availability: 87 percent for high speed units, and 95 percent for medium speed units
- Fuel efficiency: averages for figures between 13.5 and 15.5kWh per IG for high speed units, and between 16.5 and 17.9kWh per IG for medium speed units
- Operations and maintenance (O&M) costs: fixed O&M US\$27 per kW per year (nominal); variable O&M US\$56 per kW per year (nominal) and US\$22 per kW per year (nominal) for high speed and medium speed units, respectively
- Lifetime: 15 years for high speed units, 20 years for medium speed units
- Major maintenance in years 3, 6, and 9 for high speed units, and years 5, 10, and 15 for medium speed units
- Diesel fuel price: US\$4.00 per gallon (including taxes).

F.2 Estimated Tariffs

The table below shows the tariff per kWh for each category established by the base rates when the fuel surcharge—based on the assumption of a diesel price of US\$4.00/IG—is added. As agreed with the Government, we show values in United States Dollars so that we

⁷¹ The price differential of US\$0.06 per kWh depends on high speed units' shorter lifetime (25 percent less than medium speed units), lower fuel efficiency, and lower availability, in spite of their lower capital costs.

⁷² Meeting with ANGLEC management, Anguilla, 17 February 2012. Remote follow-up by telephone and e-mail, February 2012-April 2012.

⁷³ Central Statistical Office, Anguilla. 2010 Inflation Rate (period average %). Consumer Price Index Monthly and Annual Data as of January 2012. Eastern Caribbean Bank. <http://www.eccb-centralbank.org/Statistics/index.asp#monstats> (last accessed 28 March 2012). The inflation assumption translates into a capital recovery factor of 13.15 percent per year for high speed units; and 11.75 percent per year for medium speed units.

may use the values below for assessing the commercial viability of distributed renewable energy technologies.⁷⁴

Table F.1: Estimated Total Tariffs with Fuel at US\$4 per IG (US\$ per kWh)

Tariff	Base Rate (a)	Fuel surcharge assuming oil at US\$4/IG (b)	Total (a+b+c)
Tariff One (1-40 kWh)	0.21	0.26	0.47
Tariff Two (41-2,500 kWh)	0.24	0.26	0.50
Tariff Three (2,501 - 100,000 kWh)	0.23	0.26	0.50
Tariff Four (> 100,000 kWh)	0.16 (excluding fixed charge)	0.26	0.45 (excluding fixed charge)

Notes: (1) The total tariff does not include the Meter Rental Fee; (2) A Fuel Price of US\$4.00 per IG is used for calculating the fuel surcharge; the fuel charge was EC\$0.45 or US\$0.17 for March 2012; (3) The fixed charge for base rate four is not accounted for.

⁷⁴ Conversion of Eastern Caribbean Dollars \$3.64 per gallon to US Dollars (12 March 2012), <http://www.xe.com/>

Appendix G: Renewable Energy Technologies

Below we review the current state and future prospects of ‘screened in’ renewable energy technologies in Anguilla. We start each section by briefly introducing a technology. Then, we describe the current state of development of each technology in Anguilla. Next, we assess the primary resource that each technology uses. After that, we analyze the technology in greater detail, and identify the type and scale that would be appropriate for Anguilla. Following that, we discuss costs for each technology. Finally, we make a few conclusions about the future potential of the technology in Anguilla.

G.1 Solar Photovoltaic Energy

Anguilla is very well endowed with sunlight, which represents the primary energy resource for solar photovoltaic (PV) systems. Because sunlight is intermittent, solar PV systems—a mature and internationally widespread technology—provide non-firm power, mostly as small or commercial systems distributed on the grid. Capital costs of solar PV systems are expected to fall further, following a downward trend that has brought their generation costs to competitive levels in Anguilla’s high electricity price environment. Conversion efficiency of PV panels is also expected to further improve; expected improvements in batteries for backup are more uncertain.

Current state of development in Anguilla

There are no utility scale solar PV plants in Anguilla, and penetration of smaller systems is relatively limited. With the abundance of irradiation that Anguilla receives, many large and medium consumers of electricity—in particular, hotels—have been showing increased interest in systems designed for self-generation. In addition, ANGLEC has created a draft request for proposals for up to 1MW of solar PV installed capacity.⁷⁵

Primary resource

No solar radiation map exists for Anguilla. However, a solar radiation map developed in 2010 for Bahamas⁷⁶—estimating an average between 5 and 6kWh per square meter per day—may be used that as a proxy for Anguilla. These are very similar to radiation values estimated for Barbados and other Caribbean countries, which allows using estimates from other countries for output from various PV panel types (as well as for solar water heaters).

Technology for solar PV energy

Solar PV technology transforms solar radiation into electricity. The basic component of a PV system is the PV cell, a semiconductor device that converts solar radiation into direct-current electricity. (‘Conversion efficiency’ is the ratio between the electrical power produced by a solar PV cell and the amount of incident solar energy received per second.) PV cells are interconnected to form a PV panel (or module). PV panels combined with a set of additional application-dependent system components (such as inverters, batteries, electrical components, and mounting systems) form a PV system. PV systems can be used individually, or grouped together in arrays.

⁷⁵ ANGLEC. “Request for Proposal: Photovoltaic Generating Plan.” January, 2012

⁷⁶ Fichtner, *Direct normal solar irradiation on The Bahamas*, based on National Renewable Energy Laboratory (NREL), 2010.

There are currently two types of commercial PV modules: wafer-based crystalline silicon (c-Si, which currently represent about 85 to 90 percent of the global annual market⁷⁷) and thin films. Other technologies, such as advanced thin films, organic cells, and more novel concepts, are being developed, but are not commercially available. The efficiency of solar cells has increased considerably over the past few years, and is expected to increase further, especially for newer types of cells.

There are two categories of wafer-based crystalline silicon modules:

- Monocrystalline modules are made from a single large silicon crystal cut from ingots. This is the most efficient (up to 15 to 20 percent efficiency or more)⁷⁸, but also the most expensive type of solar PV panel
- Polycrystalline modules are cast in ingots of silicon that contain several small silicon crystals. This is the most common type of panel currently available on the market, and is somewhat less efficient (down to 13 to 15 percent efficiency)

Thin film panels are more economical to produce, but less efficient (efficiency ranges from 6 to 12 percent). They include amorphous silicon (a-Si) and micromorph silicon; cadmium-telluride (CdTe); and Copper-Indium-Diselenide (CIS) and Copper-Indium-Gallium-Diselenide (CIGS).

Mounting systems for the panels can be fixed, or integrate a tracking system. Tracking systems tilt panels (along one or two axes) towards the sun to increase exposure to radiation. Tracking systems are a mature technology, and increase the overall efficiency of a panel by over 20 percent (depending on panel type). However, they are more fragile and expensive than fixed mounting systems, and are less cost-benefit justified where the solar resource is good; they are also used to a limited extent in areas prone to hurricanes such as Anguilla.

Other technical issues and opportunities

The potential for increasing the use of utility scale PV in Anguilla may be constrained by the country's limited land mass, and fragmented ownership of mostly privately held land. PV systems require between 2.5 and 4 acres of land per MW.⁷⁹ Small and medium systems are more likely to be installed on residential and commercial rooftops. However, the constraint in availability of land will only be relevant in the medium to long term, when the cost of solar PV may be low enough to justify the more extensive installation of larger scale systems.

Costs of solar PV energy

The solar industry has made great progress over the past few years in reducing the costs of PV systems, and further reductions in cost are expected in the coming years. The installed cost of solar systems decreased from around US\$27.0 per Watt in 1982 to approximately US\$3-4 per Watt in 2012, depending on scale and panel type.⁸⁰ According to some

⁷⁷ International Energy Agency. Technology Roadmap: Solar Photovoltaic Energy (2010).

⁷⁸ Conversion efficiencies based on International Energy Agency. Technology Roadmap: Solar Photovoltaic Energy.

⁷⁹ NREL. "PV FAQs: How Much Land will PV need to supply our electricity." 2004 and conversation with Salomon Energy on 4/10/2012

⁸⁰ Solar Buzz (2010). Photovoltaic Industry Statistics: Costs (<http://www.solarbuzz.com/StatsCosts.htm>); conversation with Salomon Energy, April 15,2012.

estimates,⁸¹ the cost of PV systems could drop below US\$2.5 per Watt by 2035, driven by expected falling prices of polysilicon (however, a shortage in polysilicon supply in 2008 led to a price hike that could happen again).

Commercial size systems (about 60kW) installed in Anguilla can have an installed cost of about US\$3,500-4,500 per kW with polycrystalline panels, depending on the site.⁸² Smaller systems of a few kilowatts, such as that installed at the hospital, are more expensive (about US\$4,500 per kW).⁸³ Past estimates for systems to be installed at hotels are much higher (about US\$6,000 per kW)⁸⁴. According to some estimates, installing a battery for full backup could add between US\$1,500 and US\$2,800 per kW installed,⁸⁵ depending on battery quality and type; the cost of installed batteries for a hybrid system in Anguilla⁸⁶ are reportedly as low as an additional US\$1,000 per kW, but not for full backup. An unsolicited offer for a multi-megawatt solar PV project had a preliminary estimate of installed cost as low as US\$2.1 million per MW.⁸⁷ More conservative estimates for high-quality utility scale solar PV would be in the order of US\$3.0-3.2 million per MW installed for monocrystalline panels—these would have sealed panels, and would be backed by a long term guarantee.⁸⁸ Monocrystalline panels can also be used for residential applications.

⁸¹ Energy Information Administration, *Annual Energy Outlook 2010*.

⁸² Conversation with Comet Systems, February 2012;

⁸³ Conversation with ANGLEC, February 2012.

⁸⁴ Jadoo Power, estimate for Royale Caribbean Resort.

⁸⁵ Conversation with Salomon Energy, 20 April 2012.

⁸⁶ Anguilla, February 2012. U.S. Solar Battery: US\$250 to \$260 per battery (12 batteries); Gold-Cart Battery: US\$150 per battery (8 batteries), for a total of 20 batteries for backup power at night (for a hybrid 4kW Solar PV / 200 watt wind system)

⁸⁷ Conversation with ANGLEC, April 2012.

⁸⁸ Conversation with Siemens and Salomon Energy, 11 April 2012.

Installed capacity	Unit Capital Cost (US\$/kW)	O&M Costs (US\$/kW/yr)	Capacity Factor (%)	Annual output (GWh/year)	Lifetime (years)	LRMC (US\$/kWh)
Solar PV (polycrystalline, fixed, commercial)						
60kW	3,500	50	21%	0.0108	20	0.24
Solar PV (thin film, fixed, small)						
2kW	4,000	60	21%	0.0036	20	0.28
Solar PV (thin-film, fixed, small, with battery)						
2kW	6,800	60	21%	0.036	20	0.45
Solar PV (monocrystalline, fixed, utility)						
2MW	3,100	60	23%	6.042	20	0.22

Source: Estimates based on information provided by Comet Systems, ANGLEC, Siemens, Salomon Energy.

Note: discount rate of 9% for distributed scale; 11% for utility scale.

The cost of generating electricity with quality solar PV is still relatively high compared to other energy sources—but can be economically and commercially viable in Anguilla. Based on information referenced above and using a discount rate of 9 percent, small and commercial systems at distributed scale in Anguilla—assuming an output of 1,800kWh per kW per year (corresponding to a capacity factor of about 21 percent, that is about 1,840 hours on 8,760 hours per year)—could have an estimated LRMCs between US\$0.24 per kWh (for larger, polycrystalline systems of about 60kW), US\$0.28 per kWh (for smaller, thin-film systems of about 2kW for domestic use), and US\$0.45 per kWh (for smaller, thin film systems that have battery storage capability). For utility scale systems with monocrystalline panels, assuming a higher capacity factor of up to 23 percent and a discount rate of 11 percent, the LRMC could be about US\$0.22 per kWh.

Conclusions on solar PV energy in Anguilla

Very good availability of the primary resource; continuously improving technology; relatively easy design, installation, and O&M; and decreasing capital costs all contribute to a positive outlook for solar PV in Anguilla in the medium to long term, both at utility and at distributed scale.

G.2 Solar Water Heaters

As noted, Anguilla enjoys a very good availability and quality of solar radiation. Unlike solar PV, capital costs of solar thermal energy systems used to heat water—a relatively simple and very mature technology—are already low, making this an even more viable renewable energy option for the country.

Current state of development in Anguilla

Penetration of solar hot water systems in the residential and commercial sector of Anguilla is limited, and knowledge of how to install them is too. Some of the systems sold are imported from Australia, while others are manufactured in Barbados and Saint Lucia.

Technology for solar water heating

The main components of a solar water heater system are the storage tank, and the solar collector. There are two main types of solar collectors utilized for low grade thermal applications:

- **Flat plate panels** are the most common type of solar collectors. A flat plate collector is an insulated box with a glazed cover, an absorber, and copper pipes. The solar radiation passes through the glazed cover and heats the absorber. The circulation water in the pipes captures the thermal energy. The water can move by natural convection to an elevated tank, or be actively pumped through the collector. The intercept efficiency⁸⁹ for flat plate collectors may be as high as 80 percent, but decreases rapidly with the increased difference between the temperature of the heated fluid and the ambient temperature
- **Evacuated glass tube collectors** use shallow glass tubes to reduce the heat loss to the surrounding environment. The absorber is located inside the tube and is heated by the sun radiation passing through the glass. The intercept efficiency of an evacuated tube collector is slightly lower than a flat plate collector. However, the efficiency of the collector is less impacted when the temperature difference between the heated fluid and the surrounding environment increases, therefore maintaining a higher efficiency even with a higher operating temperature. This makes evacuated tube collectors better suited to providing process heating in the temperature range from 80 to 90°C.

In terms of scale, solar water heater systems range from a domestic system for one family storage tank capacity of 50 to 80 gallons and capacity of 1 to 2kW, to a commercial system with storage tank capacity of 1800 to 2600 gallons and capacity of 70 or 100kW. Scale corresponds to the sector—smaller systems are used in the residential sector, while larger ones are used in the commercial and industrial sectors. Commercial applications include in particular hotels and restaurants; industrial applications vary greatly—ranging from processing of poultry to horticulture (although this is less likely in warm climates).

Transfer of heat to a hot water system may be done through a ‘solar fluid’ flowing through a tube attached to the absorber plate (or through heat pipes integrated in the solar plates) to fluid contained in a manifold at the top of the collector, which in turn is connected to the storage cylinder by a heat exchanger. The ‘solar fluid’ may contain a non-toxic anti-freeze solution.

Costs of solar water heaters

The cost of a solar water heaters depends not only on the installed capacity of the collector (Watts thermal), but also on the capacity of the storage tank—and especially installation, making it very difficult to provide general pricing estimates. Aspects such as whether or not a building has plumbing pipes going up to the roof or not; the pitch of a roof; roofing

⁸⁹ Intercept efficiency is defined as the efficiency of the collector in converting solar energy to heat when the average temperature of the panel is equal to the ambient temperature. At intercept efficiency, there are no losses or gains from the environment.

material; and options for ground mounting all critically affect cost.⁹⁰ Since this is a mature technology, capital costs are unlikely to fall to a significant extent. However, a study by the International Energy Agency suggests that costs decrease by 20 percent when the total capacity of domestic solar water heaters doubles within a given country.⁹¹

Installed capacity	Unit Capital Cost (US\$/kW)	O&M Costs (US\$/kW/yr)	Capacity Factor (%)	Annual output (GWh/year)	Lifetime (years)	LRMC (US\$/kWh)
Solar Water Heater (flat plate, commercial)⁹²						
70kW	1,100	24	19%	0.115	20	0.09
Solar Water Heater (flat plate, small)						
2kW	1,600	20	17%	0.003	20	0.13

Source: Estimate based on data provided by Solar Dynamics for Barbados and information gathered in Anguilla.

Note: discount rate of 9%.

For our assessment, we used cost figures collected from solar water heater retailers in Anguilla (including Solar Dynamics, whose systems are being imported).⁹³ Figures gathered on the systems' efficiency confirm those for installation in Barbados, but need a 20 percent markup on installed cost to account for a more limited market in Anguilla. Estimated generation costs for residential and commercial solar hot water systems are as low as US\$0.13 and US\$0.09 per kWh, respectively.⁹⁴ A local installer referenced a 150 liter system for a 3 bedroom house, with installation included, for around USD\$1,500, which is a competitive price.⁹⁵ Output per kW (thermal) installed can be assumed to be the same based on a similar solar radiation shown for Bahamas, as discussed in section G.1.

Conclusions on solar water heaters Anguilla

Solar thermal energy for water heating is among the most cost-effective renewable energy technologies available. Adopting regional standards for solar water heater systems may be useful to ensure that systems sold on the market comply with a minimum level of efficiency that is appropriate for Anguilla—and that sub-standard systems are not imported in the country.

⁹⁰ AREO conversation with Comet Systems, 12 April 2012.

⁹¹ International Energy Agency (2009). Renewable Energy Essentials: Solar Heating and Cooling.

⁹² To calculate the cost of a 70 kW system—which is a combination of smaller units) we calculated that it would require twelve of Solar Dynamic's 160 Gallon, 5.7 kW systems. These are the largest systems that they sell. The cost, therefore, reflects the cost of twelve of those units, sold in Barbados with installation for US\$5,190, plus the 20 percent markup added for additional cost in Anguilla.

⁹³ Conversation with Landmark Realty Ltd, 12 January 2011. Conversations with Keene Enterprises (retailer), Solarhart systems, <http://www.solahart.com.au/>

⁹⁴ Meetings with retail distributors during our field visit to Anguilla, November 2010.

⁹⁵ Information from Comet System, referenced by AREO, 12 April 2012.

G.3 Wind Energy

Wind energy is a mature technology that provides non-firm energy at both utility scale and distributed scale. Potential in Anguilla looks promising, although information about the resource is limited; land is limited too. In spite of lower costs, wind looks like a less immediate opportunity than solar, which is easier to design, install, operate (with a much lower intermittency—and a very predictable load), and maintain. Detailed wind resource studies are needed to confirm preliminary estimates, and land availability would need to be assured for a period equivalent to plant lifetime for actual projects to be developed successfully.

Current state of development in Anguilla

There is no utility scale wind energy plant in Anguilla. An initial wind data analysis was done by Mistaya Engineering Inc. for Green Island Power, LLC that provides wind resource data on Corito and the East Part of the Island that shows good wind potential. However, it does not provide any economic or financial information; measurements were taken for a short period of time, and results are uncertain.⁹⁶ Based on this wind data analysis, the Government has proposed including wind turbines as part of its planned “Corito ‘Zero Energy’ Development Zone.”⁹⁷ However, the development is still in the planning stages, and preliminary estimates on wind energy benefits at Corito need to be confirmed before the government may decide whether to go ahead with the plan.

Primary resource

The speed and consistency of wind resources are the primary concern for developing wind generation. These two factors directly affect the capacity factor of a wind plant. With highly variable wind, capacity factors and output are reduced increasing the long run marginal cost of the machine. Also, short term wind variability (that is, within a given minute or hour) decreases the reliability of wind plant causing more backup conventional generation to be needed.

The offshore wind industry has grown substantially in recent years. Wind resource assessments show that offshore locations typically offer better capacity factors (up to 7 percent more than for on-shore farms⁹⁸). Before actual development of offshore wind could be considered, offshore wind resources of Anguilla should be assessed in detail, including a bathymetric survey (a study on the sea surface and depth). This would represent an important first step, as it is one of the two main components of an offshore wind resource assessment (the second one being wind measurements).

Technology for wind energy

Wind turbines capture with their blades the kinetic energy in surface winds, and use the mechanical power generated by the rotation of the blades to turn a generator, thereby converting kinetic power into electrical energy. Wind turbines are an established, widespread technology that has recently increased its penetration worldwide (159GW installed worldwide by end-2009 according to the World Wind Association; a tenfold increase since

⁹⁶ Lambert, Tony. “Anguilla Wind Data Analysis.” Mistaya Engineering Inc., 2008

⁹⁷ Anguilla National Energy Committee. “Corito ‘Zero Energy’ Development Zone.” 2009

⁹⁸ European Wind Energy Association, *Oceans of Opportunity*, September 2009.

1997). Grid systems that have high penetration of wind energy include Denmark (over 19 percent of electricity generation), Spain and Portugal (over 11 percent), and Germany and the Republic of Ireland (over 6 percent).

In terms of types of technology, wind turbines come in three-blade or two-blade configurations—three-blade turbines capture more wind energy, but two-blade turbines are more suited to high wind speeds (and their higher rotational speed produces louder noise).

In terms of scale, larger turbines (from 1MW to 5MW) yield more power at relatively lower capital cost, and are preferred whenever it is possible to carry and install them—also because there are high fixed costs for developing a wind farm that must be sustained, regardless of installed capacity.

In terms of location where the technology can be installed, wind turbines can be installed onshore or offshore—the key technological aspect involved in offshore developments concerns the foundations, which are best placed in shallow waters (up to 20 meters) and close to shore (up to 20 kilometers).⁹⁹

Other technical issues and opportunities for developing wind energy in Anguilla

There is limited ability to integrate intermittent power supply in the electricity system of Anguilla. The share of intermittent generation that a grid can handle depends on the response time of available stand-by and load-following generating units—diesel units typically have rapid response times. Additional diesel backup would be needed for developing wind farms beyond 15 percent of peak capacity, which is an approximate estimate ANGLEC mentioned for grid-integrated intermittent capacity (about 0.5MW for each additional MW of wind), and this would carry a high cost.¹⁰⁰

There is also limited availability of land for installing onshore wind farms in Anguilla. This limits the possibility of installing larger and more cost-effective turbines (3 to 5MW), and requires using turbines of 1MW or less instead. Limited availability of land also constrains the choice of sites with a good wind resource and adequate accessibility. Reportedly, some are also concerned about the visual impacts and noise of wind farms, and the negative impact this could have on the high-end tourism industry in Anguilla.

Emerging technologies for energy storage and offshore wind forecasting devices should be considered in the medium term for increasing the share of grid-connected wind energy in Anguilla. Provided the cost of these technologies decreases over the next few years, they represent an interesting potential alternative to a strategy that only relies on additional rapid-response thermal capacity. The effect of energy storage technologies is to increase the effective capacity factor of a wind farm, ensuring better grid stability. Offshore wind forecasting devices provide early warning about changes in expected wind energy output—allowing ramping up of rapid response plants if wind decreases, or ramping down generation from wind in the event of storms (wind speeds of over 25 meters per second are too high for turbines to withstand).

Finally, interruptible loads (customers that pay a special tariff accepting that service to them may be interrupted at certain times) may help stabilize the effects on the grid of

⁹⁹ European Wind Energy Association, *Oceans of Opportunity*, September 2009.

¹⁰⁰ Conversations with ANGLEC. January-April, 2012

intermittency. Interruptible loads are not uncommon in Anguilla, but are handled on a case-by-case, as-needed basis.

Costs of wind energy

Capital costs of wind energy vary greatly depending on the technology, the site, and the scale of a wind project.

‘Class 1’ turbines (such as those produced by Vestas), designed to withstand extreme gusts of 250 kilometers per hour, and average annual wind speeds of 10 meters per second, have installed capital costs of about US\$1,800 per kW;¹⁰¹ lowerable or tiltable turbines (such as those produced by Vergnet¹⁰²), designed to lower or tilt down the nacelle and blades in case of hurricanes, cost more (up to US\$3,000-US\$3,500 per kW). Only a detailed study for a specific site can price accurately the capital and O&M costs.

The future costs of wind energy depend on technology and market factors. Supply bottlenecks led to a steady increase in turbine prices, which peaked in 2008 for delivery in 2009. However, an easing of turbine demand in 2009, mainly due to financing issues coupled with an expanding supply chain, led to a global oversupply in 2010. Oversupply in the global wind market has meant that prices for contracts signed in late 2008 and 2009 for delivery in the first half of 2010 fell by 18 percent. The Energy Information Administration (EIA) expects capital costs of onshore wind to decrease by as much as 19.6 percent by 2035, and those of offshore wind to decrease even more (32.4 percent)¹⁰³.

Installed capacity	Unit Capital Cost (US\$/kW)	O&M Costs (US\$/kW/yr)	Capacity Factor (%)	Annual output (GWh/year)	Lifetime (years)	LRMC (US\$/kWh)
Wind Energy (850kW ‘Class 1’ turbines)						
3.4MW	1,800	50	35%	10.4	20	0.09
Wind Energy (275kW lowerable or tiltable turbines)						
3.02MW	3,150	98.5	35%	9.27	20	0.16
Wind Energy (10kW distributed turbines)						
10kW	6,000	110	25%	0.02	20	0.35

Source: Capital and O&M Costs, lifetime: based on information provided by Vestas (Class 1 turbines) and Vergnet (lowerable/tiltable turbines), and information from a 10MW wind farm proposed by BL&P in Barbados. Capacity factor: conservative estimate based on a preliminary assessment by Mistaya Engineering of 39-44 percent in Corito and East End.

Note: discount rate of 9% for distributed scale; 11% for utility scale.

The estimated LRMC for the utility scale wind farm on Anguilla is US\$0.09 per kWh, based on a 850kW ‘Class 1’ turbine with a capacity factor of 35 percent. This is a conservative estimate we adopt for our analysis lacking a detailed estimate—Anguilla’s preliminary

¹⁰¹ Vestas, <http://www.vestas.com/en/wind-power-plants/procurement/turbine-overview.aspx#/vestas-univers>, <http://www.vestas.com/en/wind-power-plants/wind-project-planning/siting/wind-classes.aspx#/vestas-univers> (last accessed 20 December 2010).

¹⁰² Vergnet Wind, <http://www.vergnet.fr> (last accessed 21 December 2010).

¹⁰³ United States Energy Information Agency, *Assumptions to the Annual Energy Outlook 2010*, 2010

estimate is for capacity factors between 39 and 44 percent for a 800kW turbine produced by Enercon;¹⁰⁴ very high capacity factors, however, are not uncommon in this region. Lowerable or tiltable turbines would have a higher LRMC with the same capacity factor—about US\$0.16 per kWh. LRMCs of distributed scale turbines, assuming a lower 25 percent capacity factor (since it may be assumed that the best sites would be those for utility scale wind), would be US\$0.35 per kWh for a 10kW turbine.

Conclusions on wind energy in Anguilla

Wind energy represents an interesting potential for Anguilla, but a less immediate one than solar which, in spite of higher costs, is easier to design, install, operate (with a much lower intermittency—and a very predictable load), and maintain. In any case, detailed information is needed to assess how much of Anguilla’s wind potential is technically feasible and commercially viable. In particular, the country would benefit from detailed assessments for onshore potential, and potentially for offshore potential. Assessing offshore wind could be especially important, because it might address a key limitation to developing wind energy in small island countries—limited availability of land.

Finally, the scope for developing wind energy could increase significantly if energy storage and wind forecasting solutions become technically and commercially viable.

An initial limit of 15 percent peak capacity might be a reasonable and safe first step for integrating wind energy in Anguilla’s grid until better information on the resource is collected (and experience in managing wind farms is gained), and proves that it is technically and economically feasible to go beyond this limit.

G.4 Waste-Based Energy

Waste-based energy technologies use waste collected by sanitation authorities to produce energy. Technologies belong to two broad categories: landfill gas to energy, and waste to energy.

Landfill gas to energy harvests the gas created by the action of microorganisms within a landfill after the materials have already been deposited in the landfill. Landfill gas is then combined with various types of technologies (most of them mature) for converting gas to energy. It can be done at both utility scale and distributed scale.

Waste to energy technologies use the waste as fuel, before it is put into the landfill. This has the benefit of reducing waste that goes into the landfill.

Current state of development in Anguilla

There is no landfill gas to energy project or waste to energy project operating in Anguilla. Despite the lack of projects, initial stakeholder consultations showed that there is much interest in using waste as a resource. It is likely that the limited waste stream in Anguilla may sufficient to support only a very small waste-based energy project, if any.

¹⁰⁴ Lambert, Tony. “Anguilla Wind Data Analysis.” Mistaya Engineering Inc., 2008

Primary resource

Anguilla generated an average of 35 tons per day (TPD) of municipal solid waste (MSW) from 2007 to 2011.¹⁰⁵ This tonnage fluctuates significantly throughout the year due to tourist seasons. The amount of waste produced per day includes 15.6 tons per day of household waste, 8.5 tons per day of green waste, 7.6 tons of commercial waste, and 3.3 tons of industrial waste.¹⁰⁶ Currently, all of the waste is dumped in Corito, as no markets exist on the island for recycling or composting these materials, and the quantity is too small to attract a transporter with the exception of metal, due to its high market value (Anguilla, however, does not receive revenue from the sale of metals). A small amount of the waste is crushed at the landfill and used for roadways, but the crusher that is available is frequently broken, and replacement parts are difficult to obtain.¹⁰⁷ The table shows waste production between 2007 and 2011.

Table G1: Corito Landfill Disposal Data in Metric Tons (2007-2011)

Year	Household	Green	Commercial	Waste	Total
2007	5,287.65	3,486.89	2,069.03	1,516.84	12,360.41
2008	5,037.98	4,000.76	3,852.11	1,763.85	14,654.70
2009	4,911.18	2,027.22	3,204.73	846.90	10,990.03
2010	6,031.24	3,645.13	2,706.23	1,059.77	13,442.36
2011	7,246.65	2,462.03	2,121.72	747.10	12,577.50

Source: Anguilla's Statistics Unit

Key resource factors affecting the viability of waste-based energy projects include the quantity of waste, and its characteristics. Alkalinity, and internal temperature—in addition to moisture content, and composition of the waste—determine the quality of the landfill gas. The fraction of organic waste and moisture content of the waste determine the Net Calorific Value (NCV) of the waste for waste to energy—a higher moisture content of the waste decreases its NCV. In order to accurately assess the potential for landfill gas generation and the NCV of Anguilla's waste, a detailed study of the waste should be carried out.

Technology for Waste-Based Energy

Technologies for landfill gas to energy and waste to energy are proven and commercial. Currently, waste to energy is used in more than 25 countries.¹⁰⁸ Several different technologies can be used for converting producing waste-based energy. Most processes produce electricity directly through combustion, while others produce combustible fuels such as methane, methanol, ethanol, or synthetic fuels.

¹⁰⁵ 2011 Figures are calculated by using the first four months (the only months for which data is available) as an approximation of the waste levels for the next eight months

¹⁰⁶ Anguilla Statistics Unit. "Environmental & Climate." Accessed 4/10/2012 at: http://www.gov.ai/statistics/ENVIR_CLIMATE_TAB_10.htm

¹⁰⁷ Clinton Foundation, Anguilla Work Plan-Renewable Energy.

¹⁰⁸ Gamma Energy Ltd. <http://www.gammaenergy.mu/index.php?item=16&lang=1>

The key technologies include the following:

- **For Landfill gas to energy:**
 - **Internal combustion engines** are the most commonly used option for landfill gas energy conversion projects. They have comparatively low capital costs, a high efficiency, and a high degree of standardization
 - **Gas turbines** are most economical for capacities of over 3MW. However, they typically have parasitic energy losses of 17 percent of gross output compared to internal combustion turbines (which have parasitic losses of seven percent). The turndown performance of gas-fed turbines is poor compared to internal combustion engines, and difficulties may occur when they are operated at less than a full load. Other problems include combustion chamber melting, corrosion, and accumulation of deposits on turbine blades
 - **Fuel cells** may become attractive in the future because of their higher energy efficiency, negligible emissions impact, lower maintenance costs, and suitability for all landfill sizes (although previous studies have suggested that fuel cells would be more competitive in small to medium projects¹⁰⁹). At present, however, fuel cells remain uncompetitive with conventional applications, due to economic and technical disadvantages.
- **For Waste to energy:**
 - **Anaerobic digestion** (biogas) consists of a series of processes in which microorganisms break down biodegradable material in the absence of oxygen; it is used for industrial or domestic purposes to manage waste and/or to release energy. The technical expertise required to maintain industrial scale anaerobic digesters coupled with high capital costs and low process efficiencies has limited the level of its industrial application as a waste treatment technology
 - **Incineration** (the combustion of organic material) with energy recovery is the most commonly used waste to energy generation technology. Modern incinerators have decreased emissions of fine particulate, heavy metals, trace dioxin and acid gas emissions;
 - **Pyrolysis** is a thermo-chemical decomposition of organic material at elevated temperatures in the absence of oxygen. Pyrolysis is useful for producing combustible fuels: charcoal, biochar, or biofuel
 - **Plasma arc gasification** is an experimental technology that uses an electric current that passes through a gas (air) to create plasma, a collection of free-moving electrons and ions. When plasma gas passes over waste, it causes rapid decomposition of the waste into its primary chemical constituents which is normally a mixture of predominantly carbon monoxide and hydrogen gas, known as syngas. (The extreme heat causes the inorganic portion of the waste

¹⁰⁹ United States Department of Energy (1997). *Renewable Energy Annual 1996. Chapter 10 – Growth in the Landfill Gas Industry*, <http://www.p2pays.org/ref/11/10589/chap10.html>

to become a liquefied slag, which is cooled and forms a vitrified solid upon exiting the chamber.) The syngas can be combusted in a second stage in order to produce process heat and electricity.

The scale of waste-based energy plants depends on the type of technology used. Incineration technology requires a very large amount of waste to be viable. Commercial-scale plants using pyrolysis and gasification would typically be in the order of 20,000 to 250,000 tpa¹¹⁰. Pyrolysis to charcoal and energy plants range from 20,000 to 50,000 tpa, with an energy output of 1MW to 2MW. Anaerobic digesters, however, can have a capacity as small as 100kW, and run on a waste stream not too much higher than Anguilla's—however, the smaller the unit, the higher the cost.

Landfill to gas energy engines range from small scale (about 300kW) to utility scale (3-5MW, and above for gas turbines). Utility scale engines require at the least 150,000 tpa for the reciprocating internal combustion engines—according to some industry estimates (confidential source), a 850kW plant would require a cumulative amount of one million tons of waste to operate with a 95 percent capacity factor. As a comparison, Anguilla's cumulative amount of waste produced over the past ten years was less than 100,000 tons. Smaller units of about 270-300kW would require about one third of that amount (approximately 300,000 tons in total), which is still more than Anguilla can produce. Gas turbine and fuel cell engines are larger and require significantly more tonnage still.

Costs of Waste-Based Energy

Internal combustion turbines, incinerators, and gas turbines are mature technologies, and their costs are unlikely to decrease significantly in the future. Anaerobic digesters, pyrolysis, plasma arc gasification, and fuel cell technology, however, are not yet fully mature technologies, and their costs are likely to decrease with further technology developments and experience or learning effects.¹¹¹

Municipal solid waste to energy plants come in many different sizes and varieties. Costs can vary from technology to technology. Variables such as capacity, the amount of up-front sorting required, emission testing and monitoring technologies, operator training, and ash management also have an impact on the project costs. Incinerators require control measures for stack emissions and flue gas cleaning equipment (such as acid scrubbing plant, carbon injection system, electrostatic precipitators or fabric 'type' filters, depending on the type of control system employed). Cleaning processes can form a significant proportion of the overall capital costs of a waste to energy plant—estimated between 30 and 60 percent in the United Kingdom, depending on the waste mix and technology.¹¹² Regulations concerning the design and operation of incinerator plants also mean that the capital costs and operating costs for waste to energy incinerators can be high.

Although reciprocating engine gas and diesel generators are based on the same type of technology, the capital costs for internal combustion and gas generators are higher than

¹¹⁰ Last S., *Pyrolysis and Gasification*, Mechanical Biological Treatment Website, 2008, http://www.mbt.landfill-site.com/Pyrolysis_Gasification/pyrolysis_gasification.html, last accessed 29 September 2010.

¹¹¹ Schoots K., Kramer G.J., van der Zwaan B. (2010). *Technology Learning for Fuel Cells: An Assessment of Past and Potential Cost Reductions*. Energy Policy Vol. 38, Issue 6, pp. 2887-2897

¹¹² S. Last (2008). Mechanical Biological Treatment Website (<http://www.mbt.landfill-site.com/EfW/efw.php>)

those of diesel generators (including generators that are currently operating in Anguilla), but typically lower than other renewable energy technologies. The capital cost of internal combustion engines is about US\$4,000 per kW.¹¹³ Because landfill gas is free, and the operations and maintenance costs for gas engines are low (usually about US\$0.03 per kWh), landfill gas to energy is generally more competitive than other renewable energy technologies, and competitive with conventional generation given their fuel expenses.

Landfill gas to energy project costs include costs for gas collection and flaring, electricity generation, and direct use. Each project involves the purchase and installation of equipment (capital costs) and the expense of operating and maintaining the project (O&M costs). The viability of a landfill gas to energy project depends primarily on the price and efficiency of the generator used, and the quality and quantity of the landfill gas resource.

Waste to energy plant capital expenditure can range widely, depending on the technology, and waste stream composition and quantity. Incineration technology is mature, and has limited scope for additional 'learning' effects. It is unlikely to benefit from a significant decline in cost (unless the cost of materials, inputs or labor used to make incinerators decrease). Newer types of waste to energy technologies, however, may benefit from learning effects that could lead to a decline in capital costs. Biogas costs are influenced by factors such as climate, organic content in the waste, and digester type; all-in cost for a biogas system with a digester can range from US\$4,000 to US\$8,000 per kW installed (confidential source). The digester is typically 70 to 80 percent of the project cost.

Installed capacity	Unit Capital Cost (US\$/kW)	O&M Costs (US\$/kW/yr)	Capacity Factor (%)	Annual output (GWh/year)	Lifetime (years)	LRMC (US\$/kWh)
Landfill gas to energy (internal combustion)						
270kW	4,000	157	90%	2.12	20	0.08
Waste to energy (anaerobic digester/biogas)						
100kW	5,000	150	85%	.75	20	0.10

Source: Confidential.

Note : discount rate of 11%.

Conclusions on Waste-Based Energy in Anguilla

A biogas plant (about 100kW) may be the most feasible waste-based energy project in Anguilla, given the available waste stream. A small landfill gas to energy plant (270kW, internal combustion) may be the next closest potential in the medium to long term. Provided that there exists enough waste stream (with a sufficiently good composition) to build an economically viable plant, the LRMC for both types of plants is very attractive—of course, only one of the two could be realized.

¹¹³ United States Environmental Protection Agency, *Landfill Gas to Energy Project Development Handbook*, 2010

Appendix H: Calculation of Long Run Marginal Cost of Renewable Energy Generation

We use the following assumptions for calculating the LLMCs of each renewable energy generating technology (US\$ per kWh):

- *Capacity factor*—that is, the share of time, expressed in percentage, at which a plant can operate at full capacity. This involves estimating the yearly output each renewable generation technology could produce (capacity factor multiplied by installed capacity multiplied by hours in a year provides the annual energy output). This would include resource availability (for example available solar energy, wind speed profile, and conversion efficiency of the technology)
- *Capital costs, in US\$*—we estimate capital costs (nominal costs based on current prices) based on discussions with the Government and stakeholders about market conditions in Anguilla (where available, such as for solar technologies), information from other Caribbean or small island countries we have worked in (Turks and Caicos Islands, Barbados, Jamaica, Mauritius), and our experience of the North American and Caribbean renewable generation market
- *Operation and maintenance (O&M) costs, in US\$ per kW per year*—we estimate O&M costs (nominal costs at current prices) based on the same sources used for capital costs
- *Lifetime, in years*—we estimate the lifetime of renewable generation equipment based on our experience of renewable generation technologies, in most cases 20 years being a reasonable approximation
- *Discount rate*—we assume a nominal discount rate of 9 percent for distributed renewable energy technologies (based on information provided by AREO on typical rates available from commercial banks in Anguilla), and 11 percent for utility scale ones (a conservative assumption, based on information provided by ANGLEC on a 10 percent WACC for its conventional operations). We recognize that developers of utility scale technologies may, in fact, secure a lower cost of capital; however, we keep a value of 11 percent to assess the viability of utility scale renewables more conservatively

The formula to calculate the cost of power from any technology is:

$$\text{Cost of power (US\$ per kWh)} = \frac{\text{Annualized capital and O\&M costs (US\$)}}{\text{Annual energy output (kWh per year)}}$$

- *Tariffs and conventional energy costs*—we estimate tariffs and conventional energy generation costs based on a cost for diesel No. 2 of US\$4.00 per gallon (see Appendix F).

Appendix I: Calculation of Marginal Cost of Carbon Abatement for Renewable Energy Technologies

We calculate the cost of CO₂ abatement as follows:

- *Country-wide emission factor of 0.7 tons of CO₂e per MWh*—first, we calculate emission factors for each plant type based on the carbon content of diesel fuel, according to the guidelines of the Intergovernmental Panel on Climate Change (IPCC)¹¹⁴ and estimated thermal efficiency factors (the percentage of the fuels’ energy content that is transformed in electricity).¹¹⁵ Then, we include losses. Finally, we calculate a weighted average of plant emission factors (based on relative generation in MWh) between High Speed and Low-Speed units operating in Anguilla¹¹⁶. The result (0.7 tons of carbon dioxide equivalent (tCO₂e)¹¹⁷ per MWh generated) is close to common rough approximations of emissions factors from fossil fuel plants
- *Cost of abatement*—we calculate the cost savings (US\$ per kWh) of each technology by subtracting its LRMC from the appropriate benchmark generation cost (as discussed in 5.2.2) for Anguilla’s diesel plants. Then, we divide the cost savings by the avoided emissions (that is, the emission factor but expressed in tCO₂e per kWh instead of MWh). We use the following formula:

$$\text{Cost of abatement (US\$ per ton of CO}_2\text{)} = \frac{\text{Cost savings (US\$ per kWh)}}{\text{Avoided emissions (tons of CO}_2\text{ per kWh)}}$$

¹¹⁴ 19.2 kg of carbon per GJ for diesel. We convert carbon into CO₂ by a factor of 3.67 to account for the higher molecular weight of CO₂ after oxidation of carbon (44/12 is the ratio between the molecular weights of carbon and oxygen)

¹¹⁵ Assumed thermal efficiency factor of 39% for high speed diesel units, and 41% for medium speed diesel units.

¹¹⁶ Assumed 98 percent of generation in Anguilla is from medium-speed diesel units, and the remaining 2 percent from high-speed units.

¹¹⁷ The word ‘equivalent’ refers to the fact that, based on IPCC guidelines, greenhouse gases other than carbon dioxide may be expressed in carbon dioxide terms using their global warming potential.

Appendix J: Recommended Changes to ANGLEC's Licence and Electricity Supply Regulations

We recommend adding the following definition in section 1.1 of both ANGLEC's Public Supplier's Licence and Schedule 1 of the Electricity Supply Regulations:

'Approved Renewable Energy Costs' are any of the following costs, if the Licensee complied with the Schedule 'Rules for Renewable Energy' in incurring them:

- *renewable power generation investments that are made by the Licensee, and operating and maintenance expenses, depreciation, and any taxes of those investments that are incurred by the Licensee,*
- *utility scale renewable power purchase costs that are incurred by the Licensee, as a consequence of purchasing renewable power from third parties, and*
- *distributed scale renewable power purchase costs that are incurred by the Licensee, as a consequence of purchasing renewable power from its consumers.*

The Schedule 'Rules for Renewable Energy', shown below, would be the Schedule to ANGLEC's Public Supplier's Licence (which has no other schedules), and would be placed at the end of Schedule 1 of the Electricity Supply Regulations.

We also recommend adding the following statement in section 4.4 of both ANGLEC's Public Supplier's Licence and Schedule 1 of the Electricity Supply Regulations:

The Minister or the Arbitrator shall consider that Approved Renewable Energy Costs are reasonably incurred.

SCHEDULE

Rules for Renewable Energy

Utility scale renewable energy generation

For the purpose of developing, procuring, or contracting new renewable energy generation capacity at utility scale, the Licensee is to take all of the following steps:

1. Prepare a demand forecast, which identifies expected future requirements for new firm and non-firm capacity, and the expected timing for commissioning.
2. Prepare a least cost generation plan that identifies candidate plant for firm and non-firm generation capacity required to satisfy projected demand at least cost (while preserving system reliability and power quality, and creating no unreasonable financial risk), with full consideration of renewable energy generation options (including those at distributed scale) alongside conventional generation options.
3. Consult with the public on the demand forecast and least cost generation options.

4. Adopt the least cost generation plan after making any changes that it considers desirable based on public consultation.
5. Identify the best option to design, build, operate, maintain, and finance required new renewable energy generation capacity by:
 - Assessing three possible options: (i) fully developed by the Licensee; (ii) procured to a specialized contractor under a Design, Build, Operate, and Maintain (DBOM) contract; or (iii) contracted to an Independent Power Producer (IPP); and
 - Selecting the option most likely to deliver reliable electricity at least cost, while preserving system reliability and power quality, and creating no unreasonable financial risk.
6. When the option identified is either procurement under a DBOM contract, or contracting an IPP:
 - Determine the bidding documents to be used;
 - Publish a request for expressions of interest for prequalification of bidders, stating minimum technical capacity, minimum financial capacity, and minimum relevant experience required;
 - Evaluate expressions of interest of qualified bidders;
 - Prepare a short list of up to five bidders;
 - Issue a request for proposals to shortlisted bidders, stating: full specifications of the goods, services, or works to be provided; full evaluation criteria (technical, financial, experience, and other) and detailed evaluation process, aiming to ensure reliable power at least cost and low financial risk; and any legal or commercial requirements;
 - Evaluate proposals received;
 - Approve the award of any contract;
 - Award one or more contracts to successful bidders; and
 - Announce successful bidders and publish key contract terms after contract signature.
7. Regularly update demand forecasts and least cost generation plans, and consult with the public at each update.

Distributed scale renewable energy generation

For the purpose of contracting new renewable energy generation at distributed scale, the Licensee is to take all of the following steps:

1. Identify the maximum contribution that distributed renewable energy generation can make to Anguilla's electricity supply without affecting grid stability and reliability of service, based on the most recent least cost generation plan.

2. Create a grid and distributed generation code setting out rules for safely interconnecting distributed renewable energy generation to the grid, as well as limits on the maximum unit size and total capacity, if required.
3. Create a Standard Offer Contract under which the Licensee buys excess power from owners of eligible distributed renewable energy generation:
 - at a price that compensates owners for the Licensee’s cost of generation that is offset by distributed generation under realistic dispatching conditions;
 - subject to compliance with the rules for safely interconnecting distributed renewable energy generation to the grid set out in the grid and distributed generation code, which is to be part of the contract; and
 - for a term that is to be set out in each contract issued, and which is not less than the number of years that corresponds to the useful lifetime of the distributed renewable energy system.
4. Amend by agreement in writing, in accordance with paragraph 4.1 of this Licence, the terms and conditions of affording a supply of electricity to a consumer, or potential consumer, with whom the Licensee has a standard offer contract for purchasing excess electricity, having regard to the services that the Licensee provides to the consumer and to the Licensee’s needs to recover fixed costs.
5. Submit the Standard Offer Contract to the Minister, giving him an opportunity, during a period of ninety days from the submission, to object to the contract for any one or more of the following reasons, but no other:
 - the maximum quantity of distributed generation eligible for the Standard Offer Contract will negatively affect grid stability or reliability of service;
 - the technical requirements contained in the grid and distributed generation code will not allow safe interconnection;
 - the price will not compensate the owners for the Licensee’s cost of generation that is offset by distributed generation under realistic dispatching conditions; or
 - the term is not the minimum number of years that corresponds to the useful lifetime of a distributed renewable energy system.
6. Within thirty days from the receipt of the Minister’s objection, refer to the Arbitrator, for determination within forty-five days from the referral, the question whether the Minister’s objection is supported by valid and accurate information and is therefore justified. The costs of the arbitration shall be borne in such a manner as the Arbitrator shall decide.
7. Consider that the Standard Offer Contract is approved by the Minister if the Licensee receives no objection in writing before the expiry of the ninety days referred to in paragraph 5 or, in the case of a reference to

the Arbitrator under paragraph 6, if the Licensee receives no determination in writing before the expiry of the forty-five days.

Appendix K: Optional Changes for ANGLEC’s By-laws or New Policy

ANGLEC may amend its by-laws to adopt these rules and so require that the rules be followed, instead of leaving it up to the Board whether ANGLEC follows the rules or not. To do so, ANGLEC may add the following sentences after the full stop in paragraph 4.1 of its by-laws:

In managing the business and affairs of the company, the directors, and any person to whom their powers are delegated under paragraph 4.10 or otherwise, shall comply with the ‘Rules for Renewable Energy’ set out in the Schedule of ANGLEC’s Public Supplier’s Licence, and Schedule 5 of the Electricity Supply Regulations.

In the management of the business and affairs of the company, the Rules for Renewable Energy have effect, subject to any variation by the directors—or any person to whom their powers are delegated under paragraph 4.10 or otherwise—that is previously authorized, or subsequently ratified, by ordinary resolution of the shareholders.

Alternatively, ANGLEC may incorporate the substance of the rules as new policy by adopting a new ‘Policy for Renewable Energy’, containing the following sentences:

Considering Anguilla’s dependency on imported fossil fuels for electricity generation; its severe impact on the country; and the potential to generate electricity with renewable energy sources in a way that is economically viable, contributes to energy security, and enhances local and global environmental sustainability, the company adopts this policy to guide the management of the business and affairs of the company.

In managing the business and affairs of the company, the directors, and any person to whom their powers are delegated under paragraph 4.10 of the by-laws or otherwise, intends to use its best endeavors to comply with the ‘Rules for Renewable Energy’ set out in the Schedule of ANGLEC’s Public Supplier’s Licence, and Schedule 1 of the Electricity Supply Regulations.

With this policy, the company commits to:

- *Reliable electricity at least cost;*
- *Better energy security;*
- *Greater environmental sustainability;*
- *Transparency and consultation in generation planning; and*
- *Probity and competition in procurement.*

Appendix L: Recommended Changes to the Electricity Act

We recommend amending the Electricity Act, Part 2, Section 2, subsection 2 by adding the following text in bold, and deleting the word ‘only’ from the phrases “for the purpose only of supplying electricity”:

(2) Subsection (1) shall not apply to the use of any electrical plant which—

*(a) is powered only by wind and which is used by any person for the purpose ~~only~~ of supplying electricity to his own premises, **or selling excess electricity to a public supplier if the person has a contract with the public supplier to do so;***

*(b) is used only for the photovoltaic generation of electricity by any person for the purpose ~~only~~ of supplying electricity to his own premises, **or selling excess electricity to a public supplier if the person has a contract with the public supplier to do so;***

Appendix M: Government's Terms of Reference for Renewable Energy Integration in Anguilla

Consultancy to Produce Recommendations and Draft Legislation to Amend Anguilla's Electricity Legislation to Support Renewable Energy Integration

1.0 BACKGROUND

1.1 Introduction

1.1.1 Anguilla is a British Overseas Dependent Territory, commonly referred to as a British Overseas Territory. With a population of 15,000, it is a very small services oriented economy, centered around tourism primarily, and offshore finance secondarily. It has associate membership in the Organization of Eastern Caribbean States (OECS), a smaller sub-regional organization; and the Caribbean Community, CARICOM, the larger regional organization.

1.2 Electricity Sector

1.2.1 The Electricity infrastructure in Anguilla is insular, with the island's commercial production of electricity being completely dependent on fossil fuels, (No 2 LFO Diesel). Demand for electricity has been growing continuously (4-6 percent per annum) driven purely by commercial and residential sectors in a tourism based-economy. To ensure a reliable supply in such a small (15MW peak demand) and insular electricity system, the island's electric utility has to maintain a large reserve margin and to ensure regular investments in new capacity.

1.2.2 In Anguilla, the Electricity Act (R.S.A. c. E35) offers the sole electric utility an exclusive license to produce, transmit and distribute electricity. Anguilla's electricity supply is dominated by a single supplier. The financial crisis of 2008-2011 has resulted in a heavy slowdown in electricity demand growth, resulting in a lower need to add electricity supply capacity. However, the crisis has made the consequences of high electricity costs especially burdensome for electricity consumers who are affected by a lower purchasing power. This burden is greatest on consumers on the lower end on the economic scale and is particularly harsh on those that fall below the poverty line.

1.2.3 The utility is regulated by the Minister with responsibility for electricity, in the Ministry of Infrastructure, Communications, Utilities and Housing (MICUH) in the Government of Anguilla, which in reality lacks regulatory capacity. The electric utility's oversight by government is thus limited; hence, to a large extent the utility is self-regulated. Consequently, the utility's financial and operational efficiencies may at

times fall below acceptable levels putting undue burden on consumers in higher electricity rates, and electricity supply reliability at risk on such occasions. Integrating surplus electricity from alternate energy producers into the grid and investments in wind, solar or waste-to-energy electricity production could improve the overall performance of the electricity supply industry. However, such investments take time to develop and would benefit from a clear investment framework, along with incentives or penalties for both Independent Power Producers (IPPs) and private consumers to invest.

1.2.4 No significant integration has taken place as yet and it would be prudent to first make the necessary legislative amendments to accommodate this type of environment. However, caution must be exercised in this area as both independent generation for self-use and feeding back excess private generation onto the grid for the utility to purchase could have negative consequences on the utility in the medium and long run.

1.2.5 The Electricity Act defines electricity price adjustment rules and governance in a two-fold manner: through an automatic mechanism that adjust tariffs to fuel costs through a fuel surcharge (see Electricity (Rates and Charges) Regulations R.R.A. E35-2 in Appendix 1)) and; by means of the utility filing an application for a tariff variation to the Regulator, in this case the Minister with responsibility for Energy (see the Public Suppliers License, Appendix 2). These price adjustment mechanisms have not been updated since their initial institutionalization, notwithstanding the changing reality regarding fuel costs and the scope of the utility's operations. The drawbacks of these types of automatic price adjustment mechanisms became evident during the large fuel price rises in 2008/9.

1.2.6 The price of electricity in Anguilla is not the highest in the sub-region, however, the price of electricity in the sub-region in general (i.e. Eastern Caribbean countries) is perhaps amongst the highest in the world. This can be attributed to several reasons:

- a. external factors which Anguilla nor the sub-region has no control over (price of fuel on the world market, being at the end of the supply chain, etc.).
- b. structural reasons that drive costs up and reduce the scope for cost limitations (small size of the electricity systems, insularity, and lack of alternatives to fossil fuel).
- c. the technical requirements that the utility is obliged to meet may inadvertently increase end-consumer costs, for example by not adequately differentiating temporal variations in the cost of generation in the price of electricity sold to customers.

d. the possible need for regulatory adjustment. This could:

a) produce more efficient and updated regulation in Anguilla that is better adapted to the realities of a relatively small demand base in a high energy price world. This could initiate a broader national reform to increase energy efficiency and sensibly diversify electricity supply through use of alternate sources without blindly copying regulatory mechanisms that may only be suited to larger nations;

b) improve the public's understanding of the utility's realities in particular and the energy sector in general;

c) educate policymakers on the risks, merits, and options for new policies to retard growth in electricity costs;

d) reduce cost volatility by diversifying energy supply away from fossil fuels and to encourage best value investments in electricity supply for both the short and long term.

1.3 Previous Feasibility Work

1.3.1 Limited work has previously been carried out in Anguilla to assess the feasibility and practicalities of introducing renewable generation onto the grid system and will be made available to the supplier. This feasibility work was undertaken with the participation of ANGLEC and other stakeholders and has taken into consideration:

a. costs associated with introducing renewable generation onto the system with attention to local supply and demand scenarios and profiles,

b. The scale of back-up or standby generation needed given demand profiles and scenarios of renewables intermittency

c. existing or opportunity for interconnection or local storage,

d. potential market frameworks for grid-tied renewables

e. the ability of the existing grid infrastructure (physical network and system operation) to manage different flows of energy as generation becomes more disbursed across the island

f. metering, data recording and settlement systems and processes to manage the additional data flows created by distributed generation tie-in.

1.4 ANGLEC

1.4.1 ANGLEC, a fully privately-owned and operated power utility is the sole supplier of electricity in Anguilla. Whilst the utility is a private company, Government and its agencies have retained a majority shareholding.

1.4.2 The establishment of ANGLEC and its area of service are governed by the Electricity Act (R.S.A. c. E35). ANGLEC's mode of generation is by small and medium size diesel generators. The area of service covers the entire island. ANGLEC gets its diesel supply from two sources Sol (St Lucia) Ltd or Delta Petroleum Ltd., depending upon which one of the two bulk importers to the island, it has tendered with. All diesel fuel imports are subject to an import duty. The Electricity supply peaks at 15 MW and includes 24 MW of installed capacity. ANGLEC has a staff of about 70 and started trading as a company in 1991.

1.4.3 ANGLEC's technical losses are estimated to be 9%; non-technical losses are approx 3%. Reliability has historically been very good.

1.5 Anguilla Renewable Energy Office (AREO)

1.5.1 AREO's mandate is "...to facilitate the transition to a renewably-based energy economy for Anguilla by working with stakeholders including Government, ANGLEC, the private sector, the local public and the international community".

1.5.2 The Ministry has been mandated by the Executive Council to coordinate all the various energy initiatives so as to ensure Anguilla's transition to an island with a low carbon footprint. The Ministry will therefore work collaboratively with AREO on energy related matters including this initiative. For this initiative, AREO will be instrumental in the areas of seeking funding, coordination and monitoring.

2.0 GOVERNMENT POLICY

2.1 Energy Policy

2.1.1 A National Energy Policy Framework has been developed for Anguilla. However, the Policy document needs more work to bring it in line with Government's overall energy policy goals and objectives. A Climate Change Policy has also been drafted for Anguilla and certain legislative amendments are necessary to put its recommendations and those of the National Energy Policy into effect. The National Energy Policy document when revised should clearly set out the Government's policies for the planning and management of the energy sector over the next 10 - 15 years. The framework defines the strategies that government is taking to ensure that the objectives of the policy are fully realized. The goal of the energy policy is: To improve the well-being of the people of Anguilla by promoting

the use of its renewable energy resources and implementing cost-effective, equitable, reliable, accessible, affordable, secure and environmentally sustainable energy systems.

2.1.2 In developing the energy policy framework government is mindful of the critical role of the energy sector in the attainment of its overall socio-economic development goals of improving the livelihood of all its peoples, and especially those below the poverty line. There are three principal energy policy considerations that should govern the Anguilla National Energy Policy Framework, namely:

a. Supply issues: For Anguilla the provision of adequate, secure, and cost-effective energy supplies through the promotion of indigenous energy resources specifically renewable energy resources using the least cost options and diversification of supply sources both from within and outside the country is critical to ensuring security of supply.

b. Utilization issues: The efficient utilization of energy and to discourage wasteful and non-productive patterns of energy consumption is vital for a country that is so dependent on imported energy sources.

c. Environmental issues: Due to the fragility of the environment in Anguilla government places environmental issues high on its agenda. Therefore it is important that the energy policies are targeted at minimizing the negative impacts of energy production, transportation, conversion, utilization and consumption on the environment.

2.2 Policy in the Electricity Sector

2.2.1 Specific policies in the electricity sector are to:

a. Ensure that the Anguilla Electricity Company Limited (ANGLEC) operates as a commercial power utility and is able to provide a cost effective and reliable electricity supply to meet the electricity demand of the island.

b. Ensure that ANGLEC is provided with/has access to assistance to develop its human resources capacity in all areas of its operation including, management and technical aspects.

c. Work towards achieving a full cost recovery tariff from all consumers including Government and the private sector in an open and transparent manner.

- d. Ensure that all power supply systems in Anguilla operate with strict adherence to established environmental guidelines.

2.3 Climate Change Policy

2.3.1 In addition to developing an environment in which recommendations of the National Energy Policy can be implemented, the Government of Anguilla seeks to facilitate recommendations of Anguilla's Draft Climate Change Policy.

2.3.2 Some of the goals and objectives driving Anguilla's Draft Climate Change Policy is the commitment to *"Achieve energy independence and the ability of Anguilla to meet its vital energy needs with reliable, affordable, and renewable, energy resources, through the pursuit of a balanced and advantageous transition toward control of our energy future, built upon a solid and ever growing foundation of our own free, abundant, clean and renewable energy resources – (the wind and the sun);"* (Transforming to a Climate-Resilient, Energy Efficient and Low Carbon Economy-Anguilla's Climate Change Policy (DRAFT), Ministry of Environment, 2010).

2.3.3 The draft CLIMATE CHANGE POLICY STATEMENT reads (Transforming to a Climate-Resilient, Energy Efficient and Low Carbon Economy-Anguilla's Climate Change Policy (DRAFT), Ministry of Environment, 2010):

"Climate Change presents an immediate and urgent threat to the sustainable development and sound socio-economic growth of Anguilla, therefore this policy will ensure that by addressing gaps and deficiencies in existing legislation, policy and institutional arrangements and by facilitating functional co-operation and awareness through an integrated and holistic approach among government, private sector and other members of civil society, resilience is built to insure that the island is sufficiently able to manage the impacts and risks from Climate Change while transforming to climate resilient, energy efficient low carbon economy for present and future generations."

3.0 OBJECTIVES OF GOVERNMENT AND THIS CONSULTANCY

3.1 **Implementation of Anguilla's Climate Change Policy:** The Climate Change Policy statement has as one of its principle tenets the building of resilience "... to ensure that the island is sufficiently able to manage the impacts and risks from climate change whilst transforming to a climate resilient, energy efficient, low carbon economy for present and future generations". This consultancy seeks to provide the legislative and other frameworks for the introduction/implementation of renewable energy systems and initiatives that seek to bring about energy efficiency, reliability and less dependence on fossil fuels and will feed directly into creating an energy efficient, low carbon economy, supporting the implementation of the Climate Change Policy.

3.2 Implementation of Anguilla's Energy Policy: The goal of the Energy Policy is to improve the well-being of the Anguillian people by promoting the use of renewable energy resources and implementing cost-effective, equitable, reliable, accessible, affordable, secure and environmentally sustainable energy systems. In order to accomplish this goal the legislative framework for renewables must first be in place.

3.3 Address Linkages: The main link between the Climate Change Policy, Anguilla's Energy Policy and this consultancy process is that the Executive Council (i.e., Cabinet) has concluded that the information gained through this consultancy is necessary to enact the legislative change that both the Climate Change Policy and Energy Policy need in place for several of their recommendations, including:

3.3.1 creating a legislative framework for customer-generated renewable power

3.3.2 ensuring universal access to an affordable electricity supply for all Anguillians particularly those below the poverty line for whom basic access is still in doubt.

3.4 Address affordability of electricity: To reduce the overall cost of electricity to the nation, and to decouple the cost of electricity from world energy prices so as to improve the predictability of electricity pricing. Due to external factors that Anguilla has no control over, the price of electricity in Anguilla is very high. When oil prices increase the cost of electricity increases however when oil prices decrease the cost of electricity does not necessarily decrease. Consequently, many economically disadvantaged Anguillians are now being dropped from the grid or are left off the grid because of an inability to pay due to the high costs of electricity. With this initiative it is anticipated the environment will be created that will foster, promote and develop an affordable and reliable supply of energy from renewable sources that would be made available to all Anguillians, including those below the poverty line for whom access to electricity is currently in doubt.

3.5 Address link between water and electricity production: The largest single cost-component in the production of water in Anguilla is electricity (approx 40 cents of every dollar). Anguilla has found the coupling of water prices to world energy prices to be economically unsustainable as it makes water unaffordable to the less well off. By enabling the reduction in the cost of electricity, this consultancy will help ensure that water production is also affordable by the less well off.

3.6 Policy and Action: The Ministry of Infrastructure expects to use the outputs of the consultancy, including review findings, recommendations about amendments to

electricity legislation and the draft legislation (bills and regulations) as the primary input to policy change. Consultations with key stakeholders will be held to gather feedback on the draft legislation provided by the consultant. This feedback, where appropriate, will be incorporated into the draft legislation by the Attorney General's Chambers for submission to the Executive Council. Any necessary changes will be incorporated into the draft legislation, and upon approval by the Executive Council, the Ministry will then engage in a national consultation process and receive inputs from the public sector, the private sector, academia and civil society. The feedback, where appropriate, will be fed into the bills and regulations which will then tabled by the Minister before the House of Assembly for discussion, debate, final amendment if necessary, and passage into law. With the legislative framework in place the goals and objectives of the policies can then be implemented.

3.7 Maximize Benefits of Government and Civil Society Support: With the constant increase in prices for diesel oil on the world market, electricity prices are also constantly increasing in Anguilla as a result. Being a relatively small customer at the end of the supply chain and having no control over external factors affecting fuel prices, there is nothing anyone can do to influence the high prices. This has forced both government and civil society alike to increase their energy efficiency and seek out alternate sources of energy. Anguilla has an abundance of natural resources (sun and wind); it may be prudent therefore to harness these natural resources into a reliable and renewable source of energy from which the island could use to hedge against the high costs of energy. With determination, these natural resources can be further developed into a sustainable, renewable and affordable source of energy to the benefit of all Anguillians.

3.8 Address Overall Framework: The current electricity supplier operates with an exclusive license to generate and distribute electricity. The legislative and regulatory framework currently in existence provides for this as the utility requires some form of protection to ensure a large enough customer base to make it commercially viable. To unilaterally change the legislative and regulatory framework to allow for renewable energy tie-in to the national grid cannot be done before first understanding the whole framework, because this will have very serious implications for the sustainability of the current supplier. If grid-tie of renewables were permitted on the national grid without regulation, the utility will be overrun with consumers who want to sell power to the utility. Initially the utility will welcome the idea as it means less generation thus cost savings, however, the penetration point is reached where, if too much generation from renewables is put on the grid, the utility will become unsustainable as it conceivably could end up buying or being offered more power than it is generating and selling. It will quickly degenerate into a loss making venture. Thus the regulatory framework to allow renewables on the grid cannot be changed without understanding the whole framework of the legislative and regulatory structure.

3.9 Change legislative and regulatory framework to support uptake of renewables: Because of the high cost of electricity in Anguilla and the every sign of escalating costs if dependence on fossil fuels continues, many consumers including government are looking for alternative energy options and solutions. As there is potential for Anguilla's natural resources (wind and sun) to provide a renewable source of energy, there is much interest being shown from both households and private industry in these alternative energy sources. It is already observed that:

3.9.1 Many consumers both domestic and commercial alike have already started to develop alternative systems on their own. The case is known of one household who already self-generates all its electricity needs through renewables.

3.9.2 Government through its Energy Policy is considering offering economic incentives to businesses and individuals to switch to renewables both for energy generation and in the transportation sector.

3.9.3 The utility company is gearing up for the introduction of renewables and is looking at such initiatives as Time of Use (TOU) tariffs and Demand metering.

3.9.4 Several local retailers have anticipated this demand and have begun selling, solar water heaters.

3.9.5 The tourism industry, NGOs and other civil society is already speaking of a "green" Anguilla where the island can transition to a fully green island meeting all or most of its energy needs through the use of renewable and sustainable energy resources. With this much enthusiasm from such a wide cross section of society, Anguilla feels it could enhance its tourist product by attracting a certain niche of tourist if it can showcase itself as a "green" island.

4.0 OUTCOMES

4.1 The primary outcome of this consultancy should be detailed recommendations for amendments to the Electricity Act and related legislation ("electricity legislation") and assist the Attorney General's Chambers in the drafting of legislation encompassing bills and regulations incorporating these recommendations, thus allowing for the integration of renewable energy and the implementation of several recommendations of both Anguilla's National Energy Policy and Anguilla's Draft Climate Change Policy.

4.2 The consultant shall make recommendations to amend the electricity legislation and support the drafting of new legislation to allow for integration of Renewable Energy onto the electric grid network including but not limited to the purchase of renewable power from small residential consumers, commercial consumers and larger Independent Power Producers (IPPs), and other relevant related and associated matters of renewable and sustainable energy.

4.3 In recommending amendments to Anguilla's electricity legislation for the drafting of new electricity legislation for renewable energy integration, the consultant shall support his findings and recommendations with appropriate qualitative and quantitative justification and have engaged and taken on board the views of the relevant stakeholders namely GOA institutions and agencies (specifically the Attorney General's Chambers), ANGLEC, relevant bi- and multilateral donors, NGOs and private sector representatives.

4.4 Legislative amendments and tariffs governing renewable energy integration have to be transparent and acceptable to the customers. The consultant will therefore provide explanatory narrative suitable for the layperson that explains the benefits of the proposed changes and enables Government (as the regulator) to communicate with ANGLEC and its customers on the methodologies and data used in developing recommendations for new draft legislation, by bills and regulations and for tariffs relating to renewable energy integration. The development of such content will be done in close co-operation with MICUH and AREO.

4.5 The consultant shall also assist in presenting study and review findings and recommendations to the Government, ANGLEC, and to industry stakeholders as appropriate.

5.0 DELIVERABLES

5.1 The following are the expected outputs:

5.1.1 Inception report covering the approach, methodology and work-plan to be followed during the study;

5.1.2 Presentation of the preliminary recommendations at a Stakeholder Workshop;

5.1.3 Final Report comprising:

- a. Exposition of evaluation and decision process and outcomes
- b. Recommendations on legislative amendments to electricity legislation

- c. Support the Attorney General’s Chambers in drafting the electricity legislation (bills and regulations) to incorporate the recommendations.
- d. Roadmap for the introduction of renewables into the energy mix and grid-tie
- e. Roadmap for the implementation of the legislative changes necessary in order to move forward the Energy Policy and Climate Change Policy.
- f. Summary of consultancy process for publication that covers work undertaken, methodologies followed and key outcomes.
- g. Any other outputs the consultant deems necessary for an exercise of this nature.

5.2 The Ministry of Infrastructure, Communications, Utilities and Housing will organize a stakeholder workshop to discuss the consultant’s preliminary recommendations and to build consensus among key stakeholders. Discussions and comments received during the workshop are to be incorporated in the consultant’s final set of recommendations, documents, models, mechanisms and structures.

6.0 THE CONSULTANT

6.1 As a minimum the study will require a technical electricity sector expert and a specialist in energy sector economics and energy policy development with strong work experience and expertise in integrating renewable energy into diesel grids. Ability to make recommendations for legislative amendments and to assist in the production of draft electricity legislation (bills and regulations) which incorporate those recommendations is also required. Work experience and familiarity of the nuances of the region in general and the island in particular would be an advantage but is not an absolute requirement.

While the Anguilla Attorney General’s Chambers will be responsible for the drafting of new legislation, legal expertise to bridge the gap between technical recommendations and the Attorney General’s area of knowledge may be necessary. The Consultant may therefore include up to twenty (20) hours of legal work, preferably sourced from within the Caribbean Region. Estimated pricing for legal work must be included; only actual hours worked will be compensated by the Contracting Authority.

6.2 At the very least two missions to Anguilla will be necessary. A first mission for initial discussions with all stakeholders. A second mission will be necessary for at least the team leader to present the draft report and hold the stakeholder workshop. During the second visit the consultant will also assist in presenting the findings to

key stakeholders. Other visits can be arranged throughout the exercise as may be deemed necessary.

6.3 The Government of Anguilla and the various stakeholders are committed to this initiative, thus will collaborate fully with the consultant by: providing all necessary background information, data and statistics; conducting and finalizing the drafting of new legislation and regulations; facilitating all reasonable needs of the consultant; and being available to provide logistical, secretarial, office accommodation/administrative, communications, any other support necessary and needed by the consultant in order to fulfill his remit.

6.4 The consultant will be supported by local non-profit organization the Anguilla Renewable Energy Office (AREO). The AREO will facilitate the consultancy process by gathering secondary information, organizing and facilitating the consultant's mission trips, designing and conducting the stakeholder consultation process, supporting communications around the drafting of new electricity legislation, creating public outreach materials and monitoring the consultancy process.



www.castalia-advisors.com



The Anguilla Renewable Energy Office (AREO)
www.anguillareo.org



www.cdkn.org

This document is an output from a project funded by the UK Department for International Development (DFID) and the Netherlands Directorate-General for International Cooperation (DGIS) for the benefit of developing countries. However, the views expressed and information contained in it are not necessarily those of or endorsed by DFID or DGIS, who can accept no responsibility for such views or information or for any reliance placed on them. This publication has been prepared for general guidance on matters of interest only, and does not constitute professional advice. You should not act upon the information contained in this publication without obtaining specific professional advice. No representation or warranty (express or implied) is given as to the accuracy or completeness of the information contained in this publication, and, to the extent permitted by law, the entities managing the delivery of the Climate and Development Knowledge Network do not accept or assume any liability, responsibility or duty of care for any consequences of you or anyone else acting, or refraining to act, in reliance on the information contained in this publication or for any decision based on it. Management of the delivery of CDKN is undertaken by PricewaterhouseCoopers LLP, and an alliance of organisations including Fundación Futuro Latinoamericano, INTRAC, LEAD International, the Overseas Development Institute, and SouthSouthNorth.